

**MDV DC Fan Coil Unit
2nd generation Ceiling&Floor Series
Technical Service Manual**

MDV reserves the right to discontinue, or change specification or designs at any time without notices and without incurring obligations.

MBT Confidential

2nd Generation Ceiling & Floor DC Fan Coil Unit

- 1.Features 2**
- 2.External Appearance 2**
- 3.Standard with a variety of control functions 2**
- 4.Standard PCB compatible with more functions 2**
- 5.Products Lineup 3**
- 6.Nomenclature 3**
- 7.Specifications 4**
- 8.Dimensions 13**
- 9.Sound Levels 15**
- 10.Service Spaces 29**
- 11.Wiring Diagrams 30**
- 12.Installation 33**
 - 12.1 Transport and handling 33
 - 12.2 Storage conditions 33
 - 12.3 Units installation 33
 - 12.4 Maintenance 40
 - 12.5 Troubleshooting 43
- 13.Capacity Table 45**
 - 13.1 Cooling capacity table 45
 - 13.2 Heating capacity table 93

1. Features

✦ Flexible for installation, designed for horizontal/vertical, concealed/cabinet application

Ceiling Installation



Floor Installation



Concealed Installation



✦ High efficiency and low operating sound level

Due to the DC fan motor, the unit operates in lower power consumption and lower operating sound level.

✦ Meet CE certification requirements

The unit can meet the latest CE certification requirements for using DC fan motor.



2. External Appearance

Cased Type (H1 Series)
Optional



Cased Type (H2 Series)
Standard



Uncased Type (H3 Series)
Optional



3. Standard with a variety of control functions

✦ Seven fan speed control

Seven Fan speed control function must used the new controller (KJRP-75A/BK-E) and only with 2nd generation indoor unit.



KJRP-75A/BK-E

✦ Centralized control and Modbus

The centralized control function can be connected through the network module whereas the Modbus can be connected through the reserve port.

4. Standard PCB compatible with more functions

✦ Forced fan running function

With/without forced fan on can be set by PCB switch, field adjustable.

MDV DC Fan Coil Unit



Hysteresis temperature setting

Hysteresis temperature can be set in heating and cooling mode by PCB switch, field adjustable.

0-10V wired control


Voltage output of controller	Fan speed
1 ≤ voltage < 3	1
3 ≤ voltage < 4	2
4 ≤ voltage < 5	3
5 ≤ voltage < 6	4
5 ≤ voltage < 7	5
7 ≤ voltage < 8	6
8 ≤ voltage < 10	7

5. Products Lineup

Model	Air volume (CFM)	External static pressure	Power supply
MDKH1/2/3-V150R3 MDKH1/2/3-V150R4	150	MDKH2/MDKH1 models: 0Pa. MDKH3 models: 12Pa.	220~240V-1Ph-50Hz 220~240V-1Ph-60Hz
MDKH1/2/3-V250R3 MDKH1/2/3-V250R4	250		
MDKH1/2/3-V350R3 MDKH1/2/3-V350R4	350		
MDKH1/2/3-V500R3 MDKH1/2/3-V500R4	500		
MDKH1/2/3-V700R3 MDKH1/2/3-V700R4	700		
MDKH1/2/3-V800R3 MDKH1/2/3-V800R4	800		

6. Nomenclature

MD K H2 – V 150 R3

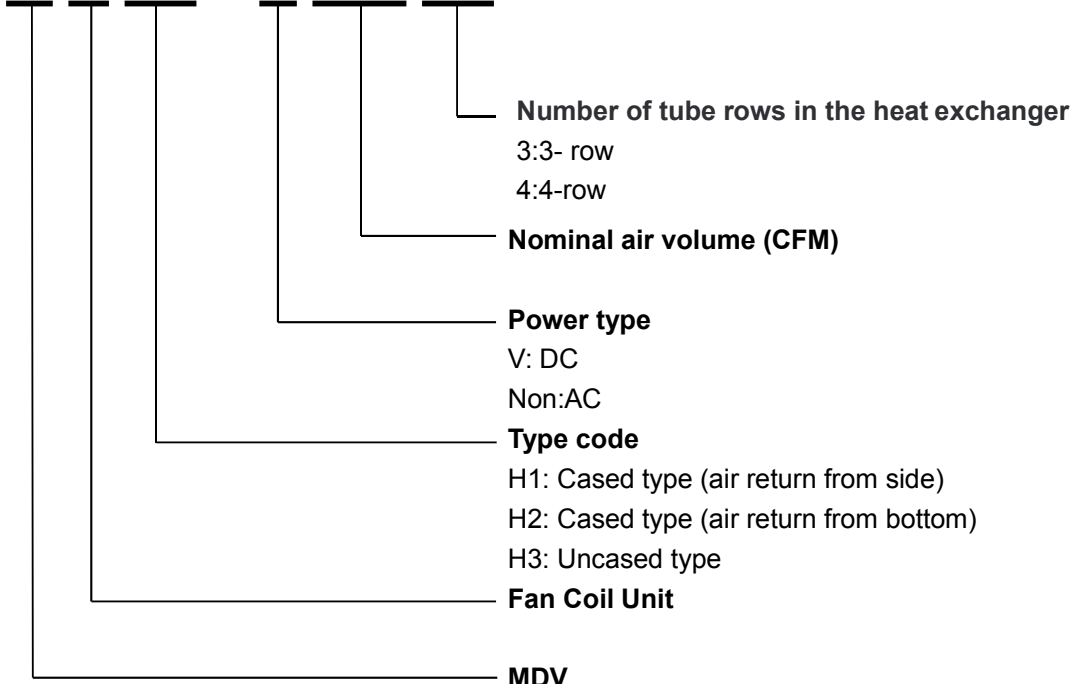

7. Specifications

Model			MDKH1-V150-R3	MDKH1-V150-R4	MDKH1-V250-R3	MDKH1-V250-R4
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	245/160/135	245/180/130	380/245/140	380/240/110
		CFM	144/94/79	144/106/76	224/144/82	224/141/65
External static pressure		Pa	0			
Cooling	Sensible Capacity(H/M/L)	kW	1.09/0.74/0.63	1.36/1.14/0.81	1.70/1.36/0.81	1.84/1.35/0.85
	Capacity (H/M/L)	kW	1.44/1.01/0.88	1.87/1.59/1.16	2.23/1.84/1.13	2.55/1.90/1.26
	Water flow rate	m ³ /h	0.25/0.17/0.15	0.32/0.27/0.2	0.38/0.32/0.19	0.44/0.33/0.22
	Water pressure drop	kPa	13.4/7.9/6.0	26.1/20.1/11.8	12.7/9.5/4.4	23.2/13.5/6.6
Heating	Capacity (H/M/L)	kW	1.50/1.02/0.88	1.97/1.68/1.20	2.47/2.00/1.27	2.63/1.92/1.27
	Water flow rate	m ³ /h	0.26/0.17/0.15	0.34/0.29/0.21	0.42/0.34/0.22	0.45/0.33/0.22
	Water pressure drop	kPa	14.5/7.3/5.6	24.0/18.8/9.9	13.6/9.8/4.3	21.8/12.2/5.9
Power input (H/M/L)		W	19/15/10	20/16/11	20/13/10	21/12/8
Rated current		A	0.20	0.21	0.21	0.22
Sound pressure level	(H/M/L)	dB(A)	34/23/21	39/33/26	30/22/14	33/26/17
Sound power level	(H/M/L)	dB(A)	47/36/34	52/46/39	43/35/27	46/38/30
Fan motor	Type	Low noise DC fan motor				
	Quantity		1	1	1	1
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity		1	1	2	2
Coil	Row		3	4	3	4
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	495×211×790	495×211×790	495×211×1020	495×211×1020
	Packing size (H×D×W)	mm	595×300×895	595×300×895	595×300×1125	595×300×1125
	Net weight	kg	18.0	18.5	21.5	22.0
	Gross weight	kg	23.5	24.0	27.5	28.0
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.

MDV DC Fan Coil Unit



Model		MDKH1-V350-R3	MDKH1-V350-R4	MDKH1-V500-R3	MDKH1-V500-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	580/435/310	580/430/300	780/550/380	780/560/390
		CFM	341/256/182	341/253/176	459/324/224	459/329/229
External static pressure		Pa	0			
Cooling	Sensible Capacity(H/M/L)	kW	2.58/2.08/1.53	2.83/2.29/1.67	3.21/2.52/1.88	3.54/2.77/2.02
	Capacity (H/M/L)	kW	3.41/2.81/2.16	3.80/3.11/2.36	4.25/3.43/2.67	4.73/3.82/2.85
	Water flow rate	m ³ /h	0.58/0.48/0.37	0.65/0.53/0.40	0.73/0.59/0.46	0.81/0.65/0.49
	Water pressure drop	kPa	33.4/24.0/15.0	36.5/25.3/15.0	53.5/35.8/24.1	53.0/35.9/21.2
Heating	Capacity (H/M/L)	kW	3.70/3.02/2.29	3.90/3.13/2.43	4.64/3.65/2.77	5.12/3.98/2.96
	Water flow rate	m ³ /h	0.63/0.52/0.39	0.67/0.54/0.40	0.80/0.63/0.47	0.88/0.68/0.51
	Water pressure drop	kPa	34.2/23.8/14.5	35.6/24.7/13.9	53.6/36.4/22.0	52.0/35.6/20.0
Power input (H/M/L)		W	27/18/11	30/18/12	50/26/15	52/28/15
Rated current		A	0.26	0.28	0.49	0.51
Sound pressure level	(H/M/L)	dB(A)	39/32/24	39/32/24	46/39/30	46/39/30
Sound power level	(H/M/L)	dB(A)	52/45/37	52/45/37	59/52/43	59/52/43
Fan motor	Type	Low noise DC fan motor				
	Quantity	1	1	1	1	
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity	2	2	2	2	
Coil	Row	3	4	3	4	
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	495×211×1240	495×211×1240	495×211×1240	495×211×1240
	Packing size (H×D×W)	mm	595×300×1345	595×300×1345	595×300×1345	595×300×1345
	Net weight	kg	25.5	26.5	25.5	26.5
	Gross weight	kg	32.5	33.5	32.5	33.5
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.

Model		MDKH1-V700-R3	MDKH1-V700-R4	MDKH1-V800-R3	MDKH1-V800-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m³/h	1050/750/450	1050/770/460	1150/850/570	1150/860/600
		CFM	618/441/265	618/453/271	676/500/335	676/506/353
External static pressure		Pa	0			
Cooling	Sensible Capacity(H/M/L)	kW	4.08/3.17/2.14	4.39/3.51/2.36	4.75/4.00/2.91	5.41/4.26/3.02
	Capacity (H/M/L)	kW	4.94/3.94/2.77	5.60/4.58/3.19	6.21/5.17/3.86	7.30/5.88/4.28
	Water flow rate	m³/h	0.85/0.68/0.47	0.96/0.79/0.55	1.06/0.89/0.66	1.25/1.01/0.73
	Water pressure drop	kPa	44.7/29.5/15.6	28.9/19.2/10.1	37.3/28.5/16.4	63.0/40.8/22.5
Heating	Capacity (H/M/L)	kW	5.29/4.20/2.96	6.22/4.95/3.37	6.80/5.46/3.98	7.70/6.02/4.29
	Water flow rate	m³/h	0.91/0.72/0.51	1.07/0.85/0.58	1.17/0.94/0.68	1.32/1.03/0.74
	Water pressure drop	kPa	49.0/33.2/17.0	33.2/22.5/11.0	39.7/27.0/15.4	55.0/36.4/19.2
Power input (H/M/L)		W	98/45/18	99/50/20	105/50/24	105/50/23
Rated current		A	0.85	0.85	0.9	0.9
Sound pressure level	(H/M/L)	dB(A)	52/43/32	52/42/33	53/46/36	53/46/36
Sound power level	(H/M/L)	dB(A)	65/57/45	65/56/46	66/59/49	65/59/49
Fan motor	Type	Low noise DC fan motor				
	Quantity		1	1	1	1
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity		3	3	3	3
Coil	Row		3	4	3	4
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	495×211×1360	495×211×1360	591×211×1360	591×211×1360
	Packing size (H×D×W)	mm	595×300×1465	595×300×1465	695×300×1465	695×300×1465
	Net weight	kg	28.5	29.5	32.5	34.5
	Gross weight	kg	36.0	37.0	41.0	42.5
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.

Model			MDKH2-V150-R3	MDKH2-V150-R4	MDKH2-V250-R3	MDKH2-V250-R4
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	255/170/150	255/210/150	400/315/190	425/300/190
		CFM	150/100/88	150/124/88	235/185/112	250/176/112
External static pressure		Pa	0			
Cooling	Sensible Capacity(H/M/L)	kW	1.14/0.77/0.66	1.42/1.19/0.85	1.79/1.44/0.86	2.06/1.51/0.96
	Capacity (H/M/L)	kW	1.50/1.06/0.92	1.95/1.66/1.21	2.35/1.94/1.19	2.85/2.13/1.41
	Water flow rate	m ³ /h	0.26/0.18/0.16	0.33/0.28/0.21	0.40/0.34/0.21	0.49/0.37/0.24
	Water pressure drop	kPa	13.9/8.21/6.16	27.2/20.88/12.2	13.3/9.98/4.59	26/15.06/7.41
Heating	Capacity (H/M/L)	kW	1.57/1.07/0.92	2.05/1.75/1.25	2.60/2.11/1.34	2.95/2.15/1.42
	Water flow rate	m ³ /h	0.27/0.19/0.16	0.35/0.30/0.22	0.45/0.37/0.23	0.51/0.37/0.24
	Water pressure drop	kPa	15.1/7.63/5.84	25.3/19.65/10.25	14.3/10.33/4.5	24.4/13.65/6.64
Power input (H/M/L)		W	15/9/8	20/14/9	17/12/7	20/11/8
Rated current		A	0.18	0.21	0.20	0.22
Sound pressure level	(H/M/L)	dB(A)	34/24/21	39/33/25	29/24/18	32/23/19
Sound power level	(H/M/L)	dB(A)	47/36/34	52/46/38	43/37/29	46/37/29
Fan motor	Type	Low noise DC fan motor				
	Quantity		1	1	1	1
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity		1	1	2	2
Coil	Row		3	4	3	4
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	495×200×790	495×200×790	495×200×1020	495×200×1020
	Packing size (H×D×W)	mm	595×300×895	595×300×895	595×300×1125	595×300×1125
	Net weight	kg	18.0	18.5	21.5	22.0
	Gross weight	kg	23.5	24.0	27.5	28.0
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.

Model		MDKH2-V350-R3	MDKH2-V350-R4	MDKH2-V500-R3	MDKH2-V500-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	595/470/340	595/450/310	790/580/410	800/600/420
		CFM	350/276/200	350/265/182	488/359/253	471/353/247
External static pressure		Pa	0			
Cooling	Sensible Capacity(H/M/L)	kW	2.65/2.14/1.57	2.90/2.35/1.72	3.25/2.56/1.91	3.63/2.85/2.08
	Capacity (H/M/L)	kW	3.50/2.89/2.22	3.90/3.20/2.43	4.30/3.48/2.71	4.85/3.92/2.93
	Water flow rate	m ³ /h	0.60/0.50/0.38	0.67/0.55/0.42	0.74/0.60/0.47	0.83/0.67/0.51
	Water pressure drop	kPa	34.1/24.63/15.39	37.4/25.91/15.37	54.2/36.22/22.78	54.3/36.81/21.77
Heating	Capacity (H/M/L)	kW	3.80/3.10/2.35	4.00/3.22/2.50	4.70/3.70/2.81	5.25/4.09/3.04
	Water flow rate	m ³ /h	0.65/0.53/0.40	0.70/0.56/0.43	0.81/0.64/0.48	0.91/0.71/0.53
	Water pressure drop	kPa	35.1/24.41/14.82	36.5/25.34/14.22	54.3/36.87/22.32	53.4/36.54/20.47
Power input (H/M/L)		W	26/17/10	29/17/11	50/25/14	52/28/15
Rated current		A	0.26	0.28	0.49	0.51
Sound pressure level	(H/M/L)	dB(A)	38/32/23	40/34/30	46/38/30	45/39/30
Sound power level	(H/M/L)	dB(A)	52/44/36	52/45/36	59/51/43	59/51/43
Fan motor	Type	Low noise DC fan motor				
	Quantity	1	1	1	1	
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity	2	2	2	2	
Coil	Row	3	4	3	4	
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	495×200×1240	495×200×1240	495×200×1240	495×200×1240
	Packing size (H×D×W)	mm	595×300×1345	595×300×1345	595×300×1345	595×300×1345
	Net weight	kg	25.5	26.5	25.5	26.5
	Gross weight	kg	32.5	33.5	32.5	33.5
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.

Model		MDKH2-V700-R3	MDKH2-V700-R4	MDKH2-V800-R3	MDKH2-V800-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	1190/855/505	1190/875/530	1360/1015/685	1300/980/680
		CFM	700/503/297	700/515/312	800/597/403	765/576/400
External static pressure		Pa	0			
Cooling	Sensible Capacity(H/M/L)	kW	4.62/3.60/2.43	4.98/3.98/2.68	5.87/4.74/3.45	6.12/4.82/3.42
	Capacity (H/M/L)	kW	5.60/4.47/3.14	6.35/5.19/3.62	7.35/6.12/4.57	8.25/6.65/4.84
	Water flow rate	m ³ /h	0.96/0.77/0.54	1.09/0.90/0.63	1.27/1.05/0.79	1.43/1.14/0.83
	Water pressure drop	kPa	50.7/33.38/17.73	32.8/21.75/11.43	44.1/33.7/19.41	71.4/46.17/25.39
Heating	Capacity (H/M/L)	kW	6.00/4.77/3.36	7.05/5.61/3.83	8.05/6.46/4.71	8.70/6.81/4.85
	Water flow rate	m ³ /h	1.04/0.83/0.59	1.22/0.98/0.67	1.39/1.12/0.82	1.51/1.18/0.83
	Water pressure drop	kPa	55.5/37.66/19.27	37.6/25.47/12.5	46.9/31.9/18.16	62.6/41.06/21.68
Power input (H/M/L)		W	96/44/17	92/46/19	113/53/22	102/49/22
Rated current		A	0.85	0.79	0.95	0.87
Sound pressure level	(H/M/L)	dB(A)	50/42/31	50/43/31	51/44/33	50/43/33
Sound power level	(H/M/L)	dB(A)	64/56/45	62/56/46	63/58/49	63/57/47
Fan motor	Type	Low noise DC fan motor				
	Quantity	1	1	1	1	
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity	3	3	3	3	
Coil	Row	3	4	3	4	
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	495×200×1360	495×200×1360	591×200×1360	591×200×1360
	Packing size (H×D×W)	mm	595×300×1465	595×300×1465	695×300×1465	695×300×1465
	Net weight	kg	28.5	29.5	32.5	34.5
	Gross weight	kg	36.0	37.0	41.0	42.5
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.

Model		MDKH3-V150-R3	MDKH3-V150-R4	MDKH3-V250-R3	MDKH3-V250-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	255/170/150	255/210/150	400/315/190	425/300/190
		CFM	150/100/88	150/124/88	235/185/112	250/176/112
External static pressure		Pa	12			
Cooling	Sensible Capacity(H/M/L)	kW	1.14/0.77/0.66	1.42/1.19/0.85	1.79/1.44/0.86	2.06/1.51/0.96
	Capacity (H/M/L)	kW	1.50/1.06/0.92	1.95/1.66/1.21	2.35/1.94/1.19	2.85/2.13/1.41
	Water flow rate	m ³ /h	0.26/0.18/0.16	0.33/0.28/0.21	0.40/0.34/0.21	0.49/0.37/0.24
	Water pressure drop	kPa	13.9/8.21/6.16	27.2/20.88/12.2	13.3/9.98/4.59	26/15.06/7.41
Heating	Capacity (H/M/L)	kW	1.57/1.07/0.92	2.05/1.75/1.25	2.60/2.11/1.34	2.95/2.15/1.42
	Water flow rate	m ³ /h	0.27/0.19/0.16	0.35/0.30/0.22	0.45/0.37/0.23	0.51/0.37/0.24
	Water pressure drop	kPa	15.1/7.63/5.84	25.3/19.65/10.25	14.3/10.33/4.5	24.4/13.65/6.64
Power input (H/M/L)		W	15/9/8	20/14/9	17/12/7	20/11/8
Rated current		A	0.18	0.21	0.20	0.22
Sound pressure level	(H/M/L)	dB(A)	34/24/21	39/33/25	29/24/18	32/23/19
Sound power level	(H/M/L)	dB(A)	47/36/34	52/46/38	43/37/29	46/37/29
Fan motor	Type	Low noise DC fan motor				
	Quantity	1	1	1	1	
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity	1	1	2	2	
Coil	Row	3	4	3	4	
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	455×200×637	455×200×637	455×200×867	455×200×867
	Packing size (H×D×W)	mm	555×255×755	555×255×755	555×255×985	555×255×985
	Net weight	kg	11.8	12.1	13.9	14.8
	Gross weight	kg	16.1	16.4	19.4	20.3
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.
6. Test with conceal tooling.

Model		MDKH3-V350-R3	MDKH3-V350-R4	MDKH3-V500-R3	MDKH3-V500-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	595/470/340	595/450/310	790/580/410	800/600/420
		CFM	350/276/200	350/265/182	488/359/253	471/353/247
External static pressure		Pa	12			
Cooling	Sensible Capacity(H/M/L)	kW	2.65/2.14/1.57	2.90/2.35/1.72	3.25/2.56/1.91	3.63/2.85/2.08
	Capacity (H/M/L)	kW	3.50/2.89/2.22	3.90/3.20/2.43	4.30/3.48/2.71	4.85/3.92/2.93
	Water flow rate	m ³ /h	0.60/0.50/0.38	0.67/0.55/0.42	0.74/0.60/0.47	0.83/0.67/0.51
	Water pressure drop	kPa	34.1/24.63/15.39	37.4/25.91/15.37	54.2/36.22/22.78	54.3/36.81/21.77
Heating	Capacity (H/M/L)	kW	3.80/3.10/2.35	4.00/3.22/2.50	4.70/3.70/2.81	5.25/4.09/3.04
	Water flow rate	m ³ /h	0.65/0.53/0.40	0.70/0.56/0.43	0.81/0.64/0.48	0.91/0.71/0.53
	Water pressure drop	kPa	35.1/24.41/14.82	36.5/25.34/14.22	54.3/36.87/22.32	53.4/36.54/20.47
Power input (H/M/L)		W	26/17/10	29/17/11	50/25/14	52/28/15
Rated current		A	0.26	0.28	0.49	0.51
Sound pressure level	(H/M/L)	dB(A)	38/32/23	40/34/30	46/38/30	45/39/30
Sound power level	(H/M/L)	dB(A)	52/44/36	52/45/36	59/51/43	59/51/43
Fan motor	Type	Low noise DC fan motor				
	Quantity	1	1	1	1	
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity	2	2	2	2	
Coil	Row		3	4	3	4
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	455×200×1087	455×200×1087	455×200×1087	455×200×1087
	Packing size (H×D×W)	mm	555×255×1205	555×255×1205	555×255×1205	555×255×1205
	Net weight	kg	17.3	18.2	17.3	18.2
	Gross weight	kg	24.0	24.9	24.0	24.9
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:

1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7°C, leaving water 12°C, Entering air temperature 27°C DB/19°C WB.
3. Heating conditions: Entering water 45°C, leaving water 40°C, Entering air temperature 20°C DB/15°C WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.
6. Test with conceal tooling.

Model		MDKH3-V700-R3	MDKH3-V700-R4	MDKH3-V800-R3	MDKH3-V800-R4	
Power supply		V/Ph/Hz	220-240/1/50			
Air flow (H/M/L)		m ³ /h	1190/855/505	1190/875/530	1360/1015/685	1300/980/680
		CFM	700/503/297	700/515/312	800/597/403	765/576/400
External static pressure		Pa	12			
Cooling	Sensible Capacity(H/M/L)	kW	4.62/3.60/2.43	4.98/3.98/2.68	5.87/4.74/3.45	6.12/4.82/3.42
	Capacity (H/M/L)	kW	5.60/4.47/3.14	6.35/5.19/3.62	7.35/6.12/4.57	8.25/6.65/4.84
	Water flow rate	m ³ /h	0.96/0.77/0.54	1.09/0.90/0.63	1.27/1.05/0.79	1.43/1.14/0.83
	Water pressure drop	kPa	50.7/33.38/17.73	32.8/21.75/11.43	44.1/33.7/19.41	71.4/46.17/25.39
Heating	Capacity (H/M/L)	kW	6.00/4.77/3.36	7.05/5.61/3.83	8.05/6.46/4.71	8.70/6.81/4.85
	Water flow rate	m ³ /h	1.04/0.83/0.59	1.22/0.98/0.67	1.39/1.12/0.82	1.51/1.18/0.83
	Water pressure drop	kPa	55.5/37.66/19.27	37.6/25.47/12.5	46.9/31.9/18.16	62.6/41.06/21.68
Power input (H/M/L)		W	96/44/17	92/46/19	113/53/22	102/49/22
Rated current		A	0.85	0.79	0.95	0.87
Sound pressure level	(H/M/L)	dB(A)	50/42/31	50/43/31	51/44/33	50/43/33
Sound power level	(H/M/L)	dB(A)	64/56/45	62/56/46	63/58/49	63/57/47
Fan motor	Type	Low noise DC fan motor				
	Quantity	1	1	1	1	
Fan	Type	Centrifugal, forward-curved Blades				
	Quantity	3	3	3	3	
Coil	Row	3	4	3	4	
	Max. working pressure	MPa	1.6	1.6	1.6	1.6
	Diameter	mm	Φ7.94	Φ7.94	Φ7.94	Φ7.94
Body	Net dimensions (H×D×W)	mm	455×200×1207	455×200×1207	550×200×1207	550×200×1207
	Packing size (H×D×W)	mm	555×255×1325	555×255×1325	650×255×1325	650×255×1325
	Net weight	kg	19.6	20.8	23.1	24.3
	Gross weight	kg	26.4	27.6	30.2	31.4
Water inlet/outlet pipe		inch	G3/4	G3/4	G3/4	G3/4
Drain pipe		mm	ODΦ18.5	ODΦ18.5	ODΦ18.5	ODΦ18.5

Notes:


1. H: High fan speed; M: Medium fan speed; L: Low fan speed.
2. Cooling conditions: Entering water 7℃, leaving water 12℃, Entering air temperature 27℃ DB/19℃ WB.
3. Heating conditions: Entering water 45℃, leaving water 40℃, Entering air temperature 20℃ DB/15℃ WB.
4. Sound power level is tested in a reverberation chamber.
5. Sound pressure level is tested in a semi-anechoic room.
6. Test with conceal tooling.

MDV DC Fan Coil Unit





8. Dimensions

Cased type

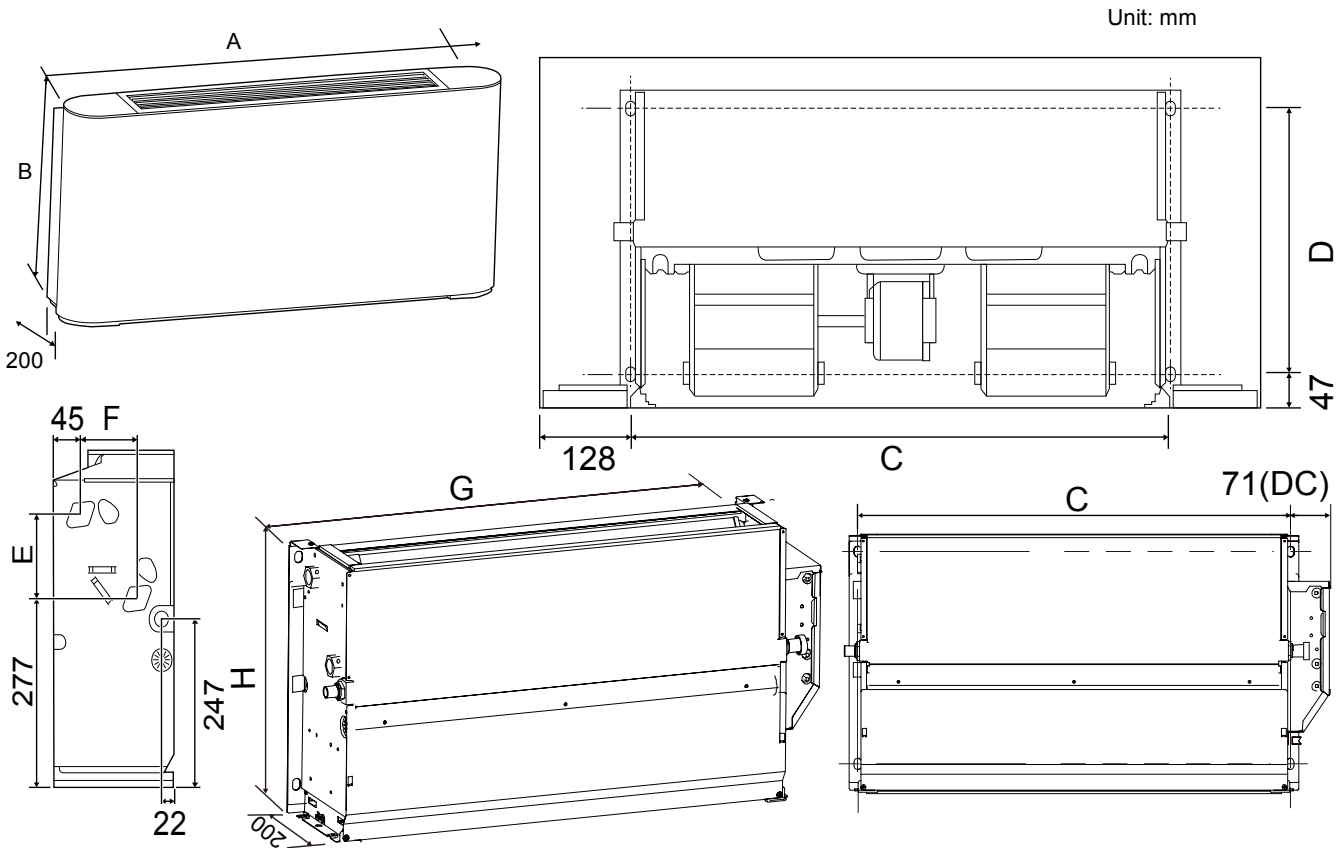

Dimensions (unit: mm)

MODEL	MDKH1/2-V150	MDKH1/2--V250	MDKH1/2--V350	MDKH1/2--V500	MDKH1/2--V700	MDKH1/2-V800
A	790	1020	1240	1240	1360	1360
B	495	495	495	495	495	591
C	534	764	984	984	1104	1104
D	375	375	375	375	375	391
E	123	123	123	123	123	219
F	93	93	93	93	93	102
G	628	858	1078	1078	1198	1198
H	455	455	455	455	455	551

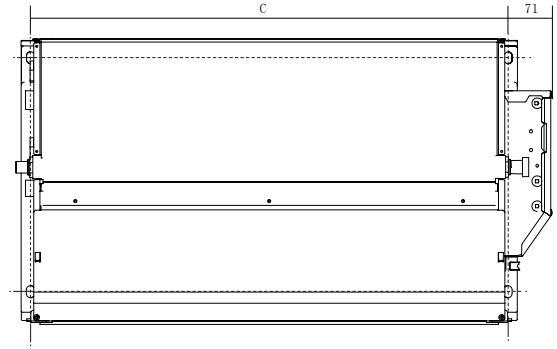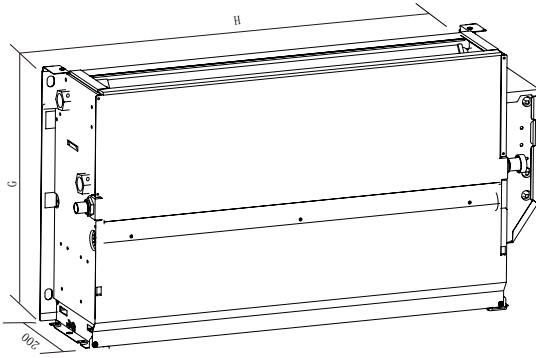


Dimensions (unit: mm)

MODEL	MDKH3-V150	MDKH3-V250	MDKH3-V350	MDKH3-V500	MDKH3-V700	MDKH3-V800
C	523	793	973	973	1093	1093
G	455	455	455	455	455	550
H	858	1088	1088	1308	1428	1428

9. Sound Levels


Sound Power Level:

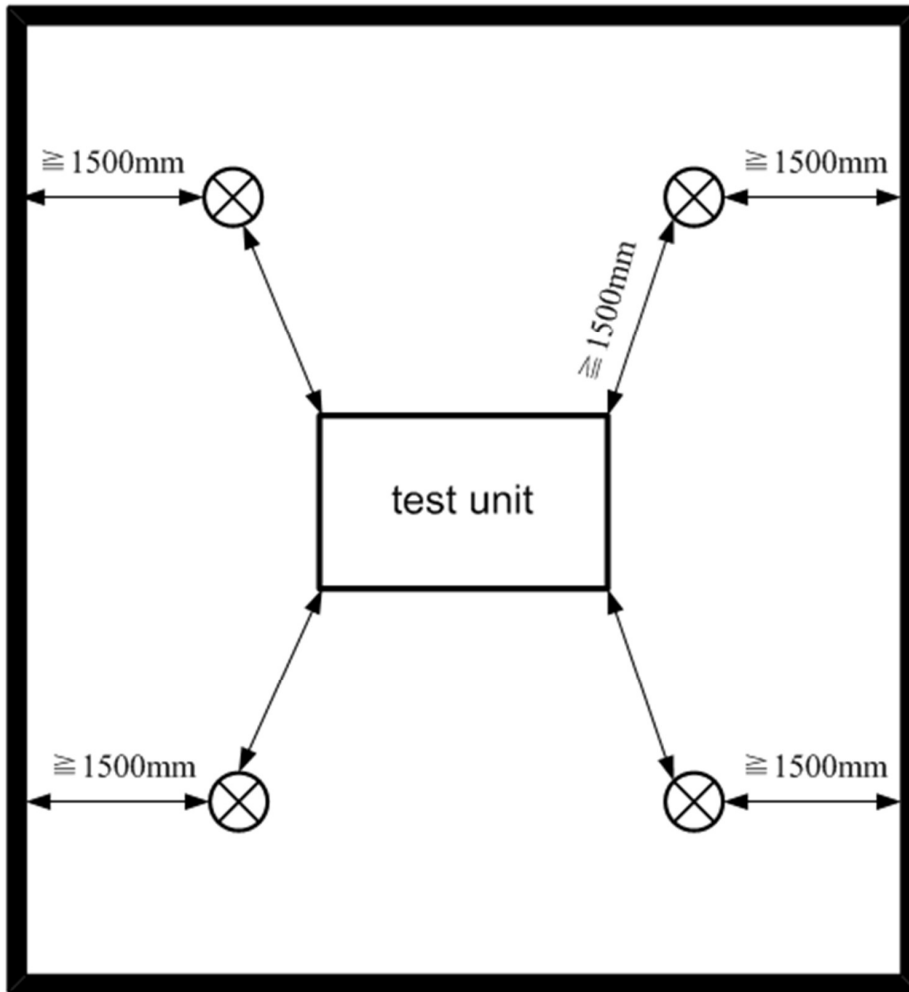

Model	150-R3	250-R3	350-R3	500-R3	700-R3	800-R3
H1 (H/M/L)	47/36/34	43/35/27	52/45/37	59/52/43	65/57/45	66/59/49
H2 (H/M/L)	47/36/34	43/37/29	52/44/36	59/51/36	64/56/45	63/58/49
H3 (H/M/L)	47/36/34	43/37/29	52/44/36	59/51/36	64/56/45	63/58/49

Model	150-R4	250-R4	350-R4	500-R4	700-R4	800-R4
H1 (H/M/L)	52/46/39	46/38/30	52/45/37	59/52/43	65/56/46	65/59/49
H2 (H/M/L)	52/46/38	43/37/29	52/45/36	59/51/43	62/56/46	63/57/47
H3 (H/M/L)	52/46/38	43/37/29	52/45/36	59/51/43	62/56/46	63/57/47

Sound Pressure Level:

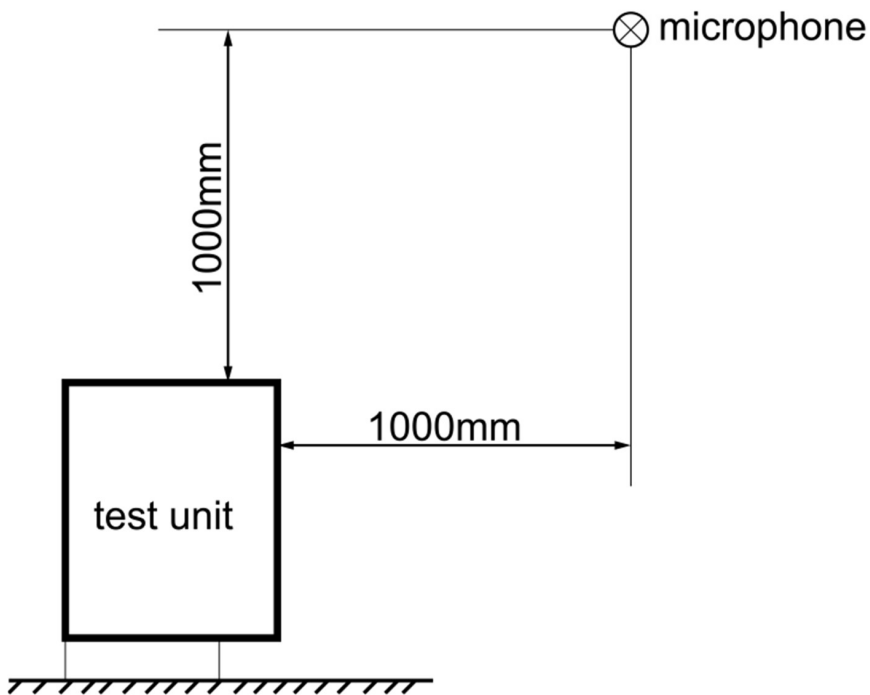

Model	150-R3	250-R3	350-R3	500-R3	700-R3	800-R3
H1 (H/M/L)	34/23/21	30/22/14	39/32/24	46/39/30	52/43/32	53/46/36
H2 (H/M/L)	34/24/21	29/24/18	38/32/23	46/38/30	50/42/31	51/44/33
H3 (H/M/L)	34/24/21	29/24/18	38/32/23	46/38/30	50/42/31	51/44/33


Model	150-R4	250-R4	350-R4	500-R4	700-R4	800-R4
H1 (H/M/L)	39/33/26	33/26/17	39/32/24	46/39/30	52/42/33	53/46/36
H2 (H/M/L)	39/33/25	32/23/19	40/34/30	45/39/30	50/43/31	50/43/33
H3 (H/M/L)	39/33/25	32/23/19	40/34/30	45/39/30	50/43/31	50/43/33

MDV DC Fan Coil Unit





NC Noise Curve:

MDKH1-V150R3

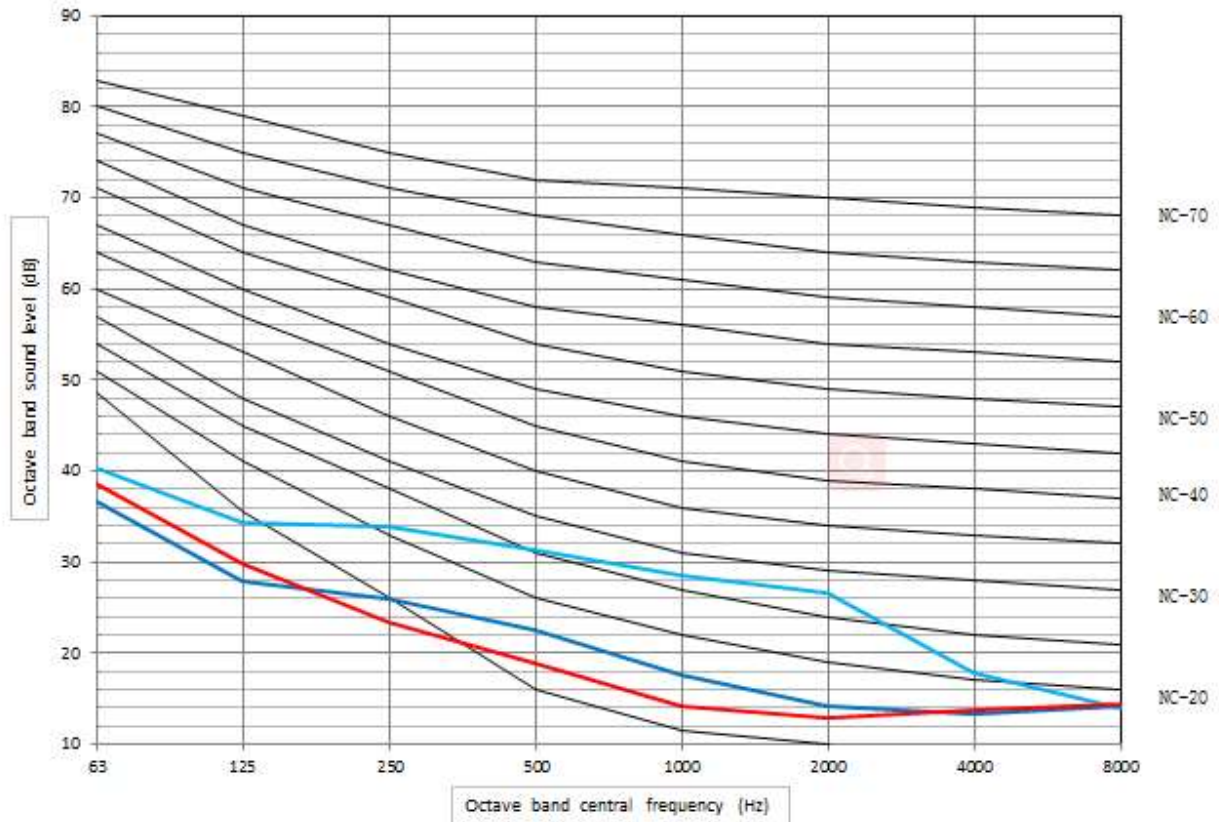


MDKH1-V250R3

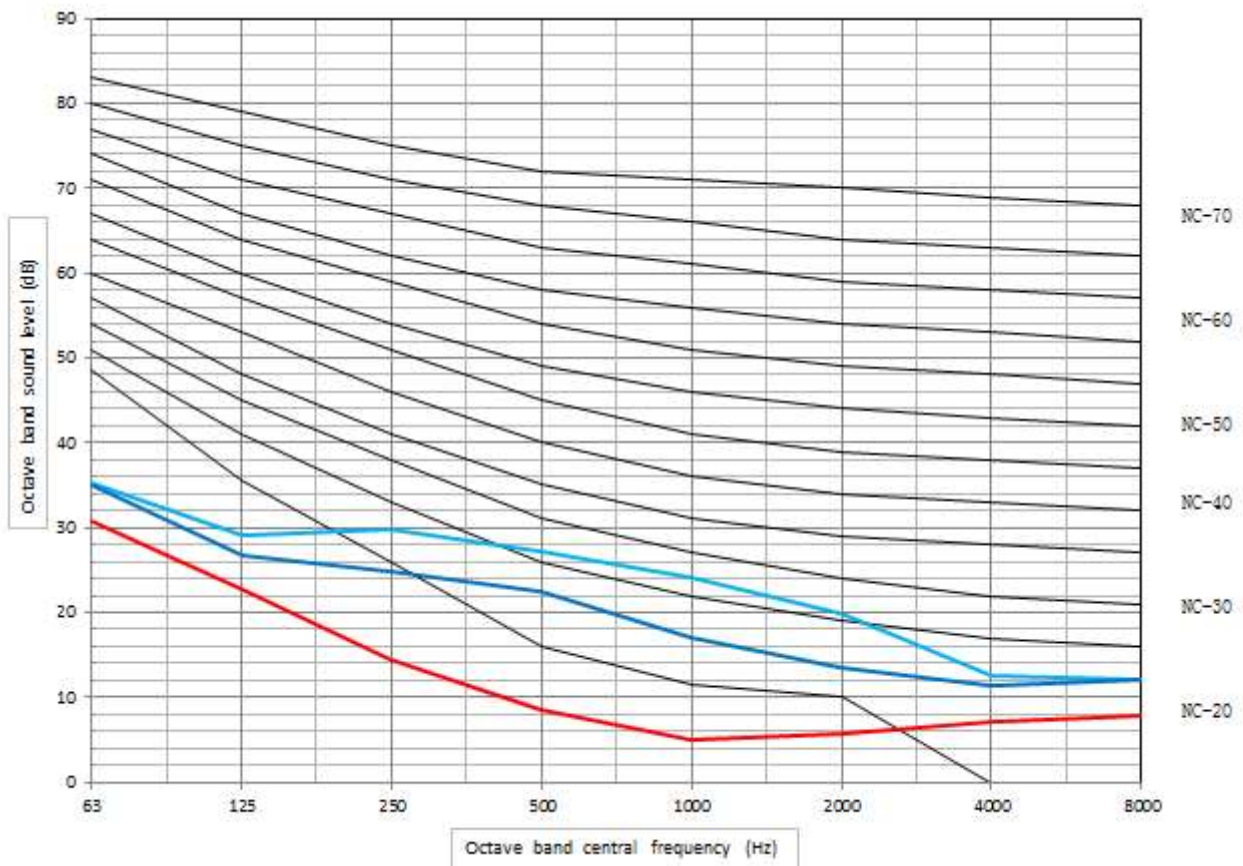


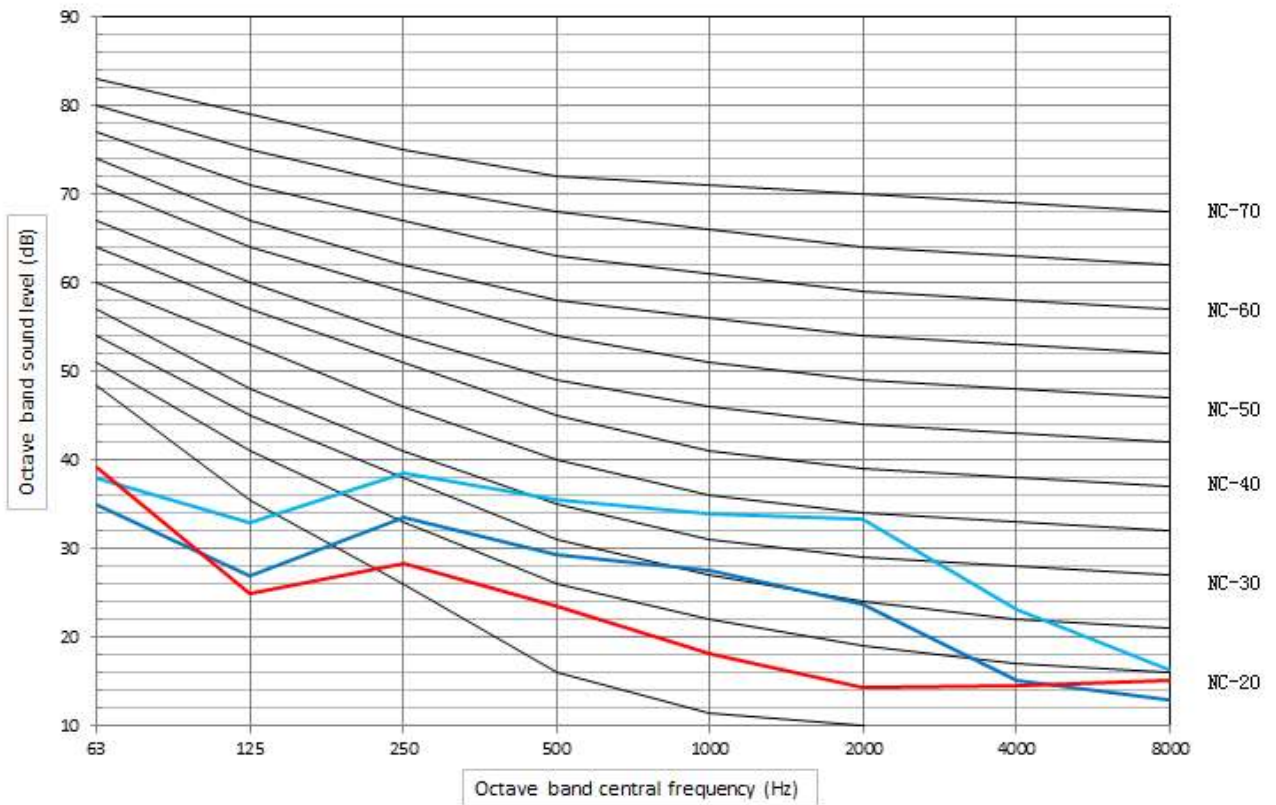


MDKH1-V500R3

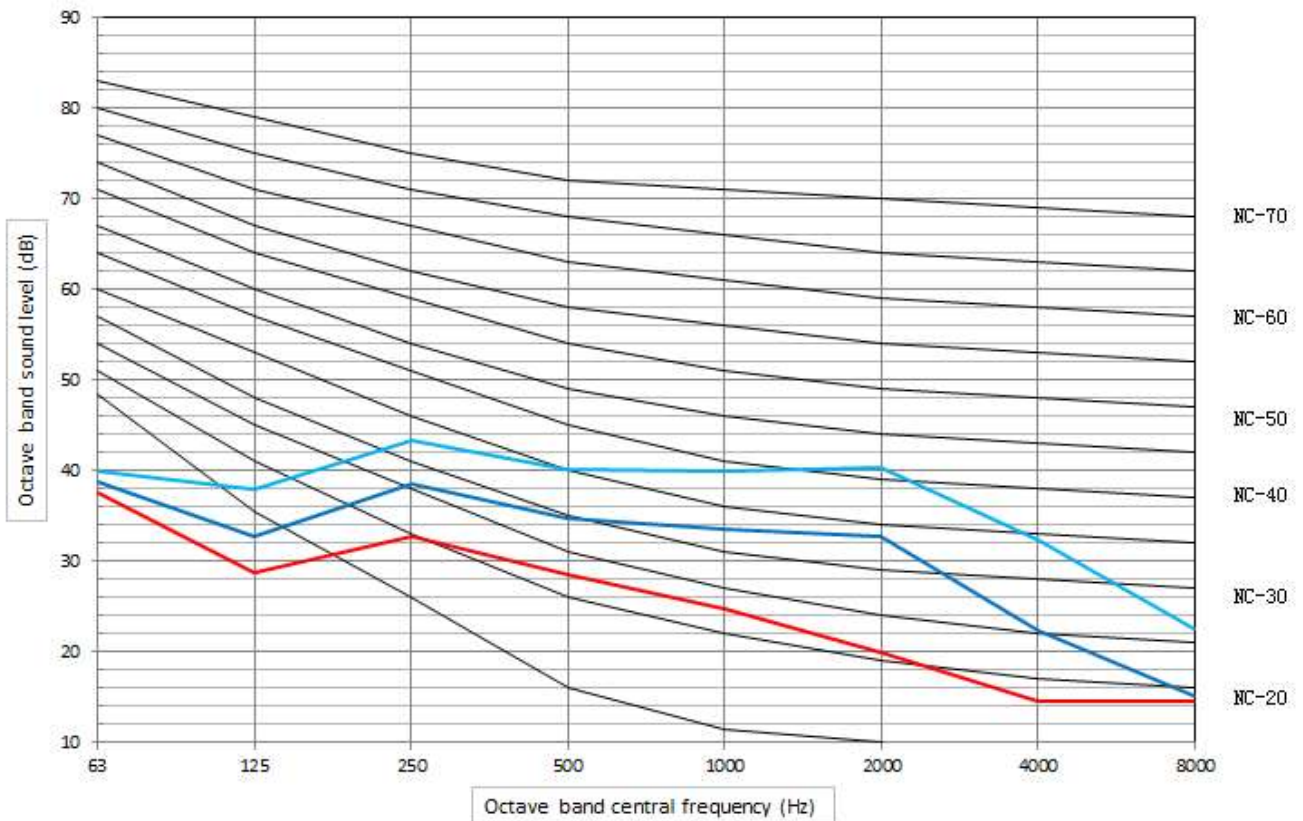


MDV DC Fan Coil Unit
MDKH1-V700R3

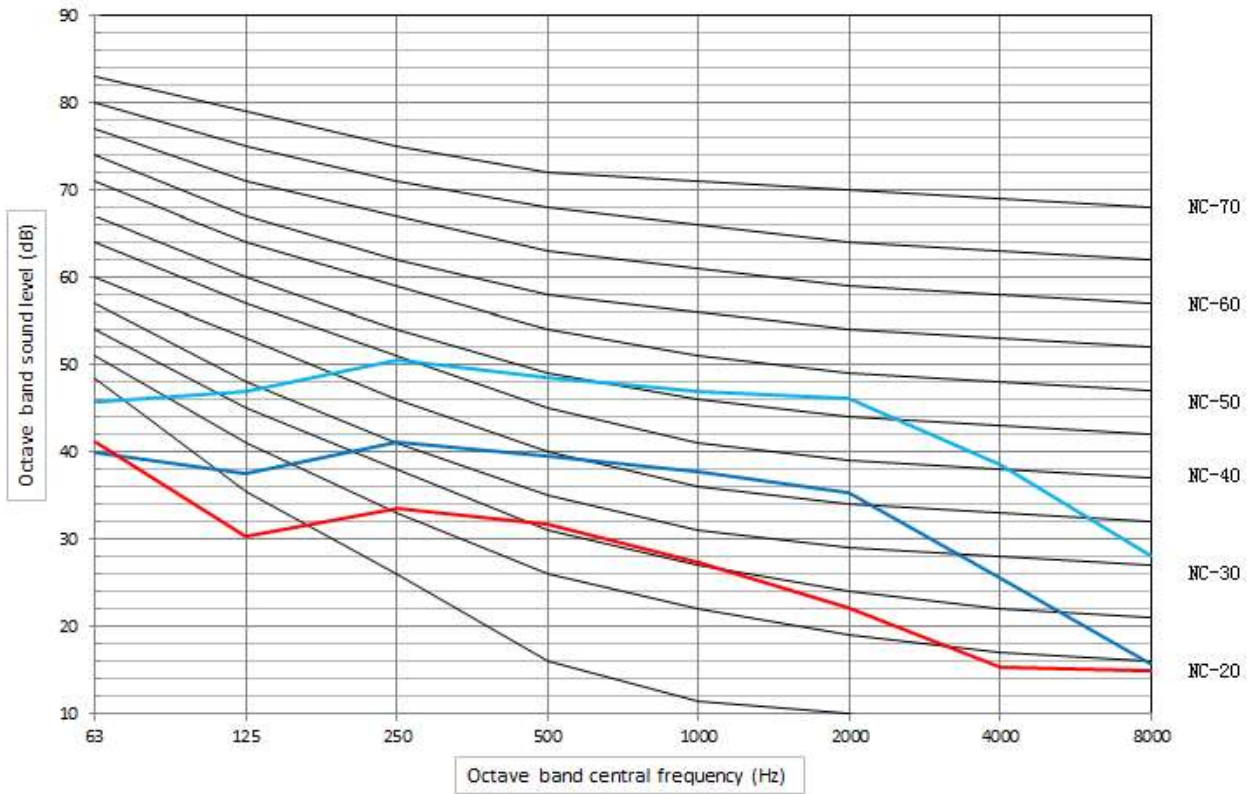


MDKH1-V800R3

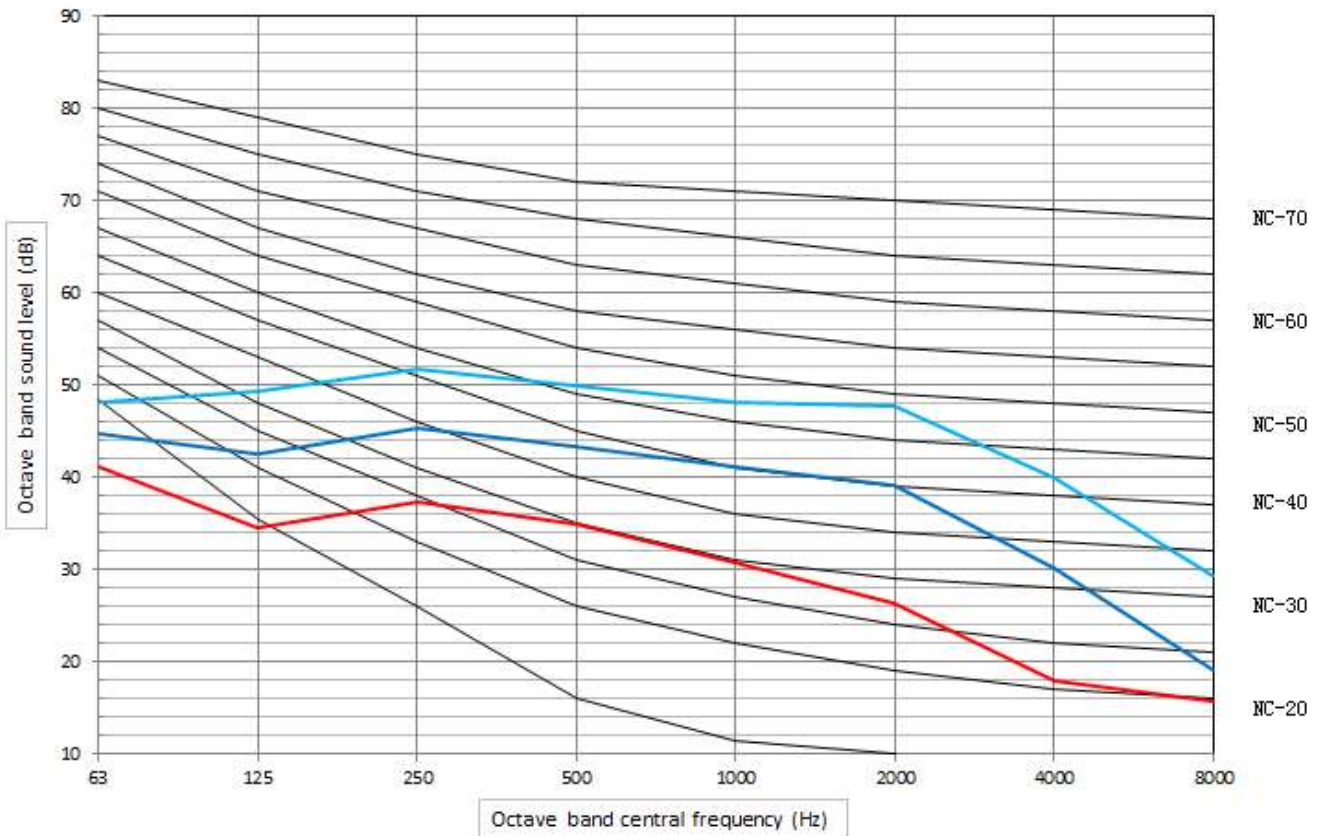

MDKH2-V150R3 / MDKH3-V150R3

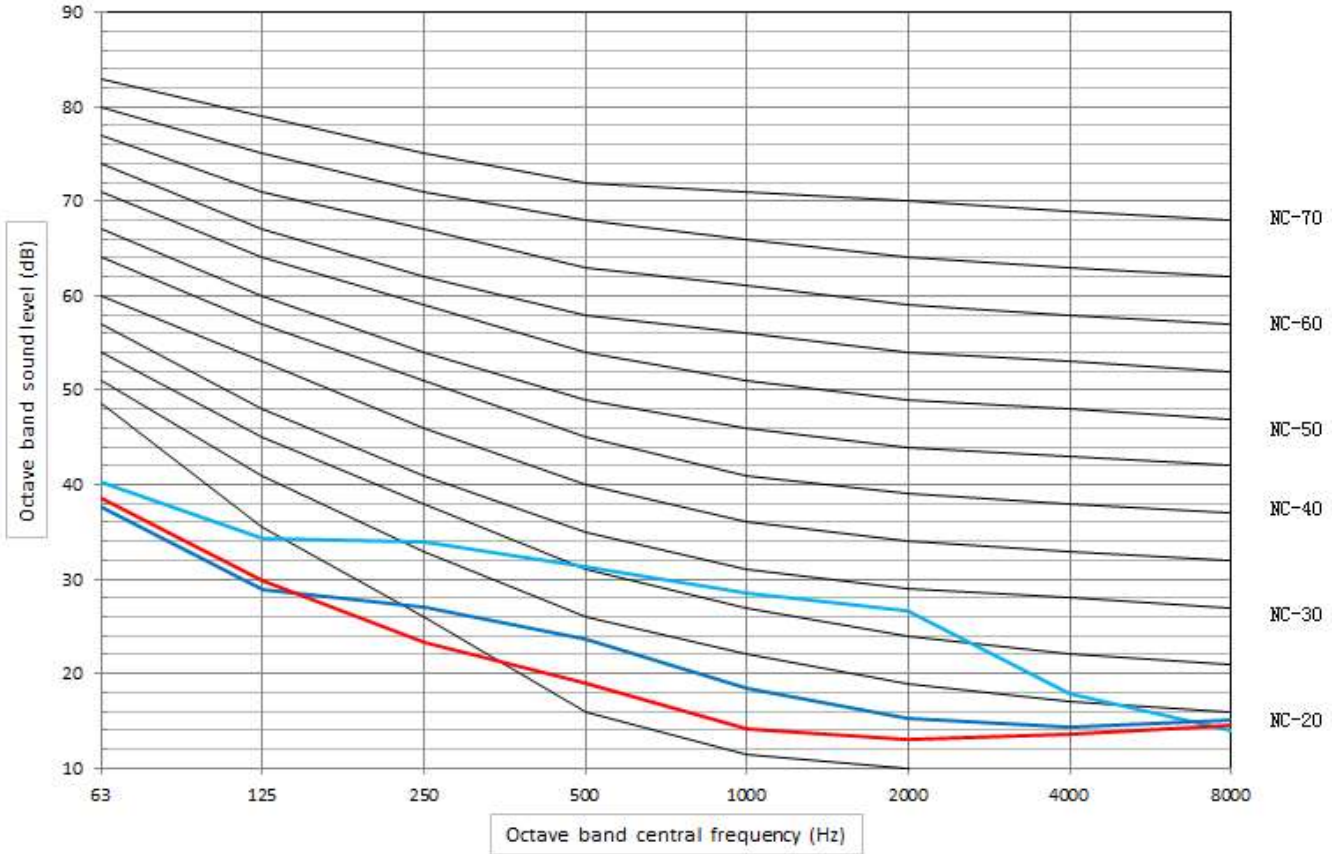


MDKH2-V250R3 / MDKH3-V250R3

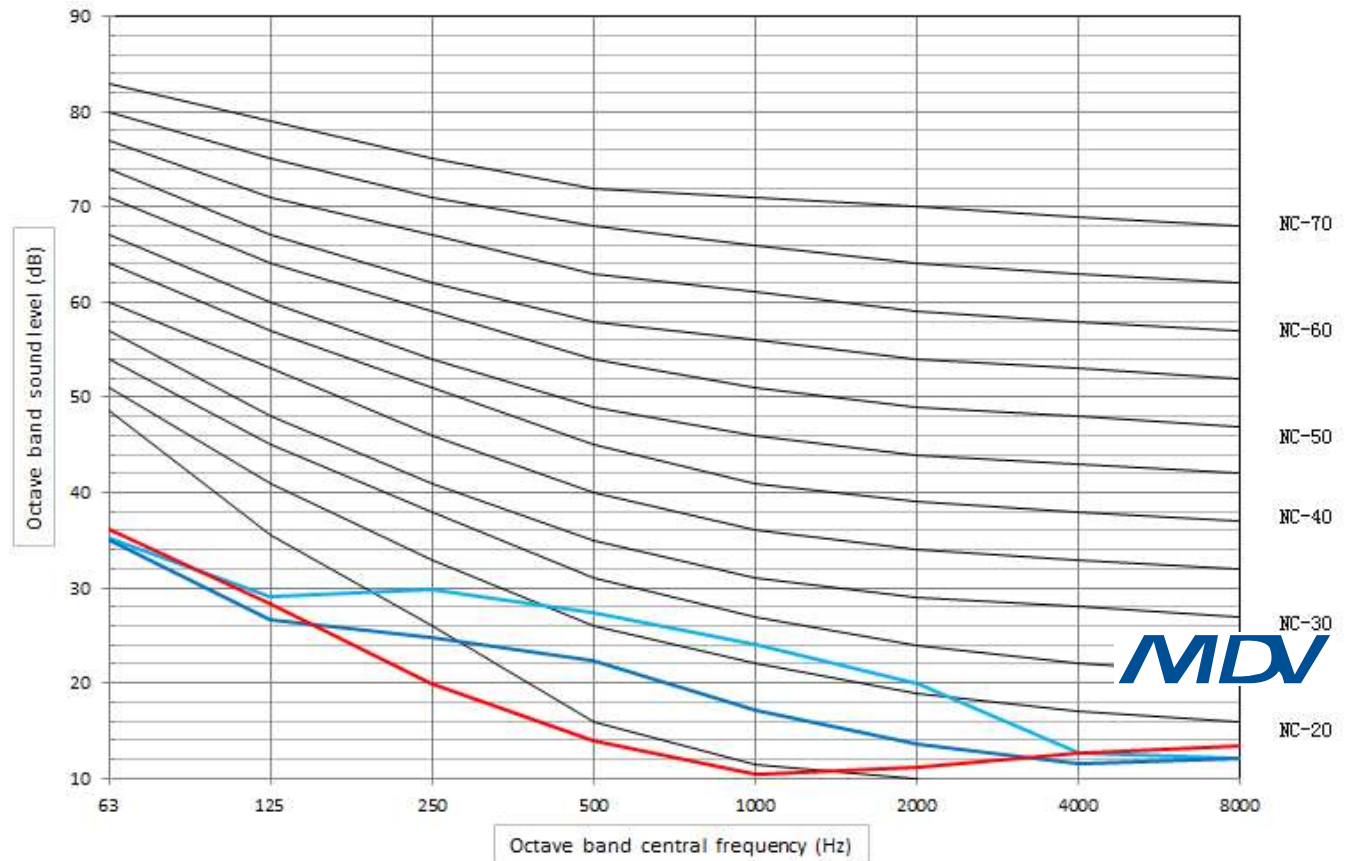


MDV DC Fan Coil Unit


MDKH2-V350R3 / MDKH3-V350R3

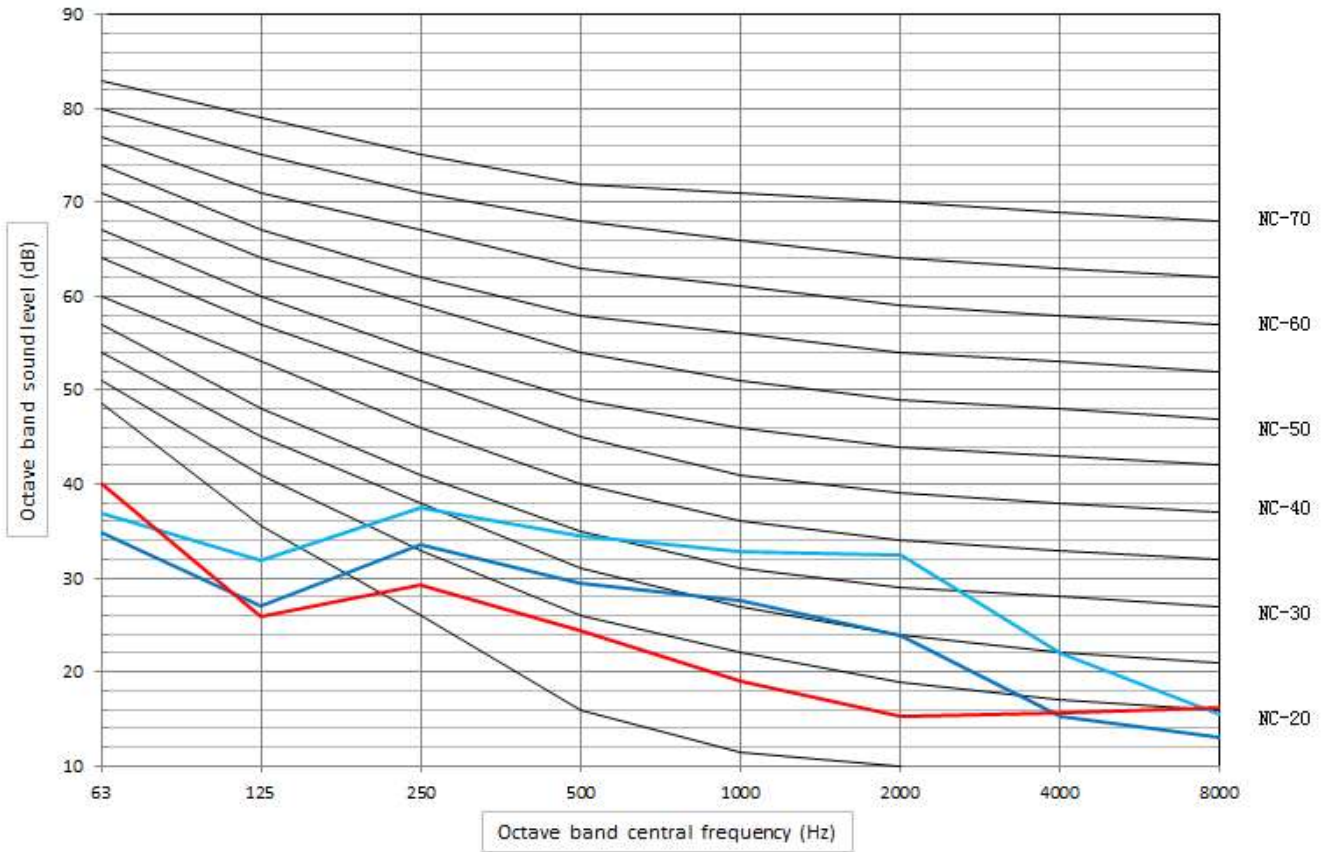


MDKH2-V500R3 / MDKH3-V500R3

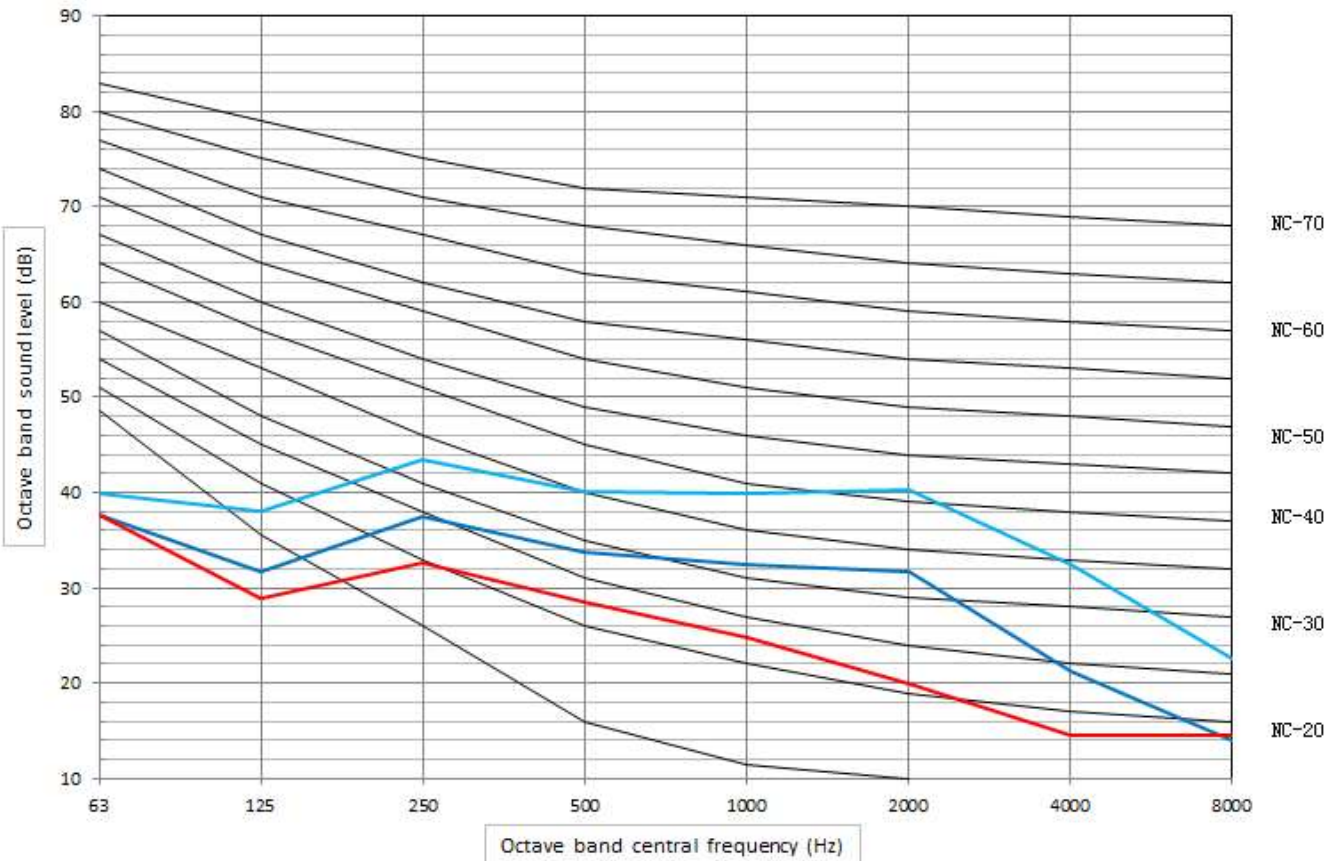


MDKH2-V700R3 / MDKH3-V700R3

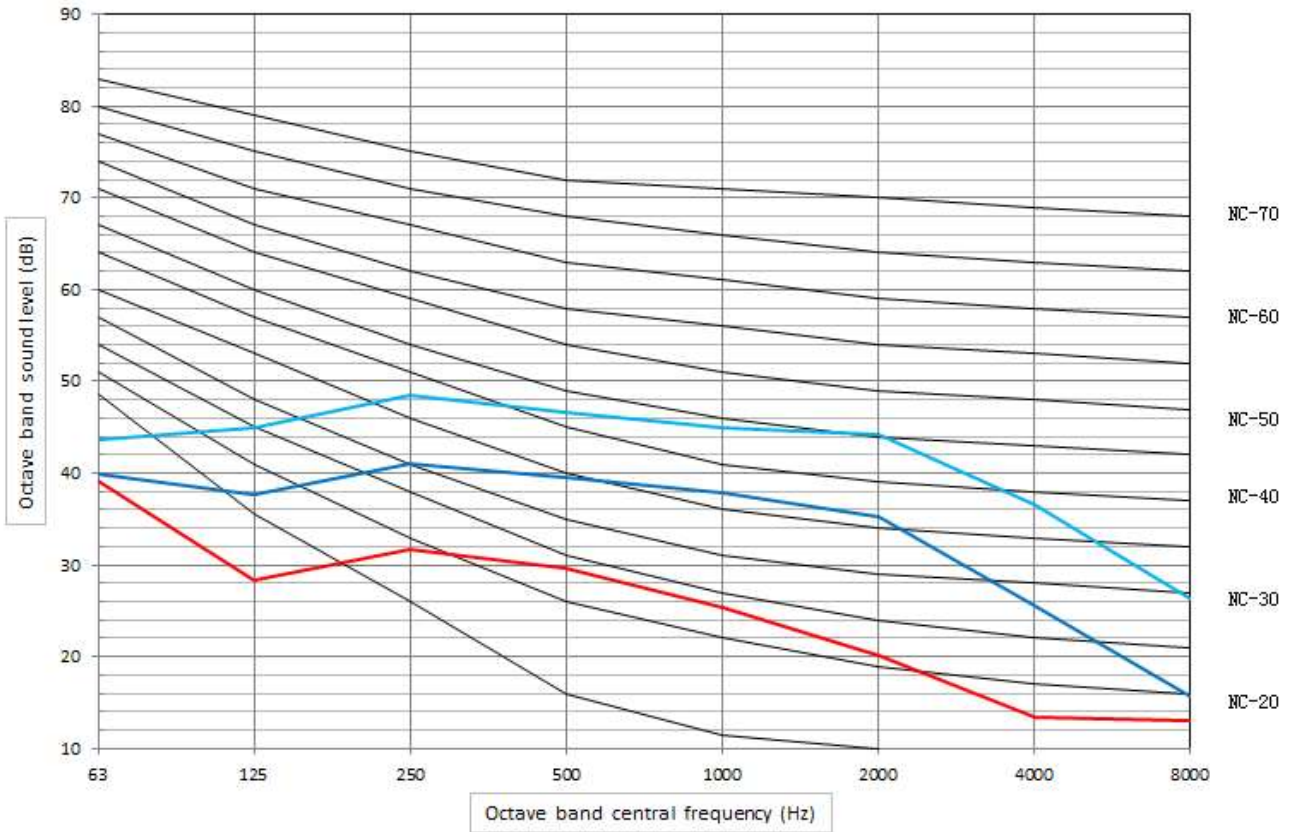


MDKH2-V800R3 / MDKH3-V800R3

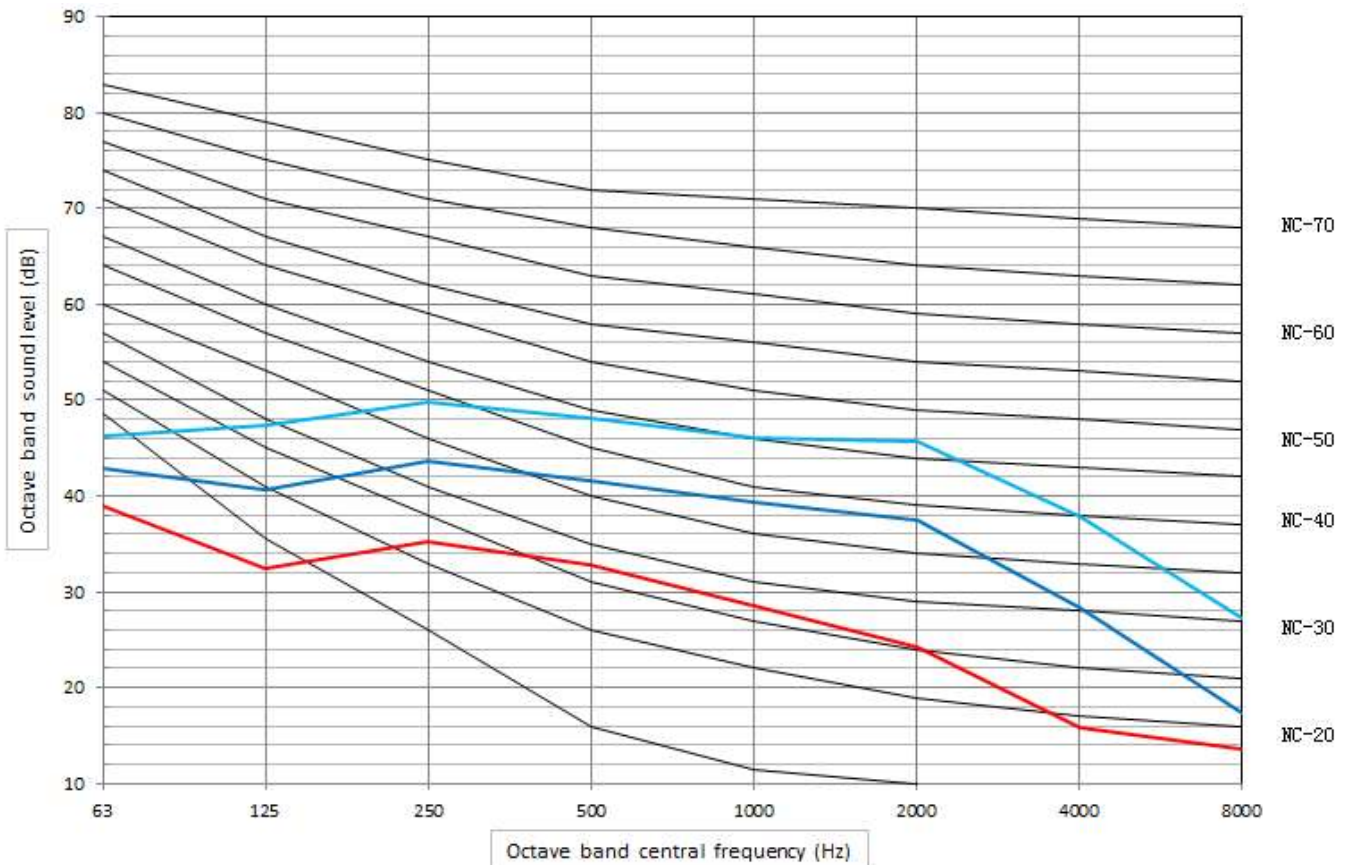


MDV DC Fan Coil Unit
MDKH1-V150R4

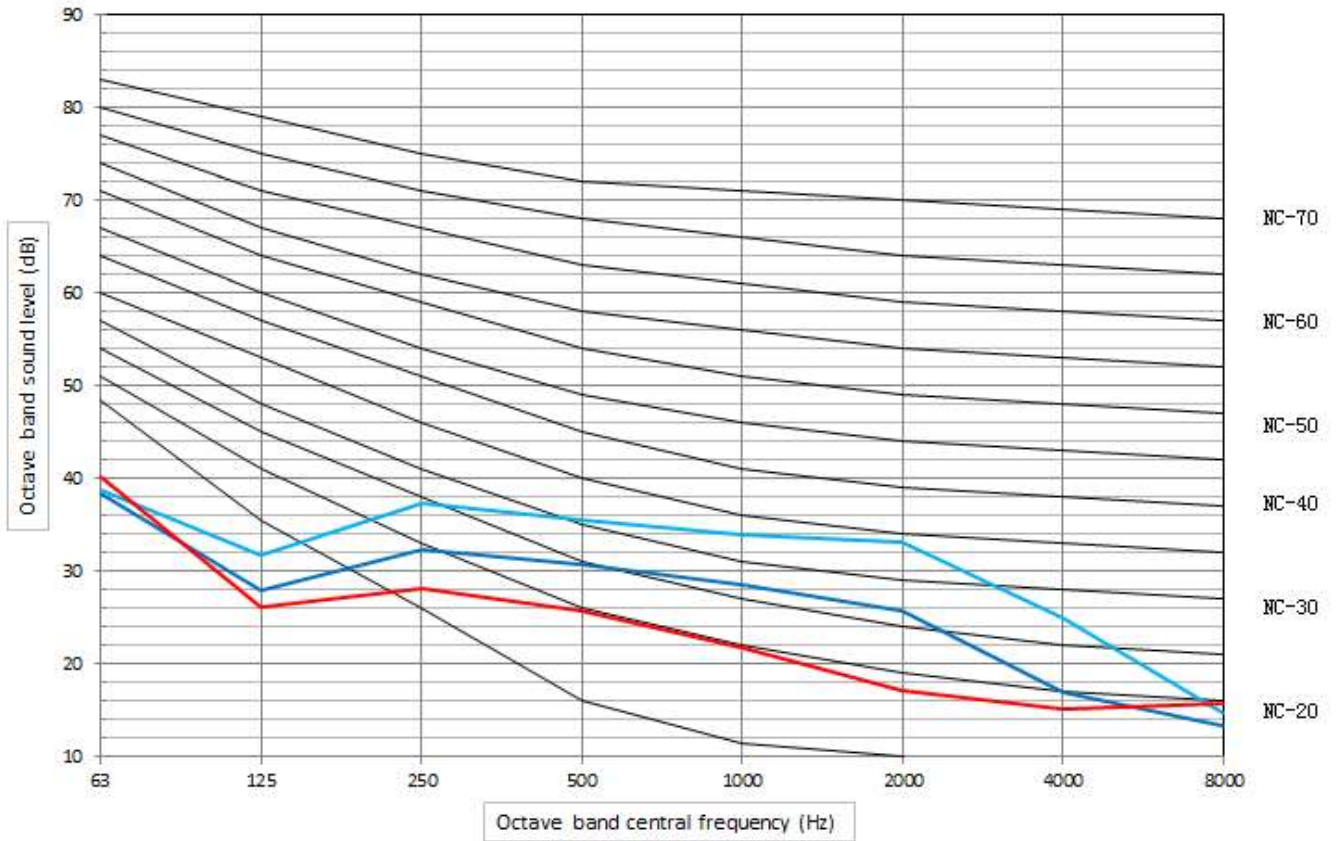


MDKH1-V250R4

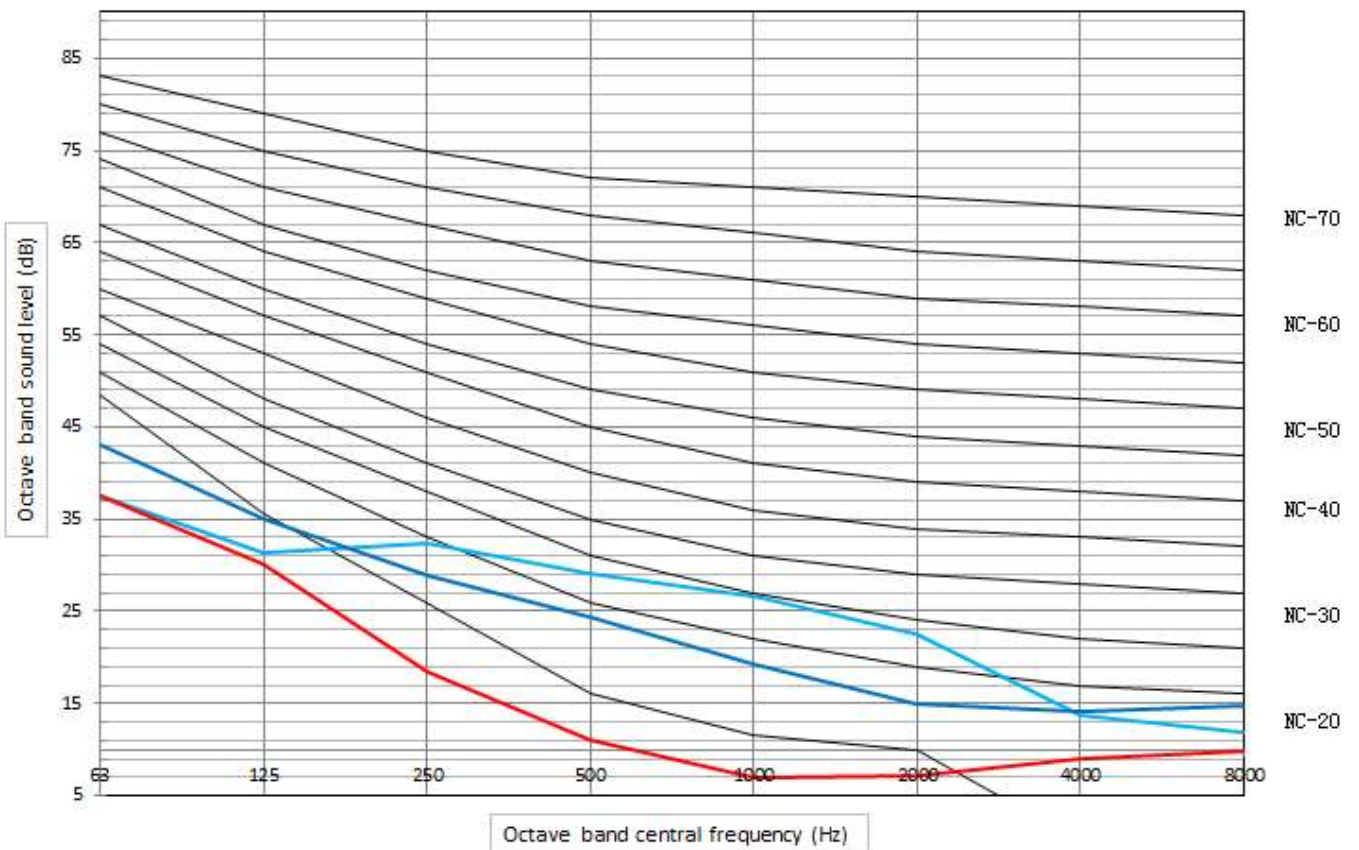

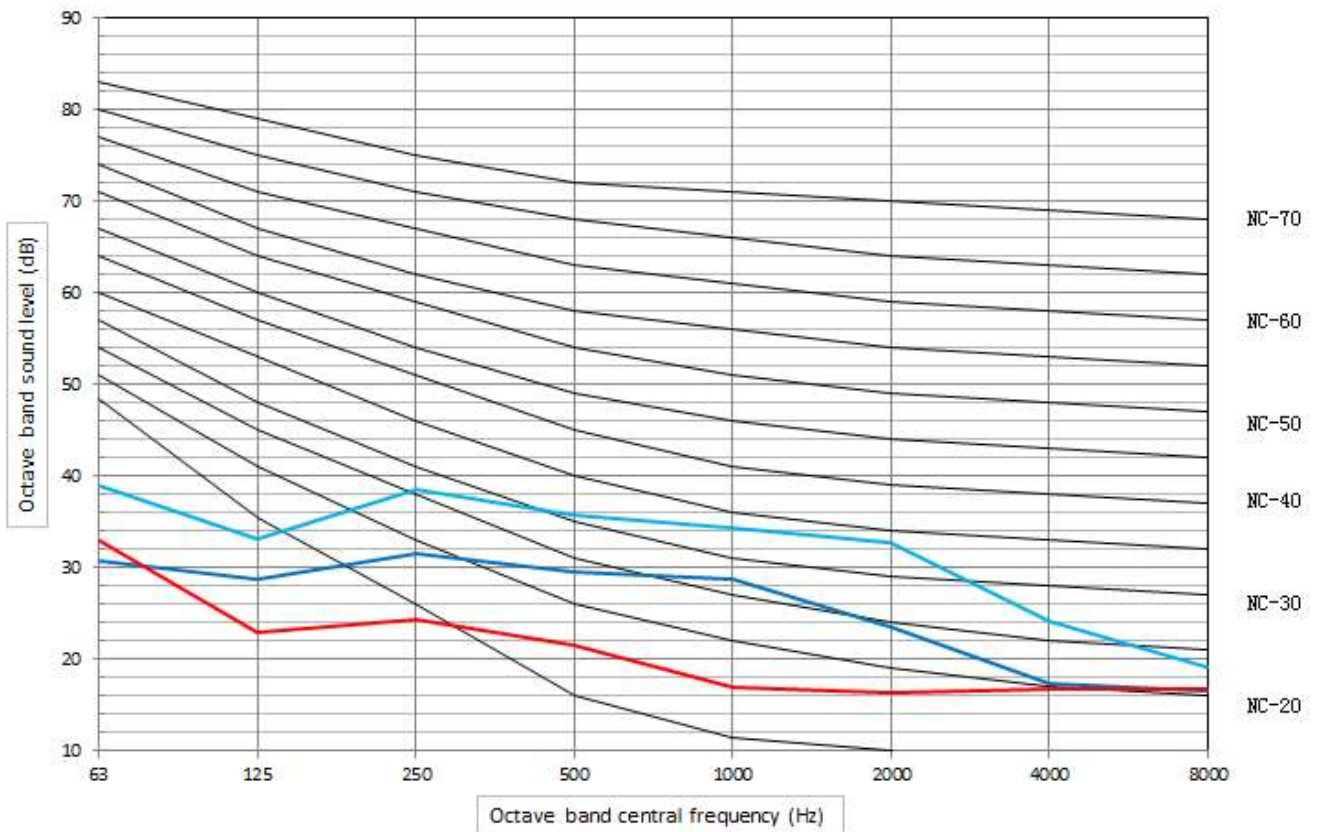


MDKH1-V500R4

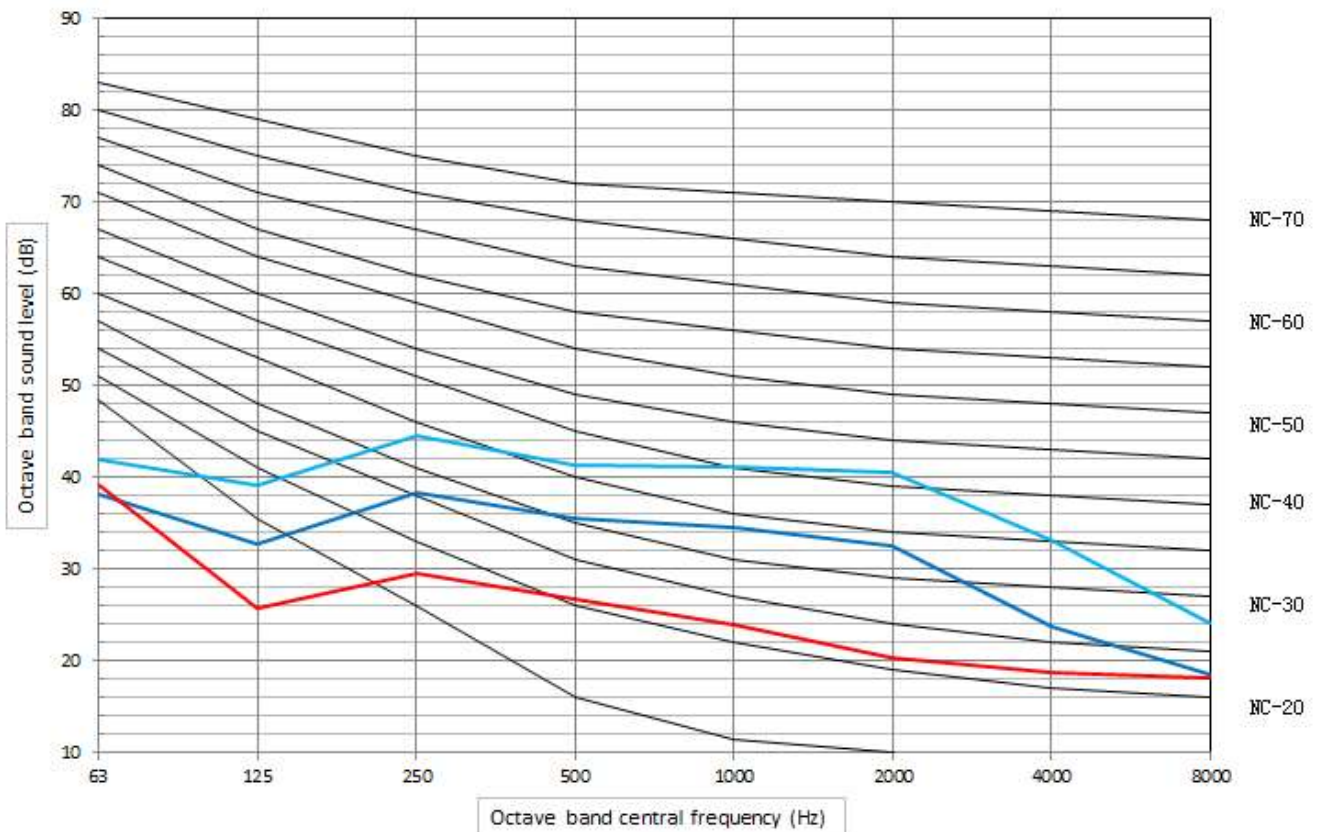


MDV DC Fan Coil Unit




MDKH1-V700R4

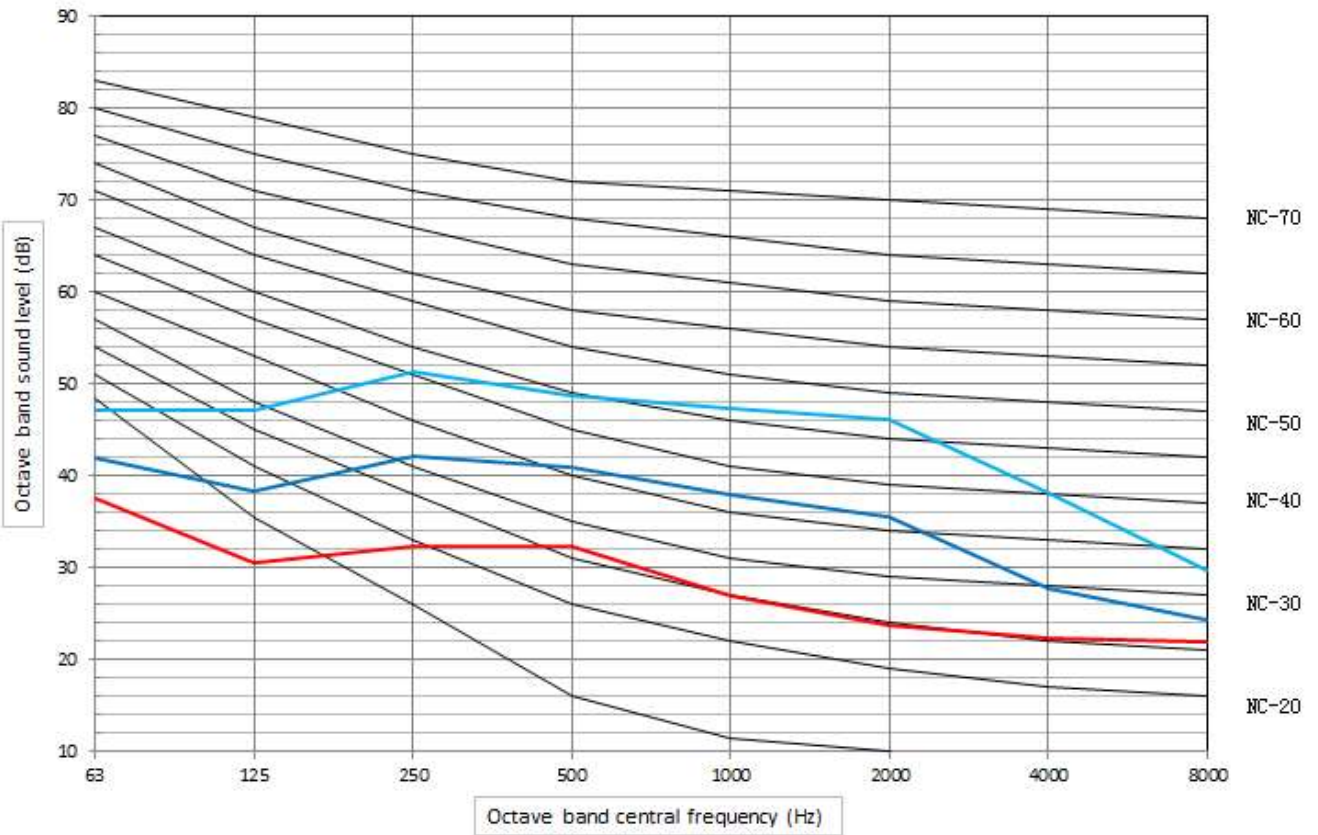


MDKH1-V800R4

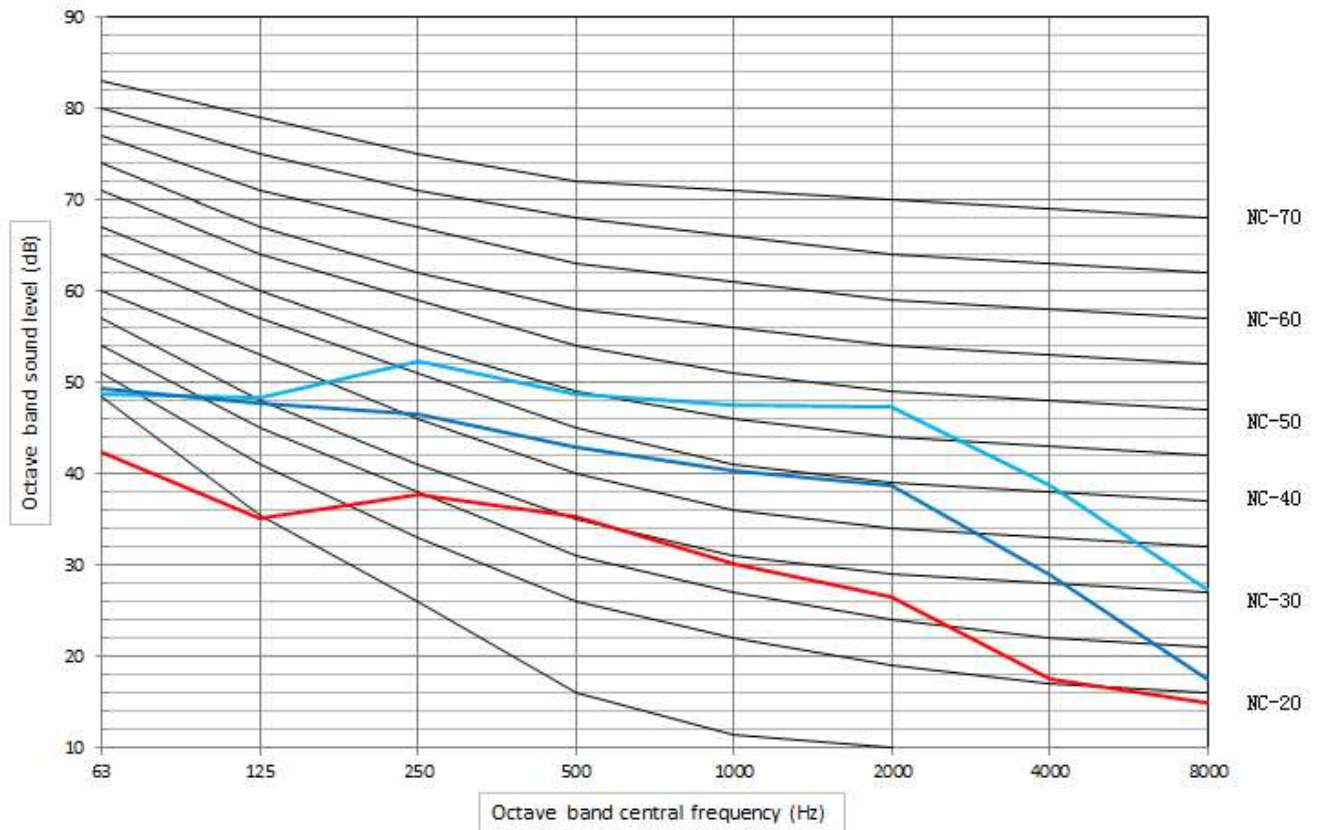


MDKH2-V150R4 / MDKH3-V150R4

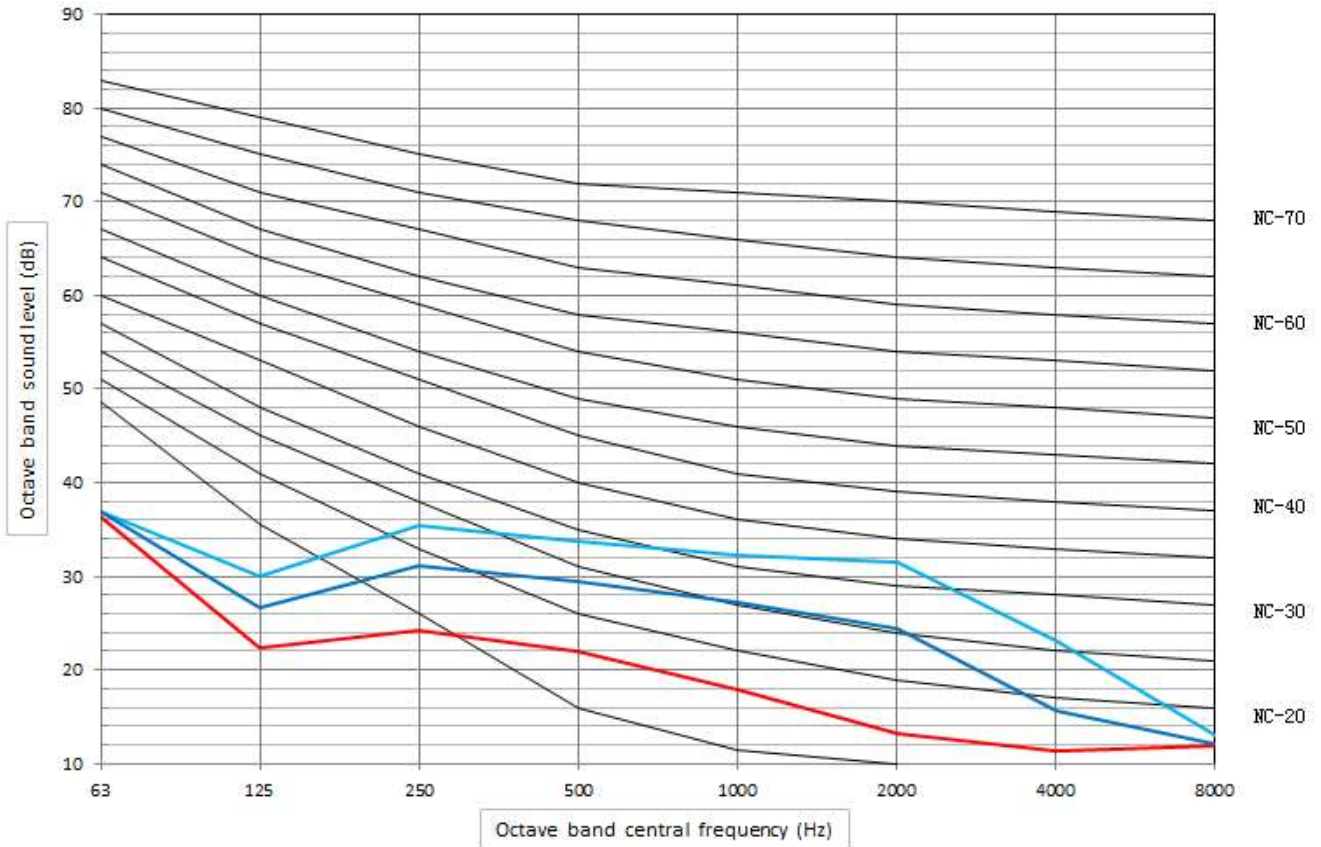


MDKH2-V250R4 / MDKH3-V250R4

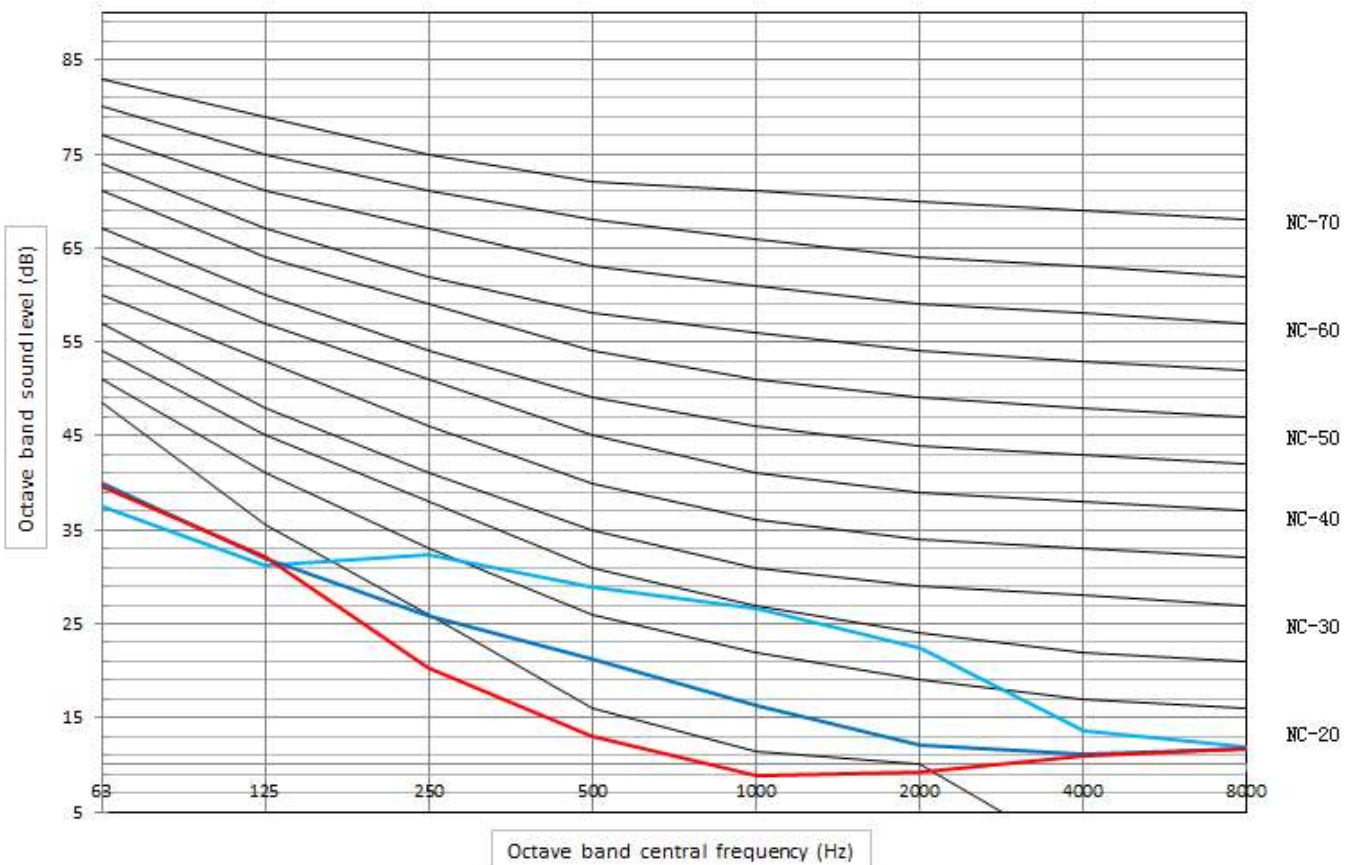

MDV DC Fan Coil Unit
MDKH2-V350R4 / MDKH3-V350R4

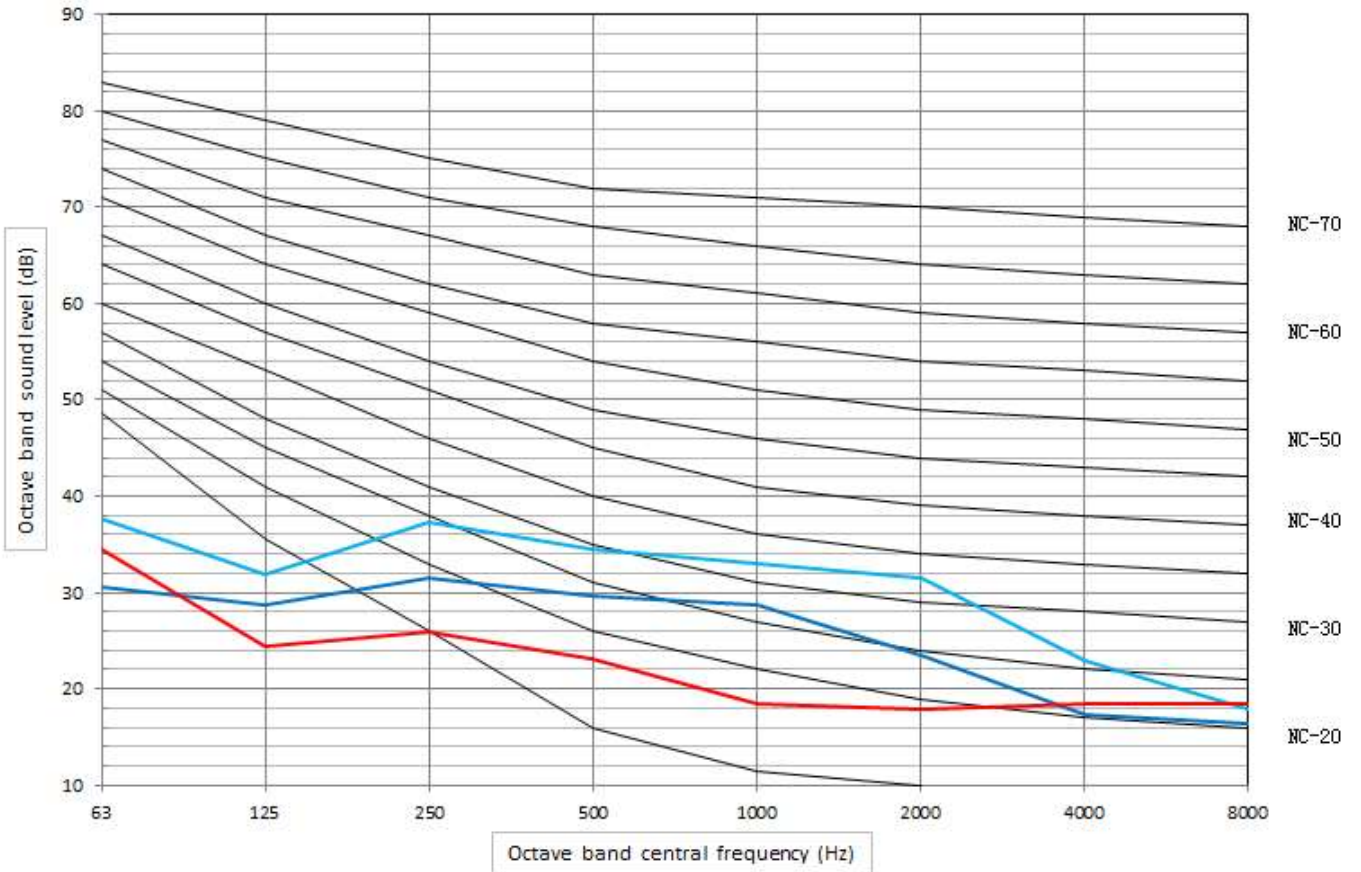


MDKH2-V500R4 / MDKH3-V500R4

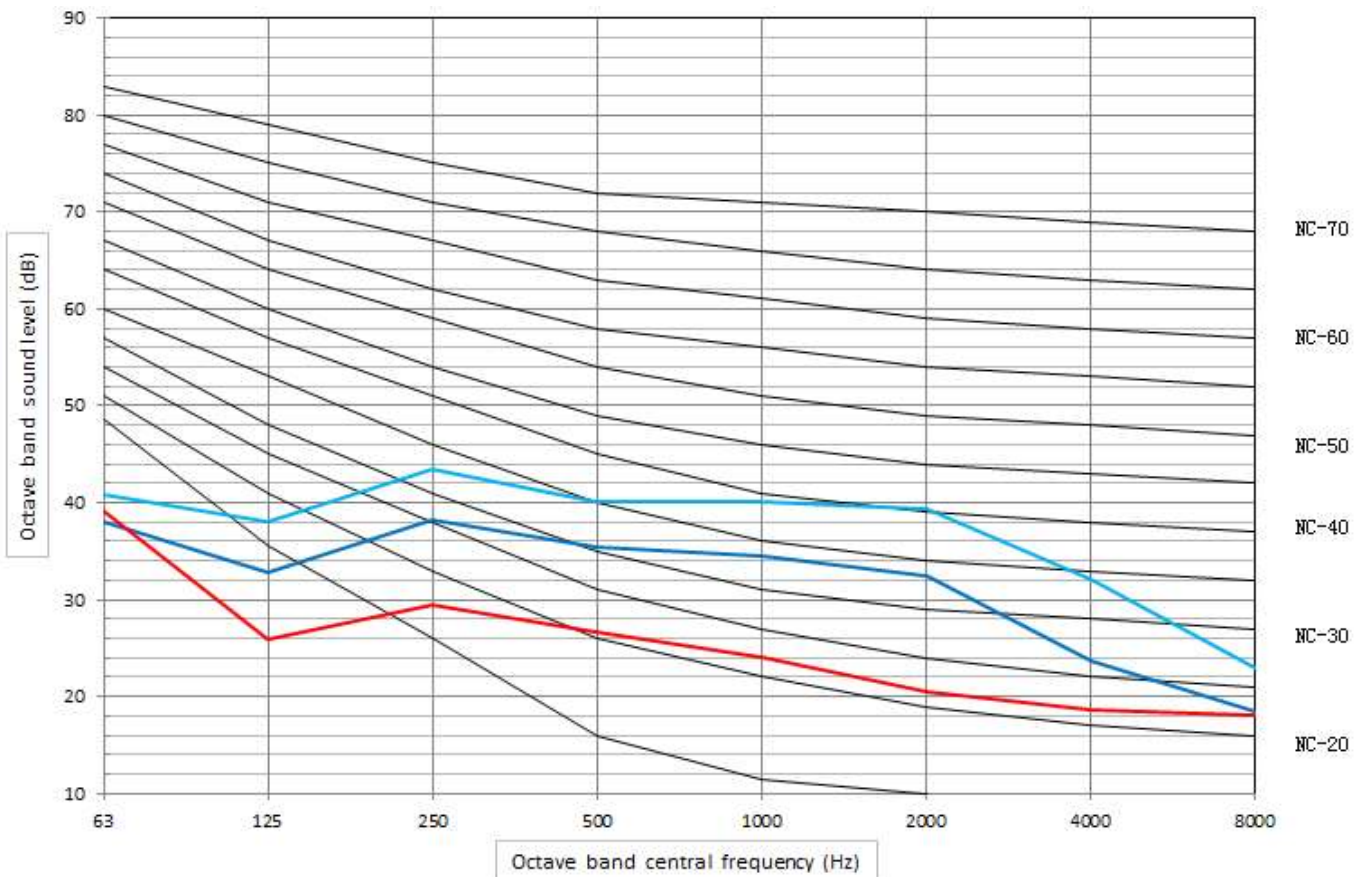




MDKH2-V700R4 / MDKH3-V700R4


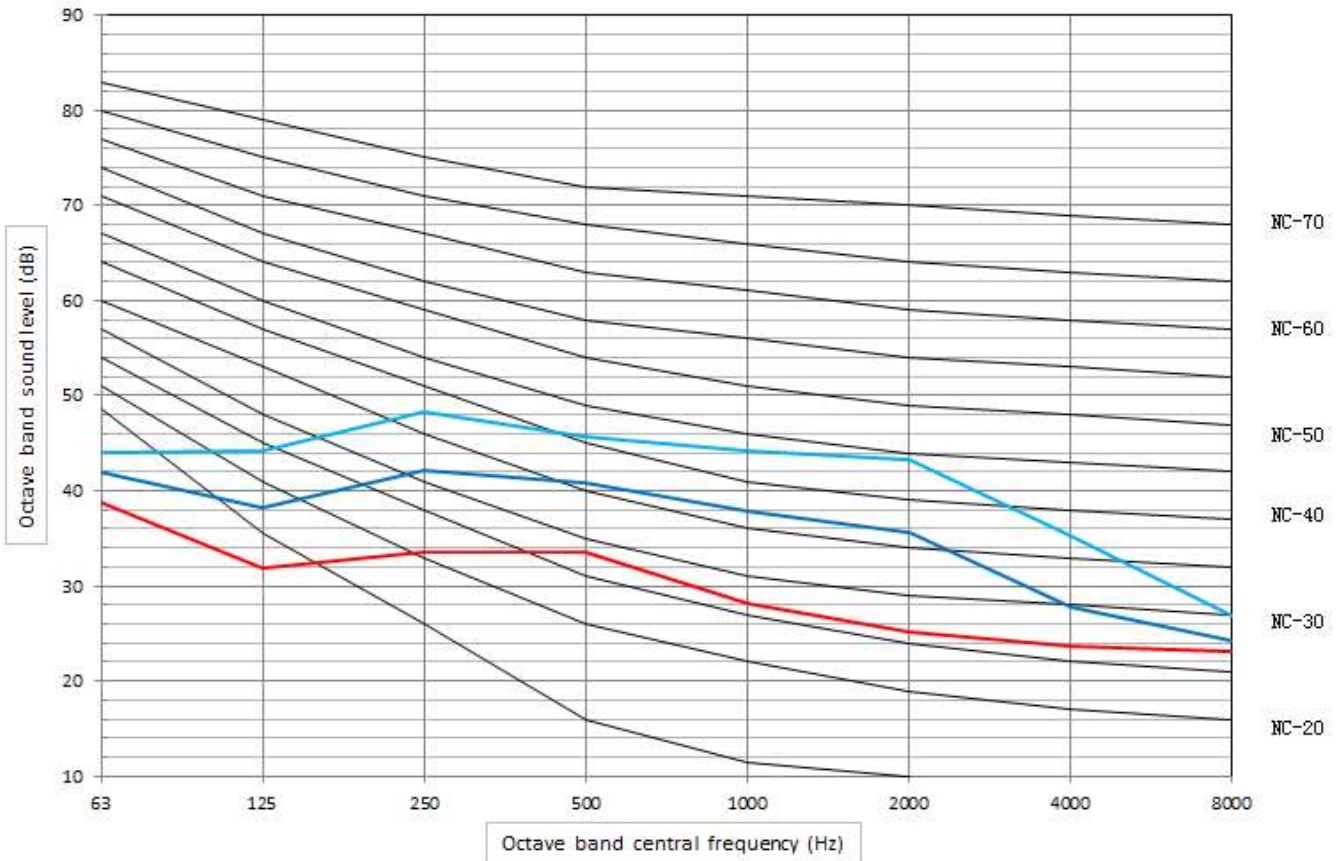


MDKH2-V800R4 / MDKH3-V800R4

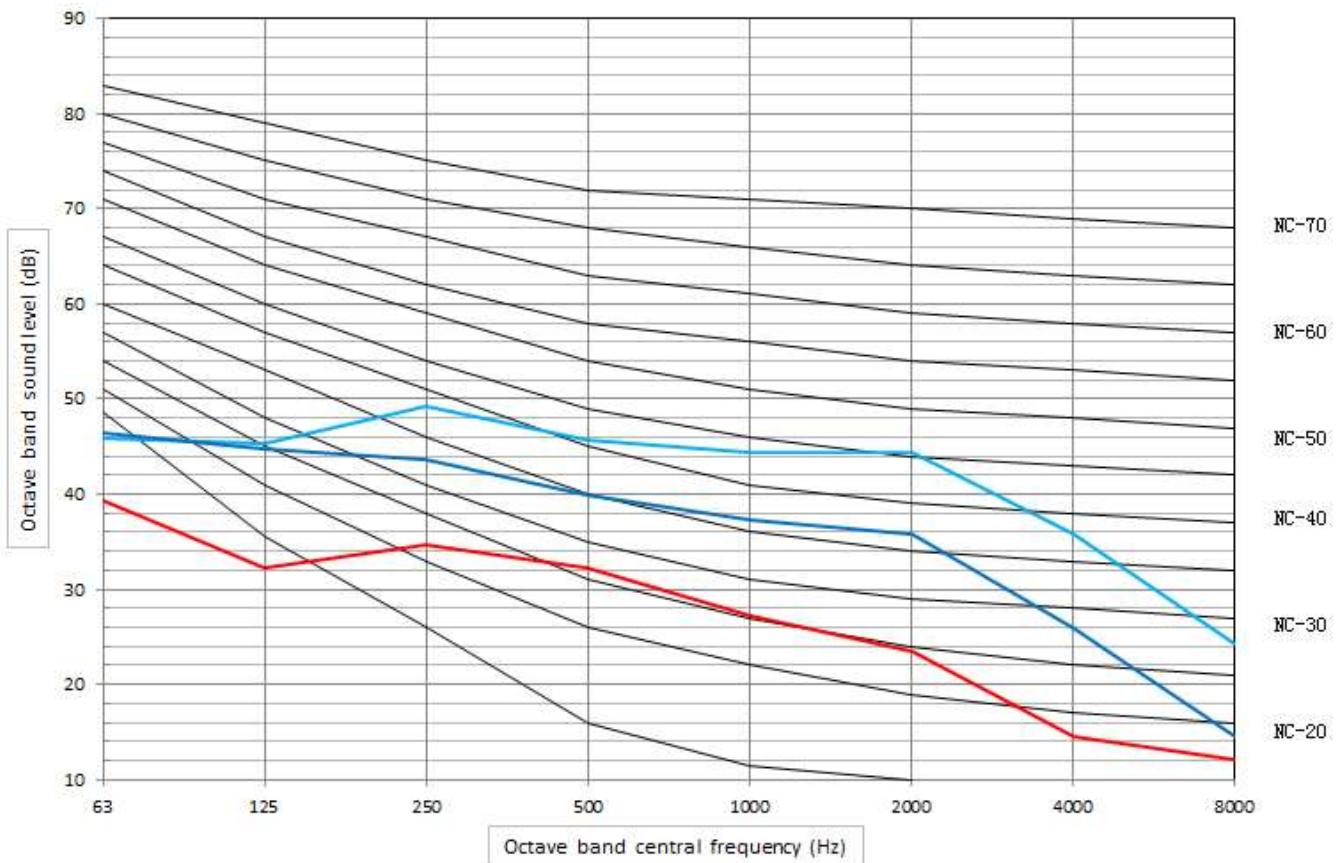




10. Service Spaces

Cased type

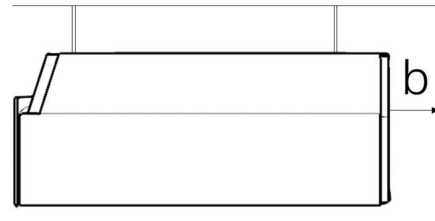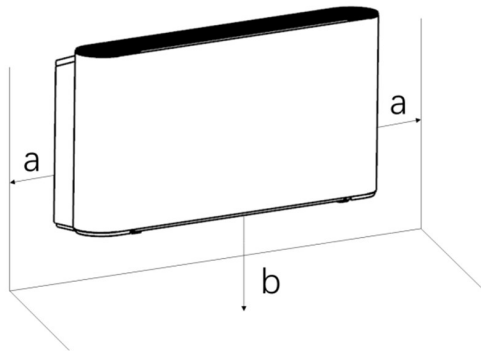

a (mm)	≥ 150
b (mm)	≥ 90
c (mm)	≥ 50


Uncased type

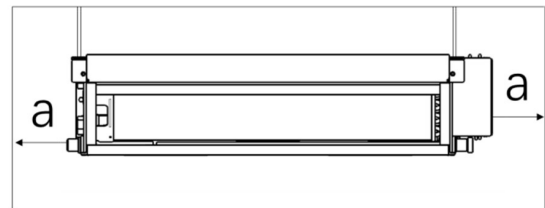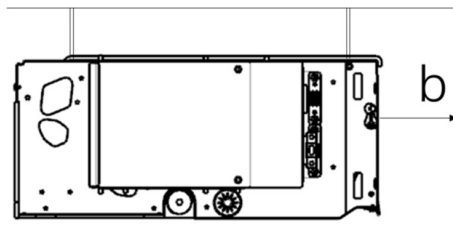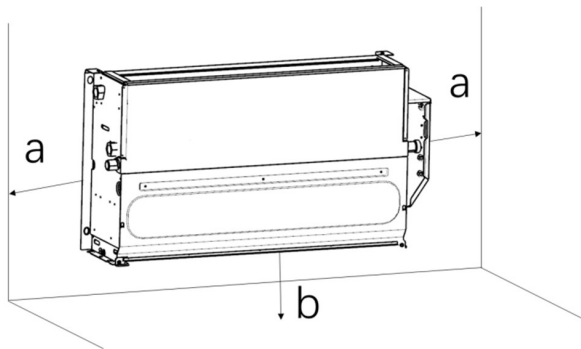

a (mm)	≥ 150
b (mm)	≥ 90

11. Wiring Diagrams

For all the model:

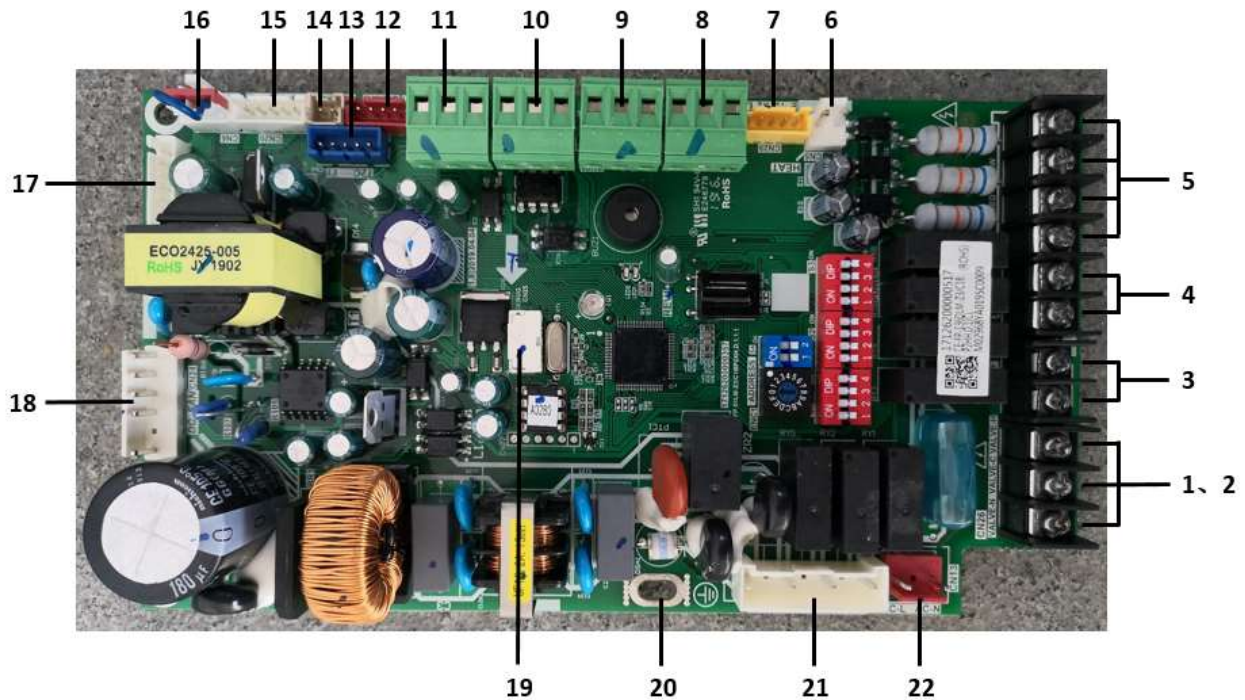

Main control board port description:


No.	Description	Remarks
1	VALVE-N: Cooling/Heating 2-way valve/3-way valve null line	Standard
	VALVE-C: Cooling 2-way/3-way valve live line	
2	VALVE-N: Cooling/Heating 2-way valve/3-way valve null line	Customized
	VALVE-H: Heating 2-way/3-way valve live line	
3	PUMP: Water pump output port	Customized
4	ALARM: Fault alarm output	Customized
5	HI: Mechanical 3-fan speeds wired controller, high fan speed	Customized
	MED: Mechanical 3-fan speeds wired controller, medium fan speed	
	LOW: Mechanical 3-fan speeds wired controller, low fan speed	
	COM: Mechanical 3-fan speeds wired controller, public port	
6	HEAT: Control port for auxiliary electric heating relay	Reserved
7	ABX2Y2E: 2-way 485 communication wired controller port	Reserved
8	XYE: Centralized control communication port	Customized
9	PQE: Modbus communication port	Customized
10	-10+: 0-10V wired controller input port	Customized
11	ON/OFF: Remote on/off port	Customized
12	SWING: Swing motor port	Reserved
13	T2C: Refrigerating pipe temperature sensor port	Standard
	T1: Room temperature sensor port	
14	T2H: Heating pipe temperature sensor port	Customized
15	CDABE: Unidirectional infrared communication wired controller port	Standard

MDV DC Fan Coil Unit

















16	WATER: Water level switch port	Customized
17	DISPLAY: Display board port	Reserved
18	DC_FAN: DC fan	Standard
19	DEBUG: Main control program burn port	Standard
20	Grounding screw position	Standard
21	N: Null line output port for AC fan	Reserved
	H: High fan speed output port for AC fan	
	M: Medium fan speed output port for AC fan	
	L: Low fan speed output port for AC fan	
22	AC-L: Power supply live line input	Standard
	AC-N: Power supply null line input	

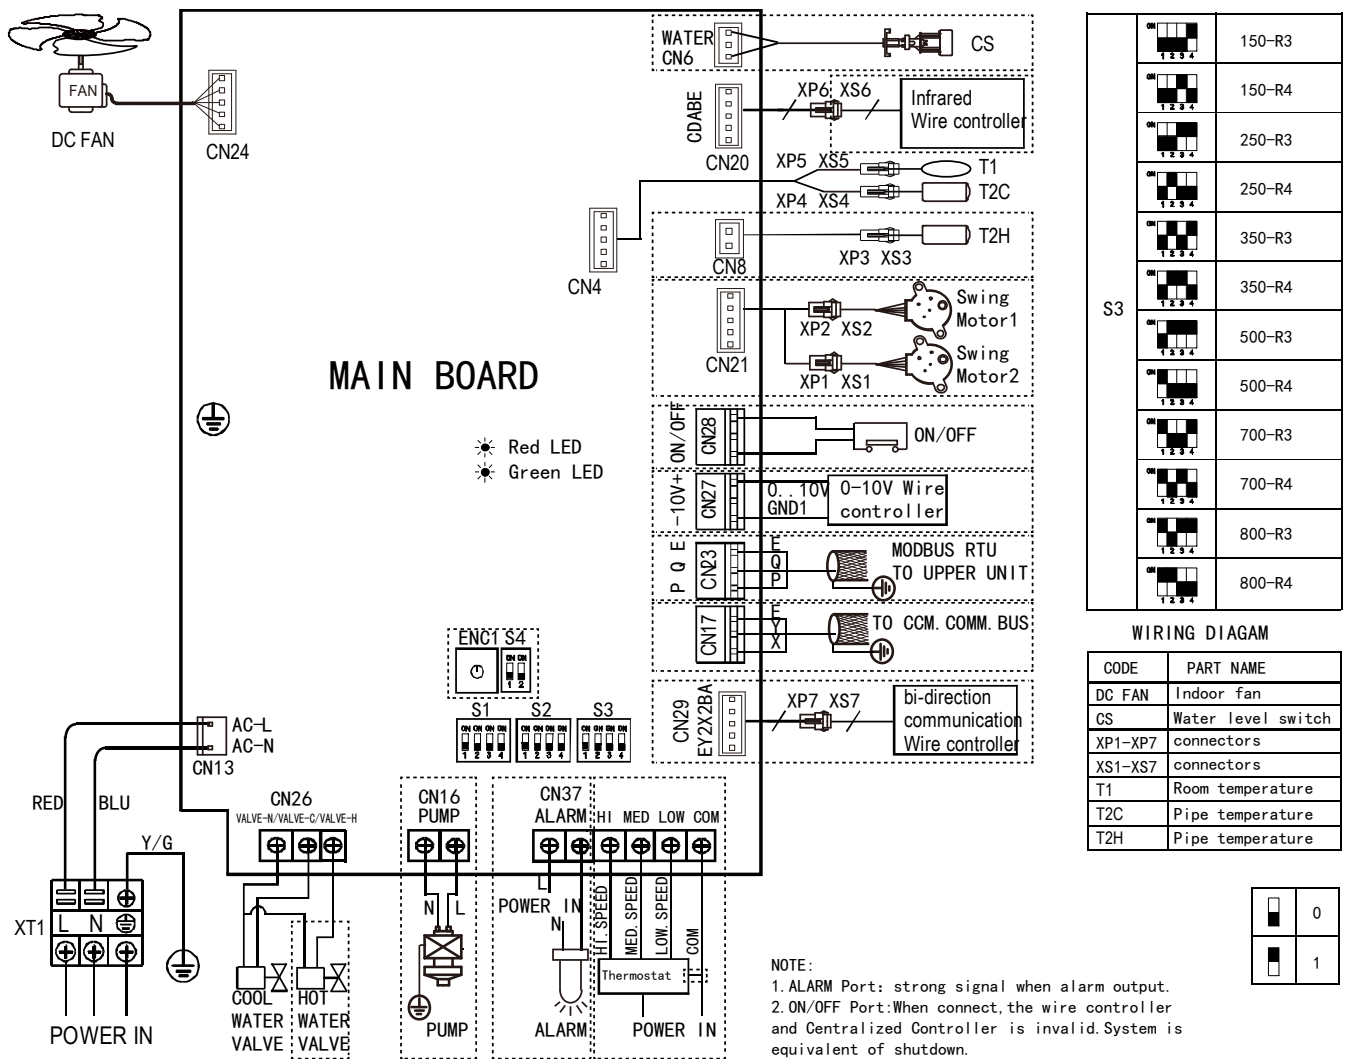For all the model:



	SWITCH FOR ADDRESS SETTING		Address
ENC1 & S4	'0-F' of the ENC1 and 'ON/OFF' of the S4, the different position represents a different address. It is combined 64 addresses (0-63)		Address 0-15
			Address 16-31
			Address 32-47
			Address 48-63

S1	S1-1		2 pipe (default)	S2	S2-1/2		Temp. compensation value is 0°C under cool mode (default)
			4 pipe				Temp. compensation value is 1°C under cool mode
	S1-2		Without force blowing (default)				Temp. compensation value is 2°C under cool mode
			Force Blowing				Temp. compensation value is 3°C under cool mode
	S1-3		Normal anti-cold wind (default)		S2-3/4		Temp. compensation value is 3°C under heat mode (default)
			High temperature anti-cold wind				Temp. compensation value is 1°C under heat mode
	S1-4						Temp. compensation value is 6°C under heat mode
						Temp. compensation value is 8°C under heat mode	

Green LED	Red LED	Name of fault
Constantly bright	1 flash	E2PROM communication error
Constantly bright	2 flashes	Room temperature sensor detection port is abnormal
Constantly bright	3 flashes	The coil sensor (T2C) detection port is abnormal
Constantly bright	4 flashes	DC motor stall failure
Constantly bright	5 flashes	The coil sensor (T2H) detection port is abnormal
Flashing	1 flash	Water level exceeds warning water level
Flashing	2 flashes	Model protection is not set
Flashing	3 flashes	Water temperature over-range protection
Flashing	4 flashes	Anti-freezing protection
Flashing	5 flashes	Remote OFF


12. Installation

12.1 Transport and handling

Caution:

Do not open or tamper with the packaging before installation. The units should only be moved and lifted by specialized personnel trained in these operations.

Check on arrival that the unit has not been damaged during transport and that it is complete with all its parts.

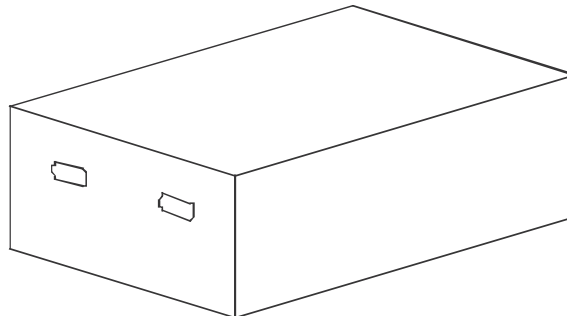

To remove the packaging, please follow below instructions:

1. Check for visible damage.
2. Open the packaging.
3. Check that the manual for use and maintenance are in the packaging.
4. Dispose of the packaging material in accordance with current legislation at the appropriate waste reception or recycling site.

The units may be moved or lifted either by hand or by means of a suitable trolley. If the weight of the unit is more than 30kg, moving units need to be moved at the same time, it is advisable to put the machines in a container and lift them by means of a crane or something similar.

12.2 Storage conditions

Units in packaging may be stacked not more than four-layer, and must be kept under cover.

12.3 Units installation

Caution:

Installation must only be carried out by qualified technicians, trained to work with air-conditioning and refrigeration systems. Incorrect installation could lead to unit malfunctioning and a consequent deterioration in performance.

For installation, follow the instructions set out below:

Check the space technically required for installation:

- ♦ Space required for installation.
- ♦ Space required for connecting the liquid lines and other valves.
- ♦ Space required for connecting power supply.
- ♦ Space required for connecting the unit to the external control panel (if any).
- ♦ Space required for setting flow route and air inlet (for specific models).
- ♦ Space required for correct and sufficient air flow.
- ♦ Space required for removing condensate water.
- ♦ Space required for cleaning the filter.
- ♦ Space required for cleaning internal assembly and maintenance.

Remove the casing:

Removing screws ① *2, ② *2 and ③ *2 and then the casing as Figure 12.4.1.

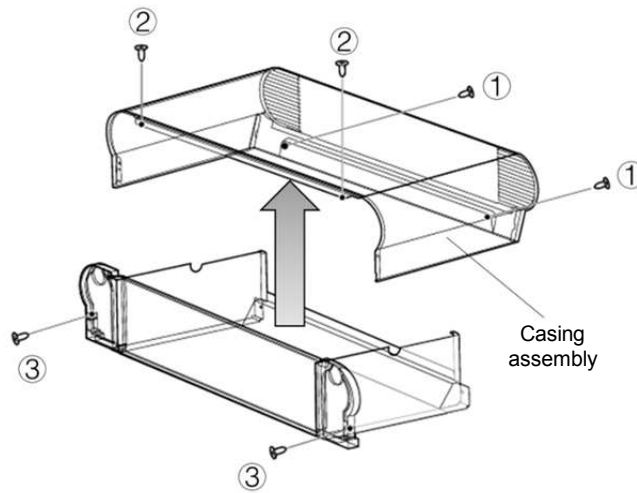


Figure 12.4.1

Mark the places for screws on the wall according to the unit mounting holes or dimensions specified in Figure 12.4.2. The drain pipe for condensate water must be smooth enough to allow unobstructed water discharge. As shown in Figure 12.4.2, fasten four screws (①) into a proper masonry structure.

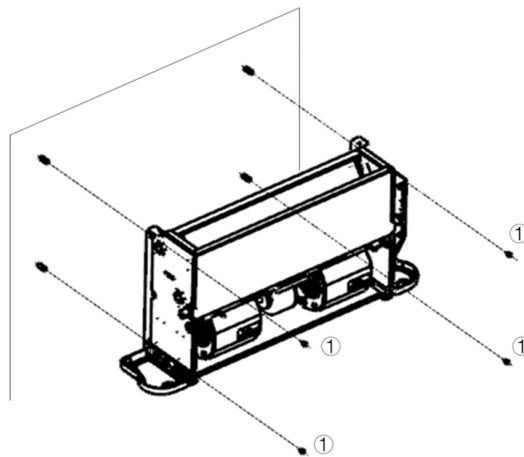


Figure 12.4.2

The footings shown in Figure 12.4.3 are optional. You can purchase them separately and install them as follows:

1. Put the footings beside the unit to be installed.
2. Place the mounting holes on the unit base into the corresponding footing locating pin and install screws ① *2 and ② *2 to fix the footing according to Figure 12.4.3.

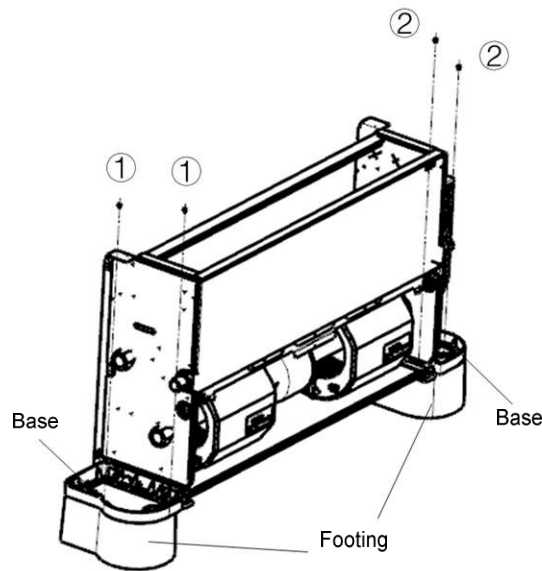






Figure 12.4.3

The footings shown in Figure 12.4.3 are optional. You can purchase them separately and install them as follows:

1. Put the footings beside the unit to be installed.
2. Place the mounting holes on the unit base into the corresponding footing locating pin and install screws ① *2 and ② *2 to fix the footing according to Figure 12.4.3.

Install the unit following the steps below in case it is ceiling mounted.

To match the existing structure, set the screw pitch according to the unit dimensions.

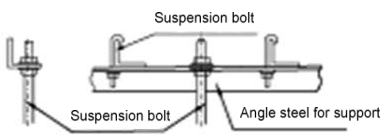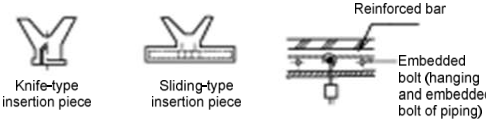Wooden structure	Original concrete slab structure
<p>Secure the square rod on the beam to set the lifting bolts.</p> 	<p>Use embedded bolts, and pull bolts.</p> 
Steel framework	Newly set concrete slab structure
<p>Directly set and use an angle steel for support.</p> 	<p>Set using embedded appliances, and embedded type of bolts.</p> 

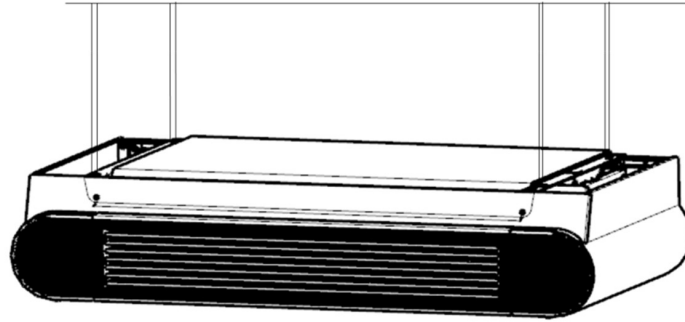


Figure 12.4.4 Diagram of ceiling exposed

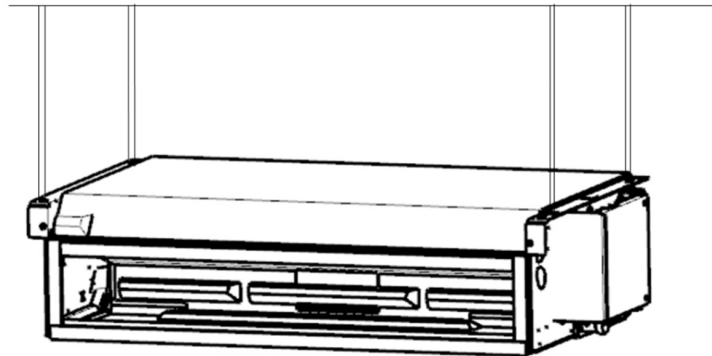


Figure 12.4.5 Diagram of ceiling concealed

Liquid pipe connections

Connect the unit to the water system using inlet and outlet connectors.

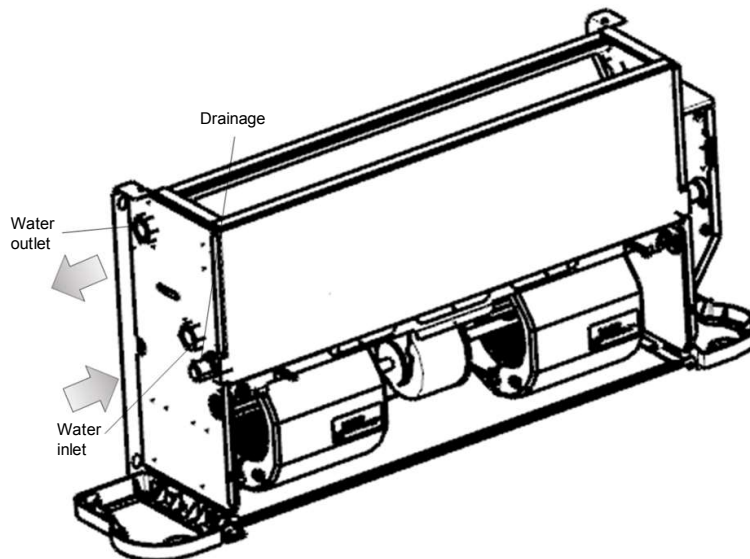


Figure 12.4.6

All water system coils are equipped with discharge and drain valves. Use a screwdriver or wrench to open and close the valve.

When installation is complete,

- ① Remove air inside pipes.
- ② Wrap the connecting pipes and all the valve body with anti-condensation material (EPDM or PE) of no less

MDV DC Fan Coil Unit



than 10 mm thick, or install auxiliary drainage equipment.

- ③ Pour water into the drain pan and check it all the way until you can see water flows from the drain outlet. Alternatively, you may check the drain channel and remove impurities that may obstruct the flow.
- ④ Install the condensate drain system.
- ⑤ The condensate drain system must be properly lowered to ensure water discharge.

Follow the steps below to set the condensate drain system.

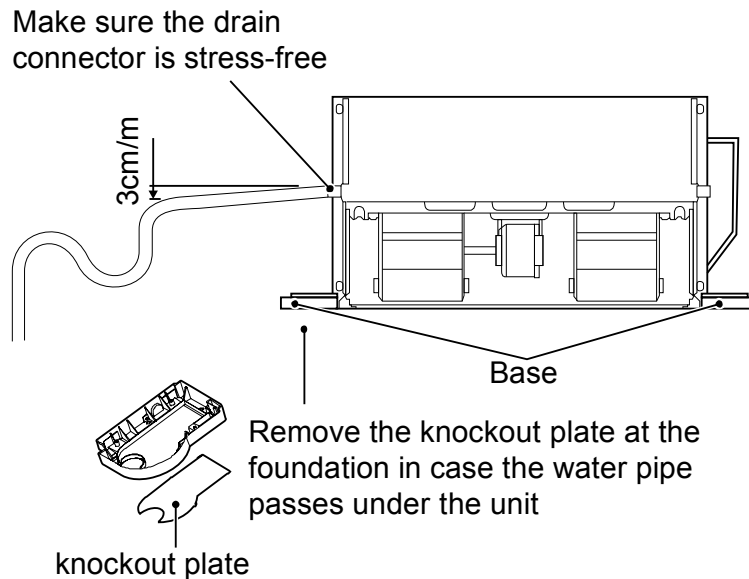


Figure 12.4.7

Set water storage elbow

The condensate drain system must be fitted with a suitable elbow to prevent odour penetration. Follow the steps below to set the elbow.

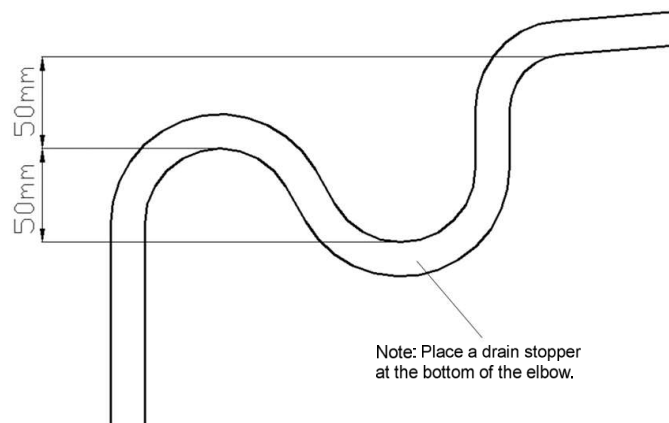


Figure 12.4.8

The customer has to purchase the three-way valve and its accessories (Operation and Installation Manual attached) separately from the manufacturer.

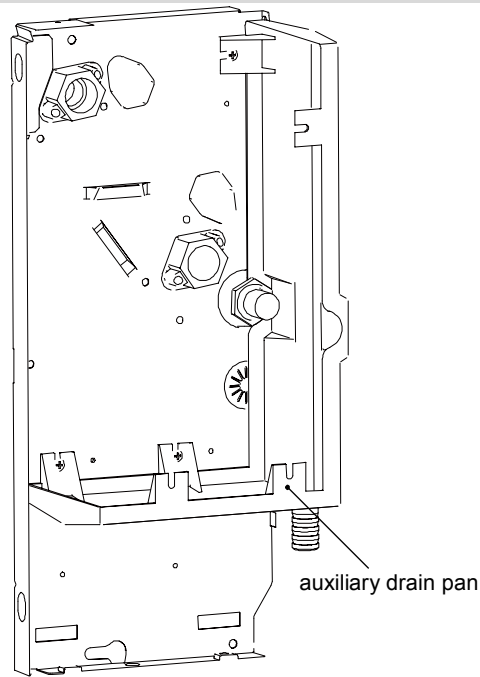


Figure 12.4.9

The customer may also need to purchase the auxiliary drain pan (Figure 12.4.9) separately from the manufacturer if required. See the steps below for installation of auxiliary drain pan:

Electrical connections

Caution:

- ♦ Make sure that the power supply falls with 220-240V~1ph 50Hz/60Hz and is able to provide enough wattage for the unit. The power supply system must comply with the current national safety regulations.
- ♦ The electrical connection must be completed by qualified professionals and must comply with local laws and regulations. The company is not responsible for personal or property damage resulting from any incorrect electrical connections.
- ♦ Provide dedicated and suitable leakage protection device for the unit, with a minimum distance of 3 mm among the wiring contacts. The unit must be grounded reliably.
- ♦ Make sure that the power cord has a large-enough cross section to withstand the maximum current required. Never use a damaged cable.
- ♦ Perform electrical connections according to the wiring nameplate of the unit.
- ♦ Secure the cable using clamps in the electric control box to ensure the safety of the power supply cable and the connection cable.
- ♦ Do not pull, step on or squeeze the cable. Do not use nails or staples to secure the power cord. You need to pass the cable through the knockout hole at the foundation.
- ♦ For this stationary appliance it is required to have for disconnection of mains supply and all-pole switch with a contact opening of at least 3mm in the fixed wiring

Danger!

Always install a general automatic switch in a protected area near the appliance with an adequate capacity characteristic delayed curve with sufficient breaking power. There should be a minimum distance of 3mm between the contacts. Earth connection is compulsory by law to ensure user safety while the machine is in use.

Refer to Tables 12.4.1&12.4.2for the specifications of the power cord and communication wire. A wiring capacity that is too small will cause the electrical wiring to become too hot, and lead to accidents when the unit burns and becomes damaged.

Select the wire diameters (minimum value) individually for each unit based on the Table 12.4.2.

MDV DC Fan Coil Unit



Maximum allowable voltage range variation between phases is 2%.

Select circuit breaker that having a contact separation in all poles not less than 3 mm providing full disconnection, where MFA is used to select the current circuit breakers and residual current operation breakers

Table 12.4.1

Air flow	255-1300m ³ /h
Power supply voltage	220-240V
Power supply phase	1 phase
Power supply frequency	50Hz、60Hz
Circuit breaker / Fuse	15A / 15A
Communication wire between indoor unit and wired controller	Three core shielded wire

Table 12.4.2

Rated current of appliance (A)	Nominal cross-sectional area (mm ²)	
	Flexible cords	Cable for fixed wiring
≤3	0.5 and 0.75	1 and 2.5
>3 and ≤6	0.75 and 1	1 and 2.5
>6 and ≤10	1 and 1.5	1 and 2.5
>10 and ≤16	1.5 and 2.5	1.5 and 4
>16 and ≤25	2.5 and 4	2.5 and 6
>25 and ≤32	4 and 6	4 and 10
>32 and ≤50	6 and 10	6 and 16
>50 and ≤63	10 and 16	10 and 25

Wiring

- ♦ See product wiring nameplate.
- ♦ Check that the voltage and the frequency of the power supply correspond to 220-240V single phase at 50Hz/60Hz; that the available power is sufficient for the running the equipment; and that the supply cables are of adequate section for the maximum current which will be required.
- ♦ Make sure that the power supply system complies with current national safety regulations.
- ♦ Electrical connections must be made in accordance with the wiring diagrams supplied with the machine. For connection to the power supply network, use double-insulated flexible cable, twin pole + earth, section 1.5mm², type H05RN-F.
- ♦ Pass the power supply cable through the slot beside the air filter. Use the cable clamp provided on the inner side of the panel to secure the power supply cable and the connecting cables, and strip only the length of cable needed to go into the connector block. In the event that the unit is mounted on a metal surface, earth connections must be made in compliance with local regulations. If the optional extra electric heating element is fitted, a separate power supply must be provided. Use double-insulated flexible cable, twin pole + earth, section 2.5mm², type H05RN-F.

Startup instructions

Caution:

Machine commissioning or the first startup must be carried out by skilled personnel qualified to work on this type of product.

Before starting up, make sure that the installation and electrical connections have been carried out in accordance with the instructions in this manual. Also make sure that there are no unauthorized persons in the vicinity of the machine during these operations.

Preliminary checks before startup

- ♦ Before starting up the unit, make sure that:
- ♦ The unit is positioned correctly;
- ♦ The flow and return pipes of the water system are correctly connected;

- ♦ The pipes are clean and free of air;
- ♦ The unit falls correctly towards the drainage outlet and the trap;
- ♦ The heat-exchangers are clean;
- ♦ The electrical connections are correct;
- ♦ The screws holding the cables are well tightened;
- ♦ The supply voltage is as required;
- ♦ The power consumption of the blower is correct and does not exceed the maximum permitted.

12.4 Maintenance

Caution:

- ♦ Maintenance work must only be carried out by qualified technicians authorized to work on air-conditioning and refrigeration systems.
- ♦ Use suitable work gloves.
- ♦ Do not use pointed objects through the air intake grilles.
- ♦ Disconnect the power supply before cleaning and maintenance.
- ♦ Use dry cloth to clean the unit.
- ♦ Always disconnect the unit from the mains power supply at the main isolator switch before carrying out maintenance work or checks. Make sure that no one accidentally supplies power to the machine; lock the main switch in the Off position.

Scheduled maintenance

- ♦ Once a month

Check the state of cleanliness of the air filters. The air filters are made of fibre and can be washed in water. The state of cleanliness of the filters must be checked regularly at the start of the operating season and on a monthly basis.

- ♦ Every six months

Check the state of cleanliness of the heat-exchanger and the condensation drain-tube.

Switch off the unit, remove the casing of the machine and check the state of the heat-exchanger and the condensation drain-tube if necessary:

1. Remove any obstacle from the surface which may obstruct air flow;
2. Clean the dust with a jet of compressed air;
3. Wash and brush gently with water;
4. Dry with a jet of compressed air;
5. Check that there are no obstacles in the condensation drain tube which could prevent the normal flow of water.

Release the air in the water system.

1. Remove the casing of the machine (for casing type);
2. Start the system and run for a few minutes;
3. Stop the system;
4. Loosen the release screw on the inlet manifold and release the air.
5. Repeat the operation several times until no more air comes out of the system.

At the end of the season

To avoid the risk of rupture due to freezing, it is advisable to drain the water from the system at the end of every season.

Check the electrical circuit

The following operations are recommended for the maintenance of the electrical circuit:

Tighten the electrical contacts and terminals;

Check the unit's power using a clip-on ammeter and compare with the values shown on the document.

Motor to replace, follow the steps below:

- a) Unplug the unit.
- b) As shown in Figure 12.5.1, remove screws ①*2 and ②*2 and then the casing.

MDV DC Fan Coil Unit



c) As shown in Figure 12.5.2, remove screws ①*2 to take the filter out.

Then, remove the upper volute.

After that, remove four screws (②) that fix the motor, to disconnect the motor cable and the main board. Then, take out the fan and the motor.

Disassemble the fan to get the motor.

Install back the motor in reverse order.

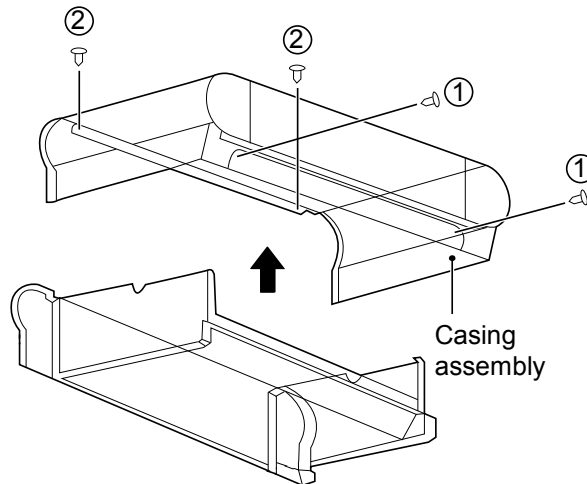


Figure 12.5.1 Removal of casing

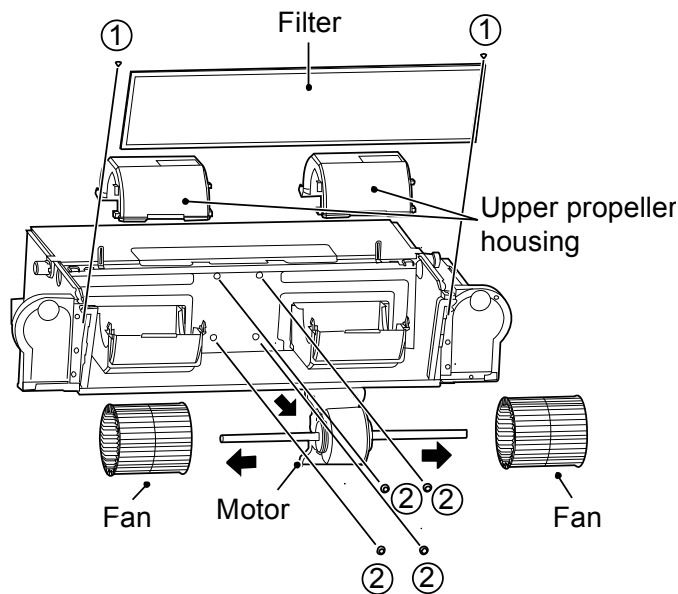


Figure 12.5.2 Removal of filter, upper volute and motor screws

Heat exchanger to replace, follow the steps below:

a) Unplug the unit.

b) Shut off the water supply.

c) As shown in Figure 12.5.3, remove screws ①*2 and ②*2 and then the casing.

d) Drain the coil.

e) Disassemble the inlet and outlet pipes.

f) As shown in Figure 12.5.4, remove screws ①*2 to remove the electric control box.

g) As shown in Figure 12.5.5, remove screws ①*7 to take the drain pan out. Then, remove screws ②*4 to take

the heat exchanger out.

h) Pull out the temperature sensor plug.

Install back the heat exchanger in reverse order

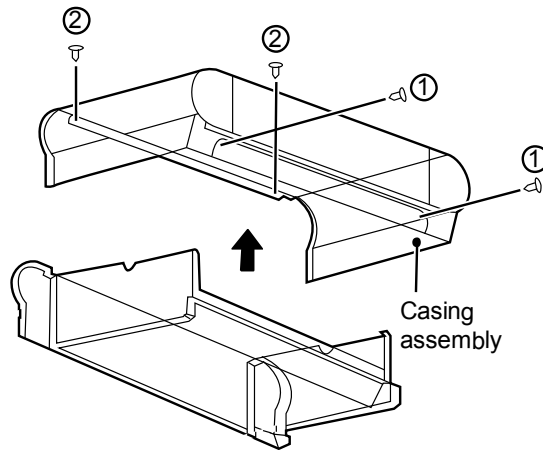


Figure 12.5.3 Removal of casing

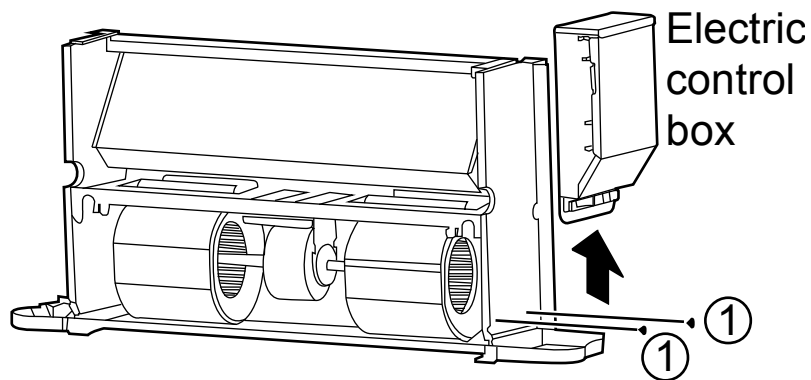


Figure 12.5.4 Removing the electric control box

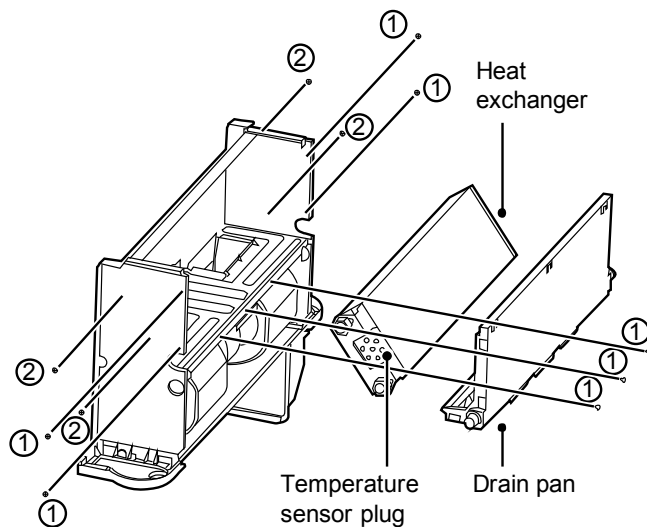


Figure 12.5.5 Removal of drain pan and heat exchanger

MDV DC Fan Coil Unit



If the unit or its parts need(s) to be removed, make sure that:

Only a professional person can disassemble the unit.

The system with antifreeze must not be discarded; otherwise, it will cause pollution. It should be collected and then be disposed off properly.

As a special waste, electronic components must be handled by professional persons together with polyurethane foam, polyurethane and sound absorbing sponge.

12.5 Troubleshooting

The system maintenance must be carried out by qualified maintenance personnel.

Error	Measures
If a safety device, such as a fuse, circuit breaker or a leakage circuit breaker is triggered frequently or the ON/OFF switch is not working properly.	Turn off the main power switch.
The operating switch is not functioning normally.	Turn off the power supply.
If a centralized controller is used, the unit number is displayed on the user interface, and the operating indicator is flickering, and an error code is shown on the screen as well.	Notify the installation personnel and report the error code.

Except as noted above, if the above faults are not typical and the unit still fails, follow the steps below:

Error	Measures
If the system does not run at all.	Check whether there is a power failure. Wait for the power supply to be restored. If a power failure occurs when the unit is still running, the system will restart automatically once the power is restored.
The system is running but there is insufficient cooling or heating.	<ul style="list-style-type: none"> Check whether the air outlet is blocked by any obstacles. Remove the obstacles. Check whether the filter is blocked. Check the temperature setting. Check the fan speed settings on the user interface. Check whether the doors and windows are open. Close the doors and windows to shut out wind from the external environment. Check whether there are too many people in the room when the cooling mode is in operation. Check whether the heat source of the room is too high. Check whether there is direct sunlight into the room. Use curtains or blinds. Check whether the angle of air flow is appropriate.

Error code overview:

If a centralized controller is used, error codes appear on the user interface. Contact the installation personnel and inform them of the error code, unit model and serial number (you can find the information on the nameplate of this unit).

Refer to Maintenance Manual for troubleshooting:

NO.	Error	Name	Running Indicator	Fault Indicator	Buzzer action	Error Code

1	Error	E ² PROM communication error	Steady on	Flashes once every 3 seconds	Buzzes 2 times every 3 seconds	E7
2	Error	Room temperature sensor port abnormal	Steady on	Flashes 2 times every 3 seconds	Buzzes 2 times every 3 seconds	E2
3	Error	Coil sensor (T2C)port abnormal	Steady on	Flashes 3 times every 3 seconds	Buzzes 2 times every 3 seconds	E3
4	Error	Coil sensor (T2H)port abnormal	Steady on	Flashes 3 times every 5 seconds	Buzzes 2 times every 3 seconds	E4
5	Error	DC motor stall fault	Steady on	Flashes 4 times every 3 seconds	Buzzes 2 times every 3 seconds	E8
6	Protection	Water level exceeding warning line	Blinking	Flashes once every 3 seconds	Buzzes 2 times every 3 seconds	EE
7	Protection	Model protection not set (model DIP switch not listed in the model table)	Blinking	Flashes 2 times every 3 seconds	Buzzes 2 times every 3 seconds	PH
8	Protection	Water temperature protection	Blinking	Flashes 3 times every 3 seconds	Buzzes 2 times every 3 seconds	P1
9	Protection	Anti-freezing protection	Blinking	Flashes 4 times every 3 seconds	Buzzes 2 times every 3 seconds	P0
10	Protection	Remote shutdown	Blinking	Flashes 5 times every 3 seconds	Buzzes 2 times every 3 seconds	P2

Non-Unit Related Faults:

The following fault symptoms are not caused by the unit itself:

1) Fault symptom: Fan speed is not consistent with the setting.

The fan doesn't respond to the controller. In cooling mode, when the pipe water temperature is outside the allowable range of room temperature, the fan speed will be maintained at a low level to avoid direct exposure to hot air. In heating mode, when the pipe water temperature reaches a certain low level, the fan speed will also be maintained at a low level to avoid direct exposure to cold air.

2) Fault symptom: Fan direction is not consistent with the setting.

The fan direction is inconsistent with the direction indicated on the user interface. Swing is a customized function. If the customer customizes this function and the fan direction does not correspond to the set direction, this is because the unit is controlled.

3) Fault symptom: white fog from a certain unit.

This may result from high humidity during cooling mode. If the interior pollution of the fan coil unit is severe, the indoor temperature distribution may be uneven. At this time, you need to clean the inside of the unit. Ask the dealer for information on how to clean the unit. This operation must be carried out by qualified maintenance personnel.

4) Fault symptom: dust and dirt in the unit.

It may happen after the unit is used again after being left idle for a long period. This is because there is dust inside the unit.

5) Fault symptom: odour from unit.

The unit will absorb the odours of rooms, furniture, cigarettes and others, and then disperse the odours again. Odour might occur after small animals enter the unit.

13. Capacity Table

13.1 Cooling capacity table

R3 series:

MDKH1-V150-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
			kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
5	3	15	1.23	0.94	0.35	18.26	1.23	1.07	0.35	18.16	1.26	1.21	0.36	19.20	1.34	1.34	0.39	21.47	1.47	1.47	0.42	25.15	
		17	1.64	0.95	0.47	29.80	1.63	1.08	0.47	29.46	1.62	1.21	0.46	29.13	1.61	1.34	0.46	28.80	1.61	1.47	0.46	28.79	
		19	-	-	-	-	2.06	1.08	0.59	44.14	2.04	1.22	0.58	43.66	2.03	1.34	0.58	43.19	2.02	1.47	0.58	42.73	
		20	-	-	-	-	2.28	1.09	0.65	52.92	2.27	1.22	0.65	52.36	2.26	1.35	0.65	51.80	2.24	1.48	0.64	51.24	
	4	15	1.08	0.86	0.23	8.90	1.11	1.00	0.24	9.36	1.17	1.15	0.25	10.24	1.29	1.29	0.28	12.02	1.42	1.42	0.30	14.18	
		17	1.50	0.88	0.32	15.53	1.49	1.01	0.32	15.35	1.48	1.14	0.32	15.18	1.48	1.27	0.32	15.17	1.50	1.41	0.32	15.67	
		19	-	-	-	-	1.93	1.02	0.41	23.94	1.92	1.16	0.41	23.68	1.90	1.28	0.41	23.43	1.89	1.41	0.41	23.17	
		20	-	-	-	-	2.16	1.03	0.46	29.06	2.14	1.16	0.46	28.75	2.13	1.29	0.46	28.45	2.12	1.42	0.45	28.15	
	5	15	0.94	0.80	0.16	3.74	1.00	0.94	0.17	4.40	1.09	1.09	0.19	5.49	1.22	1.22	0.21	7.24	1.36	1.36	0.23	8.96	
		17	1.32	0.80	0.23	8.56	1.32	0.93	0.23	8.44	1.32	1.07	0.23	8.44	1.35	1.21	0.23	8.84	1.41	1.35	0.24	9.54	
		19	-	-	-	-	1.78	0.96	0.31	14.20	1.77	1.09	0.30	14.05	1.76	1.22	0.30	13.90	1.74	1.35	0.30	13.74	
		20	-	-	-	-	2.02	0.97	0.35	17.76	2.01	1.10	0.35	17.57	1.99	1.23	0.34	17.38	1.98	1.36	0.34	17.20	
	6	15	0.85	0.75	0.12	1.90	0.94	0.90	0.13	2.28	1.04	1.04	0.15	2.97	1.17	1.17	0.17	4.07	1.30	1.30	0.19	5.40	
		17	1.15	0.73	0.17	3.99	1.15	0.86	0.16	3.97	1.18	1.00	0.17	4.26	1.24	1.15	0.18	4.82	1.32	1.29	0.19	5.66	
		19	-	-	-	-	1.60	0.88	0.23	8.70	1.59	1.01	0.23	8.60	1.58	1.14	0.23	8.48	1.58	1.27	0.23	8.50	
		20	-	-	-	-	1.85	0.89	0.27	11.17	1.84	1.02	0.26	11.04	1.83	1.16	0.26	10.93	1.82	1.28	0.26	10.81	
	7	3	15	0.93	0.80	0.27	11.21	0.98	0.94	0.28	12.18	1.08	1.08	0.31	14.39	1.21	1.21	0.35	17.80	1.34	1.34	0.38	20.91
			17	1.34	0.81	0.38	20.86	1.33	0.94	0.38	20.90	1.32	1.07	0.38	20.65	1.33	1.20	0.38	20.84	1.37	1.34	0.39	21.67
			19	-	-	-	-	1.77	0.95	0.51	33.95	1.75	1.08	0.51	33.58	1.74	1.21	0.50	33.21	1.73	1.34	0.50	32.84
			20	-	-	-	-	1.99	0.95	0.57	41.29	1.98	1.08	0.57	40.84	1.97	1.21	0.57	40.87	1.96	1.34	0.57	40.55
4		15	0.80	0.73	0.17	4.60	0.89	0.88	0.19	5.97	1.02	1.02	0.22	7.99	1.15	1.15	0.25	9.92	1.29	1.29	0.28	12.01	
		17	1.18	0.74	0.25	10.25	1.17	0.87	0.25	10.12	1.18	1.01	0.25	10.27	1.22	1.15	0.26	10.92	1.30	1.29	0.28	12.18	
		19	-	-	-	-	1.62	0.88	0.35	17.58	1.61	1.02	0.35	17.38	1.60	1.15	0.34	17.19	1.59	1.28	0.34	17.00	
		20	-	-	-	-	1.85	0.89	0.40	22.14	1.84	1.02	0.40	21.90	1.83	1.15	0.39	21.66	1.82	1.28	0.39	21.42	
5		15	0.73	0.68	0.13	2.00	0.83	0.83	0.14	2.75	0.96	0.96	0.16	4.06	1.09	1.09	0.19	5.69	1.23	1.23	0.21	7.39	
		17	0.98	0.65	0.17	4.40	1.00	0.79	0.17	4.55	1.05	0.94	0.18	5.14	1.12	1.08	0.19	6.10	1.23	1.23	0.21	7.41	
		19	-	-	-	-	1.45	0.81	0.25	9.92	1.44	0.94	0.25	9.80	1.44	1.09	0.25	13.40	1.44	1.21	0.25	9.83	
		20	-	-	-	-	1.70	0.82	0.29	12.93	1.68	0.96	0.29	12.78	1.67	1.09	0.29	12.64	1.66	1.22	0.29	12.49	
6	15	0.66	0.64	0.09	1.33	0.78	0.78	0.11	1.63	0.91	0.91	0.13	2.23	1.04	1.04	0.15	3.16	1.17	1.17	0.17	4.32		
	17	0.85	0.60	0.12	1.91	0.90	0.75	0.13	2.14	0.97	0.89	0.14	2.59	1.05	1.04	0.15	3.28	1.17	1.17	0.17	4.34		
	19	-	-	-	-	1.25	0.73	0.18	5.13	1.24	0.86	0.18	5.04	1.26	1.00	0.18	5.22	1.30	1.14	0.19	5.68		
	20	-	-	-	-	1.50	0.74	0.22	7.68	1.49	0.88	0.21	7.58	1.48	1.01	0.21	7.47	1.48	1.14	0.21	7.48		
9	3	15	0.68	0.66	0.19	6.31	0.81	0.81	0.23	8.68	0.94	0.94	0.27	11.31	1.08	1.08	0.31	14.18	1.21	1.21	0.35	17.37	
		17	1.01	0.66	0.29	12.65	1.00	0.80	0.29	12.51	1.03	0.94	0.29	13.05	1.09	1.08	0.31	14.49	1.21	1.21	0.35	17.34	
		19	-	-	-	-	1.45	0.81	0.41	23.40	1.44	0.94	0.41	23.12	1.43	1.07	0.41	22.85	1.42	1.20	0.41	22.67	
		20	-	-	-	-	1.68	0.81	0.49	30.68	1.67	0.95	0.48	30.33	1.66	1.08	0.48	29.98	1.65	1.21	0.48	29.64	
	4	15	0.62	0.61	0.13	2.36	0.75	0.75	0.16	3.98	0.88	0.88	0.19	5.96	1.02	1.02	0.22	7.89	1.15	1.15	0.25	9.73	
		17	0.81	0.58	0.17	4.89	0.85	0.73	0.18	5.44	0.92	0.88	0.20	6.51	1.02	1.02	0.22	7.92	1.16	1.16	0.25	9.76	
		19	-	-	-	-	1.28	0.74	0.28	11.60	1.27	0.87	0.27	11.46	1.27	1.01	0.27	11.39	1.29	1.14	0.28	11.77	
		20	-	-	-	-	1.52	0.75	0.33	15.56	1.51	0.88	0.33	15.38	1.50	1.01	0.32	15.20	1.49	1.14	0.32	15.01	
	5	15	0.56	0.56	0.10	1.31	0.70	0.70	0.12	1.84	0.83	0.83	0.14	2.86	0.96	0.96	0.17	4.25	1.09	1.09	0.19	5.86	
		17	0.69	0.53	0.12	1.76	0.75	0.68	0.13	2.21	0.84	0.82	0.14	2.99	0.96	0.96	0.17	4.26	1.10	1.10	0.19	5.88	
		19	-	-	-	-	1.08	0.66	0.19	5.66	1.07	0.80	0.18	5.64	1.11	0.94	0.19	6.07	1.17	1.08	0.20	6.77	
		20	-	-	-	-	1.34	0.68	0.23	8.50	1.33	0.81	0.23	8.40	1.32	0.94	0.23	8.29	1.33	1.08	0.23	8.43	
6	15	0.50	0.50	0.07	0.96	0.65	0.65	0.09	1.24	0.78	0.78	0.11	1.60	0.91	0.91	0.13	2.28	1.04	1.04	0.15	3.26		
	17	0.57	0.47	0.08	1.08	0.67	0.63	0.10	1.29	0.79	0.78	0.11	1.61	0.91	0.91	0.13	2.29	1.04	1.04	0.15	3.27		
	19	-	-	-	-	0.90	0.59	0.13	2.25	0.94	0.74	0.13	2.48	1.00	0.88	0.14	2.94	1.08	1.03	0.15	3.62		
	20	-	-	-	-	1.12	0.59	0.16	4.02	1.11	0.73	0.16	3.93	1.13	0.87	0.16	4.12	1.18	1.01	0.17	4.59		

Continued:

MDKH1-V150-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	0.53	0.53	0.15	3.42	0.67	0.67	0.19	6.07	0.81	0.81	0.23	8.46	0.94	0.94	0.27	11.01	1.08	1.08	0.31	13.78	
		17	0.64	0.51	0.18	5.55	0.71	0.66	0.20	6.73	0.81	0.81	0.23	8.48	0.95	0.95	0.27	11.04	1.08	1.08	0.31	13.82	
		19	-	-	-	-	1.10	0.67	0.31	14.35	1.09	0.80	0.31	14.18	1.10	0.94	0.31	14.31	1.14	1.07	0.33	15.18	
		20	-	-	-	-	1.33	0.67	0.38	19.83	1.32	0.81	0.38	19.58	1.31	0.94	0.37	19.34	1.31	1.07	0.37	19.17	
	4	15	0.48	0.48	0.10	1.37	0.61	0.61	0.13	2.37	0.75	0.75	0.16	4.02	0.88	0.88	0.19	5.98	1.02	1.02	0.22	7.72	
		17	0.53	0.46	0.11	1.64	0.63	0.61	0.13	2.49	0.75	0.75	0.16	4.03	0.89	0.89	0.19	6.00	1.02	1.02	0.22	7.74	
		19	-	-	-	-	0.89	0.59	0.19	6.05	0.91	0.73	0.19	6.30	0.97	0.87	0.21	7.00	1.05	1.02	0.22	8.04	
		20	-	-	-	-	1.15	0.60	0.25	9.43	1.14	0.74	0.24	9.30	1.14	0.87	0.24	9.26	1.17	1.01	0.25	9.66	
	5	15	0.43	0.43	0.07	0.94	0.57	0.57	0.10	1.26	0.70	0.70	0.12	1.89	0.83	0.83	0.14	2.99	0.96	0.96	0.17	4.42	
		17	0.44	0.41	0.08	0.98	0.57	0.57	0.10	1.27	0.70	0.70	0.12	1.90	0.83	0.83	0.14	3.01	0.96	0.96	0.17	4.44	
		19	-	-	-	-	0.73	0.52	0.12	2.09	0.78	0.67	0.13	2.57	0.87	0.82	0.15	3.36	0.97	0.96	0.17	4.51	
		20	-	-	-	-	0.93	0.52	0.16	4.05	0.93	0.66	0.16	4.07	0.97	0.80	0.17	4.56	1.04	0.95	0.18	5.33	
	6	15	0.36	0.36	0.05	0.65	0.51	0.51	0.07	0.92	0.65	0.65	0.09	1.18	0.78	0.78	0.11	1.61	0.91	0.91	0.13	2.38	
		17	0.37	0.36	0.05	0.66	0.51	0.51	0.07	0.92	0.65	0.65	0.09	1.19	0.79	0.79	0.11	1.62	0.91	0.91	0.13	2.39	
		19	-	-	-	-	0.60	0.47	0.09	1.08	0.70	0.63	0.10	1.30	0.80	0.78	0.12	1.70	0.92	0.92	0.13	2.40	
		20	-	-	-	-	0.76	0.46	0.11	1.49	0.80	0.61	0.11	1.70	0.87	0.75	0.12	2.10	0.95	0.90	0.14	2.69	
	13	3	15	0.40	0.40	0.11	1.68	0.53	0.53	0.15	3.66	0.67	0.67	0.19	6.16	0.81	0.81	0.23	8.46	0.94	0.94	0.27	10.98
			17	0.40	0.40	0.12	1.73	0.53	0.53	0.15	3.67	0.67	0.67	0.19	6.18	0.81	0.81	0.23	8.48	0.95	0.95	0.27	11.01
			19	-	-	-	-	0.70	0.52	0.20	6.62	0.75	0.66	0.21	7.38	0.83	0.81	0.24	8.76	0.95	0.95	0.27	11.04
			20	-	-	-	-	0.95	0.53	0.27	11.10	0.94	0.66	0.27	10.92	0.96	0.80	0.27	11.20	1.00	0.94	0.29	12.17
		4	15	0.34	0.34	0.07	0.91	0.48	0.48	0.10	1.37	0.62	0.62	0.13	2.51	0.75	0.75	0.16	4.24	0.89	0.89	0.19	5.97
			17	0.34	0.34	0.07	0.91	0.48	0.48	0.10	1.37	0.62	0.62	0.13	2.52	0.75	0.75	0.16	4.26	0.89	0.89	0.19	5.99
			19	-	-	-	-	0.56	0.46	0.12	1.91	0.64	0.61	0.14	2.81	0.75	0.75	0.16	4.28	0.89	0.89	0.19	6.01
			20	-	-	-	-	0.72	0.44	0.15	3.79	0.75	0.59	0.16	4.23	0.82	0.74	0.17	5.10	0.91	0.89	0.19	6.24
5		15	0.28	0.28	0.05	0.58	0.43	0.43	0.07	0.89	0.57	0.57	0.10	1.21	0.70	0.70	0.12	1.93	0.83	0.83	0.14	3.08	
		17	0.28	0.28	0.05	0.58	0.43	0.43	0.07	0.89	0.57	0.57	0.10	1.22	0.70	0.70	0.12	1.94	0.83	0.83	0.14	3.09	
		19	-	-	-	-	0.46	0.41	0.08	0.95	0.58	0.56	0.10	1.25	0.70	0.70	0.12	1.95	0.83	0.83	0.14	3.10	
		20	-	-	-	-	0.56	0.39	0.10	1.18	0.64	0.54	0.11	1.53	0.73	0.69	0.12	2.17	0.84	0.83	0.14	3.14	
6	15	0.21	0.21	0.03	0.35	0.37	0.37	0.05	0.62	0.51	0.51	0.07	0.88	0.65	0.65	0.09	1.14	0.78	0.78	0.11	1.63		
	17	0.21	0.21	0.03	0.35	0.37	0.37	0.05	0.62	0.51	0.51	0.07	0.88	0.65	0.65	0.09	1.14	0.79	0.79	0.11	1.64		
	19	-	-	-	-	0.37	0.36	0.05	0.64	0.51	0.51	0.07	0.88	0.65	0.65	0.09	1.14	0.79	0.79	0.11	1.65		
	20	-	-	-	-	0.42	0.33	0.06	0.71	0.54	0.49	0.08	0.93	0.66	0.65	0.10	1.17	0.79	0.79	0.11	1.65		
15	3	15	0.26	0.26	0.07	0.87	0.40	0.40	0.11	1.69	0.53	0.53	0.15	3.70	0.67	0.67	0.19	6.00	0.81	0.81	0.23	8.21	
		17	0.26	0.26	0.07	0.87	0.40	0.40	0.11	1.69	0.53	0.53	0.15	3.72	0.67	0.67	0.19	6.01	0.81	0.81	0.23	8.24	
		19	-	-	-	-	0.41	0.39	0.12	1.83	0.53	0.53	0.15	3.71	0.67	0.67	0.19	6.03	0.81	0.81	0.23	8.26	
		20	-	-	-	-	0.50	0.37	0.14	3.25	0.58	0.52	0.17	4.54	0.68	0.67	0.19	6.14	0.81	0.81	0.23	8.27	
	4	15	0.19	0.19	0.04	0.48	0.34	0.34	0.07	0.86	0.48	0.48	0.10	1.36	0.61	0.61	0.13	2.57	0.75	0.75	0.16	4.28	
		17	0.19	0.19	0.04	0.48	0.34	0.34	0.07	0.86	0.48	0.48	0.10	1.36	0.62	0.62	0.13	2.58	0.75	0.75	0.16	4.30	
		19	-	-	-	-	0.34	0.34	0.07	0.86	0.49	0.49	0.10	1.37	0.62	0.62	0.13	2.59	0.75	0.75	0.16	4.31	
		20	-	-	-	-	0.39	0.32	0.08	0.97	0.50	0.48	0.11	1.47	0.62	0.61	0.13	2.59	0.75	0.75	0.16	4.32	
	5	15	0.12	0.12	0.02	0.23	0.28	0.28	0.05	0.56	0.43	0.43	0.07	0.85	0.57	0.57	0.10	1.22	0.70	0.70	0.12	2.04	
		17	0.12	0.12	0.02	0.23	0.28	0.28	0.05	0.56	0.43	0.43	0.07	0.86	0.57	0.57	0.10	1.22	0.70	0.70	0.12	2.05	
		19	-	-	-	-	0.28	0.28	0.05	0.56	0.43	0.43	0.07	0.86	0.57	0.57	0.10	1.22	0.70	0.70	0.12	2.06	
		20	-	-	-	-	0.29	0.27	0.05	0.58	0.43	0.43	0.07	0.86	0.57	0.57	0.10	1.22	0.70	0.70	0.12	2.06	
6	15	-	-	-	-	0.21	0.21	0.03	0.34	0.37	0.37	0.05	0.60	0.51	0.51	0.07	0.84	0.65	0.65	0.09	1.12		
	17	-	-	-	-	0.21	0.21	0.03	0.35	0.37	0.37	0.05	0.60	0.52	0.52	0.07	0.84	0.66	0.66	0.09	1.12		
	19	-	-	-	-	0.21	0.21	0.03	0.35	0.37	0.37	0.05	0.60	0.52	0.52	0.07	0.84	0.66	0.66	0.09	1.13		
	20	-	-	-	-	0.21	0.21	0.03	0.35	0.37	0.37	0.05	0.60	0.52	0.52	0.07	0.84	0.66	0.66	0.09	1.13		

Abbreviations:

- EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
- WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH1-V250-R3																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	1.91	1.45	0.55	19.59	1.90	1.65	0.55	19.47	1.94	1.86	0.56	20.25	2.07	2.07	0.60	22.66	2.27	2.27	0.65	26.45
		17	2.53	1.46	0.72	31.46	2.51	1.66	0.72	31.11	2.50	1.86	0.71	30.76	2.48	2.06	0.71	30.41	2.48	2.26	0.71	30.40
		19	-	-	-	-	3.18	1.67	0.92	47.26	3.16	1.88	0.91	46.76	3.14	2.08	0.90	45.93	3.12	2.27	0.89	45.44
		20	-	-	-	-	3.52	1.68	1.01	55.89	3.50	1.88	1.00	55.30	3.48	2.08	1.00	54.71	3.46	2.28	0.99	54.13
	4	15	1.66	1.33	0.36	9.44	1.70	1.55	0.37	9.83	1.81	1.77	0.39	10.81	1.98	1.98	0.43	12.68	2.19	2.19	0.47	14.96
		17	2.32	1.36	0.50	16.60	2.30	1.56	0.50	16.42	2.28	1.76	0.49	16.02	2.28	1.97	0.49	16.01	2.32	2.18	0.50	16.72
		19	-	-	-	-	2.97	1.58	0.64	25.25	2.95	1.78	0.63	24.98	2.94	1.98	0.63	24.72	2.92	2.18	0.63	24.47
		20	-	-	-	-	3.33	1.59	0.71	30.67	3.31	1.79	0.71	30.35	3.29	1.99	0.71	30.03	3.27	2.19	0.70	29.71
	5	15	1.46	1.23	0.25	4.06	1.55	1.46	0.27	4.77	1.69	1.68	0.29	5.94	1.89	1.89	0.32	7.75	2.09	2.09	0.36	9.48
		17	2.05	1.24	0.35	9.10	2.03	1.44	0.35	8.98	2.03	1.65	0.35	8.98	2.08	1.87	0.36	9.36	2.17	2.08	0.37	10.07
		19	-	-	-	-	2.75	1.48	0.47	15.16	2.73	1.68	0.47	15.00	2.71	1.88	0.47	14.68	2.69	2.08	0.46	14.51
		20	-	-	-	-	3.12	1.49	0.54	18.74	3.10	1.69	0.53	18.54	3.08	1.89	0.53	18.35	3.06	2.09	0.53	18.15
6	15	1.32	1.16	0.19	2.02	1.45	1.39	0.21	2.46	1.60	1.60	0.23	3.23	1.80	1.80	0.26	4.42	2.00	2.00	0.29	5.84	
	17	1.78	1.12	0.26	4.34	1.78	1.33	0.25	4.32	1.83	1.55	0.26	4.63	1.91	1.77	0.27	5.23	2.04	1.99	0.29	6.12	
	19	-	-	-	-	2.48	1.36	0.36	9.24	2.46	1.56	0.35	9.13	2.45	1.76	0.35	9.01	2.45	1.97	0.35	9.03	
	20	-	-	-	-	2.87	1.38	0.41	11.86	2.85	1.58	0.41	11.73	2.83	1.78	0.41	11.60	2.81	1.98	0.40	11.42	
7	3	15	1.44	1.23	0.41	11.84	1.51	1.45	0.43	12.85	1.67	1.66	0.48	15.40	1.87	1.87	0.54	18.78	2.07	2.07	0.59	22.07
		17	2.06	1.24	0.59	21.96	2.05	1.45	0.59	21.70	2.04	1.65	0.58	21.44	2.05	1.86	0.59	21.66	2.11	2.07	0.61	22.87
		19	-	-	-	-	2.72	1.46	0.79	35.84	2.71	1.67	0.78	35.45	2.69	1.87	0.78	35.05	2.67	2.07	0.77	34.66
		20	-	-	-	-	3.07	1.47	0.88	43.59	3.05	1.67	0.88	43.12	3.03	1.87	0.87	42.65	3.01	2.07	0.87	42.19
	4	15	1.24	1.13	0.27	5.00	1.37	1.35	0.30	6.43	1.57	1.57	0.34	8.47	1.78	1.78	0.38	10.47	1.99	1.99	0.43	12.67
		17	1.82	1.14	0.39	10.84	1.81	1.34	0.39	10.69	1.82	1.55	0.39	10.85	1.89	1.77	0.41	11.60	2.00	1.99	0.43	12.85
		19	-	-	-	-	2.50	1.37	0.54	18.55	2.48	1.57	0.53	18.34	2.47	1.77	0.53	18.14	2.45	1.97	0.53	17.94
		20	-	-	-	-	2.86	1.37	0.62	23.36	2.84	1.58	0.61	23.10	2.82	1.78	0.61	22.85	2.81	1.98	0.60	22.60
	5	15	1.13	1.06	0.19	2.15	1.28	1.28	0.22	2.99	1.48	1.48	0.25	4.41	1.68	1.68	0.29	6.13	1.89	1.89	0.33	7.85
		17	1.52	1.01	0.26	4.78	1.54	1.22	0.26	4.93	1.61	1.45	0.28	5.55	1.73	1.67	0.30	6.55	1.90	1.90	0.33	7.88
		19	-	-	-	-	2.24	1.25	0.39	10.48	2.23	1.46	0.38	10.36	2.23	1.70	0.38	12.70	2.23	1.87	0.38	10.38
		20	-	-	-	-	2.62	1.27	0.45	13.65	2.60	1.48	0.45	13.49	2.58	1.68	0.44	13.34	2.57	1.88	0.44	13.19
6	15	1.02	0.98	0.15	1.38	1.21	1.21	0.17	1.72	1.41	1.41	0.20	2.41	1.61	1.61	0.23	3.43	1.80	1.80	0.26	4.63	
	17	1.32	0.93	0.19	2.06	1.39	1.15	0.20	2.32	1.49	1.38	0.21	2.81	1.63	1.60	0.23	3.56	1.80	1.80	0.26	4.65	
	19	-	-	-	-	1.93	1.13	0.28	5.55	1.92	1.33	0.27	5.45	1.94	1.55	0.28	5.64	2.01	1.77	0.29	6.11	
	20	-	-	-	-	2.33	1.15	0.33	8.15	2.31	1.35	0.33	8.05	2.29	1.56	0.33	7.95	2.29	1.76	0.33	7.94	
9	3	15	1.05	1.03	0.30	6.74	1.25	1.25	0.36	9.15	1.46	1.46	0.42	11.93	1.66	1.66	0.48	15.00	1.87	1.87	0.54	18.20
		17	1.56	1.02	0.45	13.35	1.55	1.23	0.44	13.20	1.59	1.44	0.45	13.77	1.68	1.66	0.48	15.34	1.87	1.87	0.54	18.26
		19	-	-	-	-	2.23	1.25	0.64	24.69	2.21	1.45	0.64	24.40	2.20	1.65	0.63	24.12	2.19	1.86	0.63	23.93
		20	-	-	-	-	2.59	1.26	0.75	32.17	2.57	1.46	0.74	32.00	2.56	1.66	0.74	31.64	2.54	1.86	0.73	31.28
	4	15	0.95	0.95	0.21	2.56	1.15	1.15	0.25	4.31	1.36	1.36	0.29	6.38	1.57	1.57	0.34	8.32	1.78	1.78	0.38	10.27
		17	1.25	0.90	0.27	5.29	1.31	1.12	0.28	5.85	1.42	1.35	0.31	6.93	1.58	1.58	0.34	8.36	1.79	1.79	0.38	10.30
		19	-	-	-	-	1.98	1.14	0.43	12.25	1.97	1.35	0.42	12.10	1.96	1.55	0.42	12.03	1.99	1.77	0.43	12.41
		20	-	-	-	-	2.35	1.16	0.51	16.45	2.33	1.36	0.50	16.25	2.32	1.57	0.50	16.06	2.30	1.77	0.50	15.86
	5	15	0.87	0.87	0.15	1.36	1.08	1.08	0.19	1.98	1.28	1.28	0.22	3.10	1.48	1.48	0.25	4.60	1.69	1.69	0.29	6.27
		17	1.06	0.82	0.18	1.90	1.16	1.05	0.20	2.40	1.30	1.27	0.22	3.25	1.48	1.48	0.26	4.61	1.69	1.69	0.29	6.29
		19	-	-	-	-	1.66	1.02	0.29	6.09	1.66	1.23	0.29	6.06	1.72	1.45	0.30	6.49	1.81	1.67	0.31	7.19
		20	-	-	-	-	2.07	1.04	0.36	8.99	2.05	1.25	0.35	8.88	2.04	1.45	0.35	8.76	2.05	1.66	0.35	8.90
6	15	0.78	0.78	0.11	1.00	1.00	1.00	0.14	1.28	1.21	1.21	0.17	1.70	1.41	1.41	0.20	2.48	1.60	1.60	0.23	3.54	
	17	0.88	0.73	0.13	1.12	1.04	0.98	0.15	1.34	1.22	1.21	0.17	1.72	1.41	1.41	0.20	2.49	1.61	1.61	0.23	3.55	
	19	-	-	-	-	1.40	0.92	0.20	2.45	1.45	1.14	0.21	2.70	1.54	1.36	0.22	3.19	1.67	1.59	0.24	3.93	
	20	-	-	-	-	1.73	0.91	0.25	4.36	1.72	1.12	0.25	4.28	1.75	1.34	0.25	4.47	1.82	1.56	0.26	4.96	

Continued:

MDKH1-V250-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	0.82	0.82	0.23	3.71	1.03	1.03	0.29	6.45	1.25	1.25	0.36	8.93	1.46	1.46	0.42	11.62	1.66	1.66	0.48	14.64	
		17	0.99	0.79	0.28	5.95	1.09	1.02	0.31	7.12	1.25	1.25	0.36	8.95	1.46	1.46	0.42	11.65	1.67	1.67	0.48	14.69	
		19	-	-	-	-	1.69	1.03	0.48	15.10	1.68	1.23	0.48	14.88	1.69	1.44	0.48	15.05	1.75	1.66	0.50	15.89	
		20	-	-	-	-	2.06	1.04	0.59	20.92	2.04	1.24	0.58	20.67	2.03	1.45	0.58	20.41	2.02	1.65	0.58	20.23	
	4	15	0.74	0.74	0.16	1.44	0.95	0.95	0.20	2.57	1.15	1.15	0.25	4.35	1.37	1.37	0.29	6.36	1.58	1.58	0.34	8.14	
		17	0.82	0.71	0.18	1.77	0.96	0.94	0.21	2.70	1.15	1.15	0.25	4.36	1.37	1.37	0.29	6.38	1.58	1.58	0.34	8.17	
		19	-	-	-	-	1.38	0.91	0.30	6.45	1.41	1.13	0.30	6.68	1.49	1.35	0.32	7.40	1.62	1.58	0.35	8.48	
		20	-	-	-	-	1.78	0.93	0.38	9.96	1.76	1.14	0.38	9.83	1.76	1.34	0.38	9.78	1.80	1.56	0.39	10.20	
	5	15	0.66	0.66	0.11	0.97	0.88	0.88	0.15	1.32	1.08	1.08	0.19	2.05	1.28	1.28	0.22	3.25	1.49	1.49	0.26	4.77	
		17	0.69	0.64	0.12	1.01	0.88	0.88	0.15	1.33	1.08	1.08	0.19	2.06	1.28	1.28	0.22	3.26	1.49	1.49	0.26	4.79	
		19	-	-	-	-	1.12	0.81	0.19	2.27	1.21	1.04	0.21	2.79	1.34	1.26	0.23	3.65	1.50	1.49	0.26	4.86	
		20	-	-	-	-	1.43	0.80	0.25	4.39	1.44	1.01	0.25	4.41	1.50	1.24	0.26	4.91	1.61	1.47	0.28	5.70	
	6	15	0.56	0.56	0.08	0.68	0.79	0.79	0.11	0.96	1.00	1.00	0.14	1.23	1.21	1.21	0.17	1.74	1.41	1.41	0.20	2.59	
		17	0.57	0.56	0.08	0.69	0.79	0.79	0.11	0.96	1.01	1.01	0.14	1.24	1.21	1.21	0.17	1.74	1.41	1.41	0.20	2.60	
		19	-	-	-	-	0.93	0.73	0.13	1.12	1.08	0.97	0.16	1.37	1.24	1.20	0.18	1.84	1.41	1.41	0.20	2.61	
		20	-	-	-	-	1.17	0.71	0.17	1.61	1.24	0.94	0.18	1.84	1.34	1.16	0.19	2.28	1.47	1.39	0.21	2.92	
	13	3	15	0.62	0.62	0.18	1.81	0.82	0.82	0.24	3.96	1.04	1.04	0.30	6.50	1.25	1.25	0.36	8.92	1.46	1.46	0.42	11.58
			17	0.62	0.61	0.18	1.87	0.82	0.82	0.24	3.97	1.04	1.04	0.30	6.52	1.25	1.25	0.36	8.95	1.46	1.46	0.42	11.62
			19	-	-	-	-	1.09	0.80	0.31	7.00	1.16	1.02	0.33	7.79	1.28	1.25	0.37	9.24	1.46	1.46	0.42	11.65
			20	-	-	-	-	1.47	0.82	0.42	11.72	1.46	1.02	0.42	11.53	1.48	1.24	0.42	11.81	1.55	1.45	0.44	12.64
		4	15	0.53	0.53	0.11	0.94	0.75	0.75	0.16	1.46	0.95	0.95	0.20	2.73	1.16	1.16	0.25	4.56	1.37	1.37	0.29	6.31
			17	0.53	0.53	0.11	0.94	0.75	0.75	0.16	1.47	0.95	0.95	0.20	2.74	1.16	1.16	0.25	4.58	1.37	1.37	0.29	6.33
			19	-	-	-	-	0.86	0.71	0.18	2.08	0.99	0.94	0.21	3.05	1.16	1.16	0.25	4.61	1.37	1.37	0.29	6.35
			20	-	-	-	-	1.11	0.69	0.24	4.11	1.16	0.91	0.25	4.56	1.26	1.14	0.27	5.44	1.40	1.37	0.30	6.58
5		15	0.43	0.43	0.07	0.60	0.66	0.66	0.11	0.92	0.88	0.88	0.15	1.28	1.08	1.08	0.19	2.10	1.28	1.28	0.22	3.34	
		17	0.43	0.43	0.07	0.60	0.66	0.66	0.11	0.92	0.88	0.88	0.15	1.29	1.08	1.08	0.19	2.11	1.28	1.28	0.22	3.35	
		19	-	-	-	-	0.71	0.63	0.12	0.99	0.89	0.87	0.15	1.32	1.08	1.08	0.19	2.11	1.28	1.28	0.22	3.36	
		20	-	-	-	-	0.87	0.60	0.15	1.25	0.99	0.84	0.17	1.65	1.12	1.06	0.19	2.35	1.29	1.28	0.22	3.40	
6		15	0.33	0.33	0.05	0.37	0.57	0.57	0.08	0.65	0.79	0.79	0.11	0.91	1.01	1.01	0.14	1.19	1.21	1.21	0.17	1.77	
		17	0.33	0.33	0.05	0.37	0.57	0.57	0.08	0.65	0.79	0.79	0.11	0.91	1.01	1.01	0.14	1.19	1.21	1.21	0.17	1.78	
		19	-	-	-	-	0.58	0.56	0.08	0.66	0.79	0.79	0.11	0.91	1.01	1.01	0.14	1.20	1.21	1.21	0.17	1.78	
		20	-	-	-	-	0.66	0.52	0.09	0.74	0.84	0.76	0.12	0.97	1.03	1.00	0.15	1.23	1.21	1.21	0.17	1.79	
15		3	15	0.40	0.40	0.11	0.90	0.61	0.61	0.17	1.83	0.82	0.82	0.23	3.99	1.04	1.04	0.30	6.33	1.25	1.25	0.36	8.66
			17	0.40	0.40	0.11	0.90	0.61	0.61	0.18	1.84	0.82	0.82	0.23	4.01	1.04	1.04	0.30	6.34	1.25	1.25	0.36	8.69
			19	-	-	-	-	0.63	0.61	0.18	1.99	0.82	0.82	0.23	4.01	1.04	1.04	0.30	6.36	1.25	1.25	0.36	8.72
			20	-	-	-	-	0.78	0.57	0.22	3.53	0.89	0.81	0.26	4.86	1.05	1.04	0.30	6.48	1.25	1.25	0.36	8.73
		4	15	0.30	0.30	0.06	0.50	0.53	0.53	0.11	0.89	0.75	0.75	0.16	1.46	0.95	0.95	0.20	2.79	1.16	1.16	0.25	4.58
			17	0.30	0.30	0.06	0.50	0.53	0.53	0.11	0.89	0.75	0.75	0.16	1.47	0.95	0.95	0.20	2.80	1.16	1.16	0.25	4.60
			19	-	-	-	-	0.53	0.53	0.11	0.89	0.75	0.75	0.16	1.47	0.95	0.95	0.20	2.81	1.16	1.16	0.25	4.62
			20	-	-	-	-	0.60	0.50	0.13	1.01	0.77	0.74	0.17	1.59	0.95	0.95	0.20	2.81	1.16	1.16	0.25	4.63
	5	15	0.19	0.19	0.03	0.24	0.44	0.44	0.08	0.58	0.67	0.67	0.11	0.89	0.88	0.88	0.15	1.30	1.08	1.08	0.19	2.21	
		17	0.19	0.19	0.03	0.24	0.44	0.44	0.08	0.58	0.67	0.67	0.11	0.89	0.88	0.88	0.15	1.30	1.08	1.08	0.19	2.22	
		19	-	-	-	-	0.44	0.44	0.08	0.58	0.67	0.67	0.12	0.89	0.88	0.88	0.15	1.31	1.08	1.08	0.19	2.23	
		20	-	-	-	-	0.46	0.42	0.08	0.60	0.67	0.67	0.12	0.89	0.88	0.88	0.15	1.31	1.08	1.08	0.19	2.24	
	6	15	-	-	-	-	0.33	0.33	0.05	0.36	0.57	0.57	0.08	0.62	0.80	0.80	0.11	0.87	1.01	1.01	0.15	1.19	
		17	-	-	-	-	0.33	0.33	0.05	0.36	0.57	0.57	0.08	0.63	0.80	0.80	0.11	0.87	1.01	1.01	0.15	1.19	
		19	-	-	-	-	0.33	0.33	0.05	0.36	0.57	0.57	0.08	0.63	0.80	0.80	0.11	0.88	1.01	1.01	0.15	1.20	
		20	-	-	-	-	0.33	0.33	0.05	0.36	0.57	0.57	0.08	0.63	0.80	0.80	0.11	0.88	1.01	1.01	0.15	1.20	

MDKH1-V350-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	2.84	2.13	0.81	50.88	2.83	2.43	0.81	50.89	2.87	2.74	0.82	51.80	3.04	3.04	0.87	57.39	3.33	3.33	0.96	67.71	
		17	3.74	2.15	1.07	82.16	3.71	2.45	1.07	81.29	3.69	2.74	1.06	80.45	3.67	3.03	1.05	79.60	3.66	3.32	1.05	79.10	
		19	-	-	-	-	4.67	2.46	1.35	121.87	4.65	2.76	1.34	121.44	4.62	3.05	1.33	119.29	4.59	3.34	1.32	118.07	
		20	-	-	-	-	5.18	2.46	1.49	146.28	5.15	2.76	1.49	144.79	5.12	3.05	1.48	144.64	5.10	3.34	1.48	144.02	
	4	15	2.55	2.00	0.55	25.57	2.58	2.31	0.55	26.13	2.70	2.62	0.58	28.27	2.93	2.93	0.63	32.65	3.23	3.23	0.69	38.47	
		17	3.47	2.02	0.74	43.60	3.45	2.32	0.74	43.15	3.43	2.62	0.74	42.69	3.41	2.91	0.73	42.33	3.45	3.21	0.74	43.18	
		19	-	-	-	-	4.42	2.34	0.95	66.27	4.39	2.63	0.94	65.60	4.37	2.93	0.94	64.93	4.34	3.22	0.94	64.68	
		20	-	-	-	-	4.93	2.35	1.06	80.21	4.90	2.64	1.05	79.41	4.87	2.94	1.05	78.61	4.84	3.23	1.04	77.81	
	5	15	2.23	1.85	0.38	13.91	2.35	2.18	0.41	15.36	2.54	2.51	0.44	17.51	2.82	2.82	0.49	20.89	3.11	3.11	0.53	24.57	
		17	3.16	1.88	0.54	25.22	3.14	2.18	0.54	24.95	3.12	2.48	0.54	24.69	3.16	2.78	0.54	25.16	3.26	3.09	0.56	26.55	
		19	-	-	-	-	4.14	2.21	0.71	40.44	4.12	2.51	0.71	40.03	4.10	2.80	0.71	39.63	4.07	3.09	0.70	39.23	
		20	-	-	-	-	4.66	2.22	0.80	49.13	4.63	2.52	0.79	48.53	4.60	2.81	0.79	48.15	4.58	3.10	0.79	47.68	
6	15	1.95	1.70	0.28	7.31	2.14	2.04	0.31	9.08	2.38	2.38	0.34	11.38	2.69	2.69	0.39	14.10	2.99	2.99	0.43	16.78		
	17	2.82	1.73	0.40	15.19	2.80	2.03	0.40	15.00	2.82	2.34	0.41	15.28	2.93	2.66	0.42	16.23	3.08	2.98	0.44	17.61		
	19	-	-	-	-	3.82	2.07	0.55	25.47	3.80	2.37	0.54	25.21	3.78	2.66	0.54	24.95	3.76	2.95	0.54	24.71		
	20	-	-	-	-	4.36	2.09	0.63	32.12	4.34	2.39	0.62	31.80	4.31	2.68	0.62	31.47	4.29	2.97	0.62	31.16		
7	3	15	2.17	1.82	0.63	32.10	2.25	2.14	0.65	34.01	2.45	2.45	0.71	39.51	2.74	2.74	0.79	47.53	3.04	3.04	0.88	57.06	
		17	3.08	1.84	0.89	58.27	3.06	2.14	0.88	57.64	3.04	2.44	0.88	56.99	3.04	2.73	0.88	56.95	3.11	3.03	0.89	59.10	
		19	-	-	-	-	4.02	2.15	1.16	92.46	3.99	2.45	1.15	91.46	3.97	2.74	1.14	90.49	3.95	3.03	1.14	89.53	
		20	-	-	-	-	4.53	2.16	1.31	114.04	4.50	2.46	1.30	112.82	4.47	2.75	1.29	111.65	4.45	3.04	1.29	111.42	
	4	15	1.91	1.69	0.41	15.58	2.07	2.02	0.44	17.75	2.33	2.33	0.50	21.83	2.64	2.64	0.57	26.86	2.93	2.93	0.63	32.57	
		17	2.78	1.71	0.60	29.66	2.76	2.01	0.60	29.34	2.76	2.31	0.60	29.24	2.82	2.62	0.61	30.49	2.97	2.93	0.64	33.26	
		19	-	-	-	-	3.74	2.03	0.81	49.65	3.72	2.33	0.81	49.11	3.70	2.62	0.80	48.60	3.68	2.91	0.80	48.08	
		20	-	-	-	-	4.26	2.04	0.92	62.12	4.24	2.34	0.92	61.48	4.20	2.63	0.91	60.12	4.18	2.92	0.90	59.91	
	5	15	1.66	1.55	0.29	7.87	1.90	1.89	0.33	10.48	2.21	2.21	0.38	13.55	2.52	2.52	0.43	16.97	2.82	2.82	0.48	20.48	
		17	2.42	1.55	0.42	15.83	2.41	1.86	0.42	15.74	2.49	2.18	0.43	16.57	2.62	2.50	0.45	18.12	2.83	2.82	0.49	20.64	
		19	-	-	-	-	3.44	1.90	0.59	28.92	3.41	2.20	0.59	28.61	3.41	2.58	0.58	33.40	3.39	2.79	0.59	28.22	
		20	-	-	-	-	3.96	1.91	0.68	36.59	3.93	2.21	0.68	36.21	3.91	2.50	0.67	35.83	3.88	2.80	0.67	35.47	
6	15	1.51	1.45	0.22	3.84	1.76	1.76	0.25	5.81	2.07	2.07	0.30	8.63	2.39	2.39	0.34	11.29	2.70	2.70	0.39	13.95		
	17	1.98	1.37	0.28	7.79	2.07	1.70	0.30	8.60	2.23	2.04	0.32	10.00	2.44	2.38	0.35	11.72	2.70	2.70	0.39	13.97		
	19	-	-	-	-	3.07	1.75	0.44	17.30	3.05	2.04	0.44	17.10	3.04	2.34	0.44	17.04	3.11	2.66	0.45	17.65		
	20	-	-	-	-	3.63	1.77	0.52	23.08	3.60	2.07	0.52	22.72	3.58	2.37	0.51	22.48	3.55	2.66	0.51	22.23		
9	3	15	1.58	1.53	0.45	18.14	1.84	1.84	0.53	23.60	2.15	2.15	0.62	31.10	2.45	2.45	0.70	38.37	2.74	2.74	0.79	47.38	
		17	2.35	1.52	0.68	35.78	2.33	1.82	0.67	35.30	2.36	2.13	0.68	36.12	2.49	2.44	0.71	39.47	2.75	2.75	0.80	47.51	
		19	-	-	-	-	3.31	1.84	0.95	64.91	3.29	2.14	0.95	64.17	3.27	2.44	0.94	63.48	3.25	2.73	0.94	62.81	
		20	-	-	-	-	3.82	1.85	1.10	83.51	3.80	2.15	1.10	82.61	3.77	2.44	1.09	81.70	3.75	2.74	1.08	80.81	
	4	15	1.41	1.40	0.30	9.04	1.72	1.72	0.37	12.79	2.03	2.03	0.44	17.01	2.34	2.34	0.50	21.63	2.64	2.64	0.57	26.72	
		17	1.99	1.37	0.43	16.41	2.03	1.69	0.44	16.90	2.15	2.02	0.46	18.76	2.35	2.34	0.51	21.83	2.64	2.64	0.57	26.79	
		19	-	-	-	-	3.00	1.71	0.65	33.04	2.98	2.01	0.64	32.66	2.96	2.31	0.64	32.28	2.99	2.61	0.64	32.79	
		20	-	-	-	-	3.53	1.73	0.77	44.19	3.51	2.03	0.76	43.71	3.49	2.32	0.76	43.24	3.46	2.62	0.75	42.75	
	5	15	1.28	1.28	0.22	4.11	1.58	1.58	0.27	7.20	1.90	1.90	0.33	10.36	2.22	2.22	0.38	13.39	2.52	2.52	0.43	16.67	
		17	1.58	1.21	0.27	7.23	1.74	1.55	0.30	8.85	1.96	1.89	0.34	10.84	2.22	2.22	0.38	13.42	2.52	2.52	0.43	16.72	
		19	-	-	-	-	2.64	1.57	0.45	17.99	2.62	1.87	0.45	17.75	2.65	2.18	0.46	18.15	2.75	2.49	0.47	19.34	
		20	-	-	-	-	3.18	1.59	0.55	24.83	3.16	1.89	0.55	24.56	3.14	2.19	0.54	24.27	3.14	2.48	0.54	24.19	
6	15	1.17	1.17	0.17	2.11	1.47	1.47	0.21	3.70	1.77	1.77	0.25	6.08	2.08	2.08	0.30	8.76	2.40	2.40	0.34	11.19		
	17	1.34	1.09	0.19	2.91	1.54	1.43	0.22	4.23	1.79	1.77	0.26	6.22	2.09	2.09	0.30	8.78	2.40	2.40	0.34	11.22		
	19	-	-	-	-	2.19	1.39	0.31	9.54	2.24	1.71	0.32	9.90	2.36	2.04	0.34	10.91	2.54	2.37	0.36	12.31		
	20	-	-	-	-	2.79	1.43	0.40	14.41	2.77	1.73	0.40	14.23	2.76	2.04	0.40	14.20	2.83	2.35	0.41	14.83		

Continued:

		MDKH1-V350-R3																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.22	1.22	0.35	11.42	1.54	1.54	0.44	16.85	1.85	1.85	0.53	23.02	2.15	2.15	0.61	29.83	2.45	2.45	0.70	37.89	
		17	1.55	1.20	0.44	17.04	1.65	1.52	0.47	19.05	1.85	1.85	0.53	23.16	2.15	2.15	0.61	29.91	2.45	2.45	0.70	37.93	
		19	-	-	-	-	2.55	1.53	0.73	40.62	2.53	1.83	0.73	40.11	2.53	2.13	0.73	39.98	2.60	2.44	0.75	41.95	
		20	-	-	-	-	3.06	1.54	0.88	55.19	3.05	1.84	0.87	55.03	3.03	2.14	0.87	54.80	3.01	2.43	0.87	54.12	
	4	15	1.09	1.09	0.23	4.96	1.41	1.41	0.30	8.88	1.73	1.73	0.37	12.55	2.04	2.04	0.44	16.60	2.34	2.34	0.50	21.03	
		17	1.22	1.05	0.26	6.65	1.45	1.40	0.31	9.32	1.73	1.73	0.37	12.56	2.04	2.04	0.44	16.64	2.34	2.34	0.50	21.09	
		19	-	-	-	-	2.17	1.39	0.47	18.56	2.18	1.69	0.47	18.58	2.26	2.01	0.48	19.88	2.42	2.33	0.52	22.24	
		20	-	-	-	-	2.72	1.41	0.58	27.29	2.70	1.71	0.58	26.96	2.68	2.00	0.58	26.61	2.72	2.31	0.58	27.19	
	5	15	0.98	0.98	0.17	2.15	1.28	1.28	0.22	4.33	1.60	1.60	0.27	7.42	1.91	1.91	0.33	10.28	2.22	2.22	0.38	13.14	
		17	1.04	0.95	0.18	2.47	1.29	1.28	0.22	4.41	1.60	1.60	0.28	7.44	1.92	1.92	0.33	10.31	2.22	2.22	0.38	13.18	
		19	-	-	-	-	1.73	1.22	0.30	8.67	1.86	1.55	0.32	9.77	2.04	1.89	0.35	11.44	2.25	2.22	0.39	13.49	
		20	-	-	-	-	2.31	1.25	0.40	14.02	2.29	1.55	0.39	13.81	2.34	1.87	0.40	14.36	2.47	2.19	0.42	15.80	
	6	15	0.85	0.85	0.12	1.37	1.18	1.18	0.17	2.15	1.47	1.47	0.21	3.89	1.78	1.78	0.25	6.24	2.09	2.09	0.30	8.70	
		17	0.87	0.84	0.13	1.39	1.18	1.18	0.17	2.15	1.48	1.48	0.21	3.90	1.78	1.78	0.25	6.27	2.10	2.10	0.30	8.72	
		19	-	-	-	-	1.40	1.08	0.20	3.41	1.60	1.42	0.23	4.83	1.83	1.76	0.26	6.68	2.10	2.10	0.30	8.78	
		20	-	-	-	-	1.77	1.06	0.25	6.25	1.86	1.39	0.27	6.94	2.03	1.73	0.29	8.21	2.23	2.07	0.32	9.68	
	13	3	15	0.90	0.90	0.26	6.62	1.23	1.23	0.35	11.46	1.54	1.54	0.44	16.86	1.85	1.85	0.53	22.96	2.14	2.14	0.61	29.34
			17	0.92	0.90	0.26	6.89	1.23	1.23	0.35	11.48	1.54	1.54	0.44	16.90	1.85	1.85	0.53	23.02	2.15	2.15	0.61	29.43
			19	-	-	-	-	1.69	1.20	0.48	19.62	1.75	1.52	0.50	20.91	1.90	1.84	0.55	24.10	2.15	2.15	0.61	29.47
			20	-	-	-	-	2.22	1.22	0.63	31.18	2.20	1.52	0.63	30.72	2.21	1.82	0.63	30.86	2.30	2.14	0.66	33.04
		4	15	0.79	0.79	0.17	2.20	1.09	1.09	0.23	5.17	1.41	1.41	0.30	8.81	1.73	1.73	0.37	12.39	2.04	2.04	0.44	16.54
			17	0.79	0.79	0.17	2.21	1.09	1.09	0.23	5.19	1.42	1.42	0.30	8.83	1.73	1.73	0.37	12.42	2.04	2.04	0.44	16.59
			19	-	-	-	-	1.30	1.05	0.28	7.61	1.51	1.40	0.32	9.78	1.74	1.73	0.37	12.58	2.04	2.04	0.44	16.63
			20	-	-	-	-	1.80	1.06	0.38	13.18	1.82	1.38	0.39	13.44	1.94	1.71	0.42	15.21	2.11	2.03	0.46	17.60
5		15	0.66	0.66	0.11	1.21	0.98	0.98	0.17	2.17	1.28	1.28	0.22	4.45	1.60	1.60	0.27	7.39	1.92	1.92	0.33	10.08	
		17	0.66	0.66	0.11	1.21	0.98	0.98	0.17	2.18	1.28	1.28	0.22	4.47	1.60	1.60	0.27	7.41	1.92	1.92	0.33	10.11	
		19	-	-	-	-	1.07	0.94	0.18	2.70	1.31	1.27	0.22	4.70	1.60	1.60	0.28	7.42	1.92	1.92	0.33	10.14	
		20	-	-	-	-	1.29	0.89	0.22	4.56	1.47	1.23	0.25	6.25	1.70	1.58	0.29	8.21	1.95	1.92	0.33	10.34	
6		15	0.51	0.51	0.07	0.76	0.86	0.86	0.12	1.30	1.18	1.18	0.17	2.18	1.47	1.47	0.21	4.01	1.78	1.78	0.26	6.40	
		17	0.51	0.51	0.07	0.76	0.86	0.86	0.12	1.30	1.18	1.18	0.17	2.19	1.48	1.48	0.21	4.02	1.79	1.79	0.26	6.42	
		19	-	-	-	-	0.89	0.84	0.13	1.35	1.19	1.18	0.17	2.23	1.48	1.48	0.21	4.04	1.79	1.79	0.26	6.44	
		20	-	-	-	-	1.03	0.78	0.15	1.62	1.27	1.13	0.18	2.66	1.51	1.46	0.22	4.29	1.79	1.79	0.26	6.46	
15		3	15	0.59	0.59	0.17	2.22	0.91	0.91	0.26	6.59	1.23	1.23	0.35	11.14	1.54	1.54	0.44	16.61	1.84	1.84	0.53	22.27
			17	0.59	0.59	0.17	2.22	0.91	0.91	0.26	6.61	1.23	1.23	0.35	11.17	1.54	1.54	0.44	16.65	1.84	1.84	0.53	22.33
			19	-	-	-	-	0.95	0.90	0.27	7.15	1.23	1.23	0.35	11.16	1.55	1.55	0.44	16.70	1.85	1.85	0.53	22.40
			20	-	-	-	-	1.25	0.88	0.36	11.50	1.38	1.21	0.39	13.53	1.58	1.54	0.45	17.25	1.85	1.85	0.53	22.40
		4	15	0.46	0.46	0.10	1.02	0.79	0.79	0.17	2.24	1.10	1.10	0.23	5.35	1.42	1.42	0.30	8.73	1.73	1.73	0.37	12.37
			17	0.46	0.46	0.10	1.02	0.79	0.79	0.17	2.25	1.10	1.10	0.24	5.37	1.42	1.42	0.30	8.75	1.74	1.74	0.37	12.41
			19	-	-	-	-	0.79	0.79	0.17	2.29	1.10	1.10	0.24	5.39	1.42	1.42	0.31	8.77	1.74	1.74	0.37	12.44
			20	-	-	-	-	0.90	0.74	0.19	3.19	1.14	1.08	0.24	5.88	1.43	1.42	0.31	8.81	1.74	1.74	0.38	12.46
	5	15	0.30	0.30	0.05	0.52	0.67	0.67	0.11	1.17	0.99	0.99	0.17	2.29	1.29	1.29	0.22	4.70	1.61	1.61	0.28	7.44	
		17	0.30	0.30	0.05	0.52	0.67	0.67	0.12	1.17	0.99	0.99	0.17	2.30	1.29	1.29	0.22	4.71	1.61	1.61	0.28	7.46	
		19	-	-	-	-	0.67	0.66	0.12	1.17	0.99	0.99	0.17	2.31	1.29	1.29	0.22	4.73	1.61	1.61	0.28	7.48	
		20	-	-	-	-	0.71	0.64	0.12	1.24	1.00	0.98	0.17	2.37	1.29	1.29	0.22	4.73	1.62	1.62	0.28	7.49	
	6	15	-	-	-	-	0.52	0.52	0.07	0.74	0.87	0.87	0.12	1.25	1.18	1.18	0.17	2.29	1.48	1.48	0.21	4.22	
		17	-	-	-	-	0.52	0.52	0.07	0.74	0.87	0.87	0.12	1.25	1.18	1.18	0.17	2.30	1.48	1.48	0.21	4.24	
		19	-	-	-	-	0.52	0.52	0.07	0.74	0.87	0.87	0.12	1.26	1.18	1.18	0.17	2.31	1.48	1.48	0.21	4.25	
		20	-	-	-	-	0.52	0.51	0.08	0.75	0.87	0.87	0.12	1.26	1.18	1.18	0.17	2.31	1.48	1.48	0.21	4.26	

MDKH1-V500-R3																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
5	3	15	3.54	2.67	1.02	75.70	3.52	3.05	1.02	74.93	3.58	3.43	1.04	77.25	3.81	3.81	1.09	85.07	4.18	4.18	1.20	100.04
		17	4.66	2.68	1.35	121.81	4.64	3.06	1.34	120.95	4.62	3.44	1.34	121.52	4.58	3.80	1.32	117.87	4.57	4.17	1.32	117.89
		19	-	-	-	-	5.84	3.07	1.68	180.03	5.80	3.45	1.67	178.34	5.77	3.82	1.67	176.69	5.74	4.18	1.66	175.03
		20	-	-	-	-	6.47	3.08	1.87	215.79	6.44	3.45	1.86	213.78	6.40	3.82	1.85	211.81	6.37	4.19	1.84	209.83
	4	15	3.17	2.50	0.68	37.20	3.21	2.89	0.69	38.00	3.36	3.29	0.72	41.33	3.67	3.67	0.79	48.09	4.04	4.04	0.87	57.38
		17	4.32	2.52	0.93	64.37	4.30	2.90	0.93	63.74	4.28	3.28	0.92	63.13	4.25	3.65	0.92	62.59	4.31	4.03	0.93	63.92
		19	-	-	-	-	5.51	2.92	1.19	98.53	5.49	3.30	1.19	97.61	5.46	3.67	1.18	96.70	5.42	4.03	1.17	94.65
		20	-	-	-	-	6.15	2.92	1.33	118.21	6.12	3.30	1.32	117.10	6.08	3.67	1.31	116.00	6.05	4.04	1.30	114.89
	5	15	2.79	2.32	0.48	20.45	2.92	2.72	0.50	22.04	3.17	3.13	0.54	25.29	3.52	3.52	0.61	30.62	3.90	3.90	0.67	36.44
		17	3.94	2.35	0.68	37.06	3.92	2.73	0.68	36.71	3.90	3.10	0.67	36.33	3.94	3.49	0.68	36.98	4.07	3.88	0.70	39.14
		19	-	-	-	-	5.15	2.75	0.89	58.59	5.13	3.13	0.88	58.20	5.10	3.50	0.88	57.66	5.07	3.87	0.87	57.13
		20	-	-	-	-	5.81	2.77	1.00	72.52	5.77	3.14	1.00	71.84	5.74	3.52	0.99	71.18	5.71	3.89	0.99	70.53
6	15	2.42	2.13	0.35	11.74	2.67	2.56	0.38	13.89	2.98	2.97	0.43	16.66	3.36	3.36	0.48	20.48	3.74	3.74	0.54	24.58	
	17	3.50	2.15	0.50	21.87	3.48	2.53	0.50	21.62	3.51	2.92	0.50	21.98	3.64	3.32	0.52	23.38	3.84	3.73	0.55	25.67	
	19	-	-	-	-	4.76	2.58	0.68	37.01	4.73	2.96	0.68	36.67	4.70	3.33	0.67	36.31	4.68	3.70	0.67	35.97	
	20	-	-	-	-	5.43	2.60	0.78	46.75	5.40	2.98	0.78	46.32	5.37	3.35	0.77	45.89	5.34	3.72	0.77	45.47	
7	3	15	2.69	2.28	0.77	45.86	2.79	2.67	0.80	48.91	3.06	3.06	0.88	57.92	3.44	3.44	1.00	71.36	3.81	3.81	1.11	85.32
		17	3.83	2.30	1.11	86.12	3.81	2.68	1.11	85.24	3.79	3.05	1.10	84.36	3.79	3.43	1.10	84.28	3.89	3.81	1.12	87.62
		19	-	-	-	-	5.01	2.69	1.45	136.65	4.98	3.06	1.44	135.32	4.96	3.44	1.44	134.71	4.94	3.81	1.44	134.66
		20	-	-	-	-	5.66	2.70	1.65	171.43	5.63	3.07	1.64	169.71	5.60	3.45	1.63	168.06	5.56	3.81	1.62	166.45
	4	15	2.36	2.11	0.51	22.25	2.58	2.53	0.55	25.84	2.92	2.92	0.63	32.34	3.30	3.30	0.71	39.44	3.67	3.67	0.80	48.00
		17	3.45	2.13	0.75	43.08	3.43	2.51	0.74	42.61	3.42	2.89	0.74	42.45	3.51	3.28	0.76	44.41	3.71	3.67	0.80	48.83
		19	-	-	-	-	4.66	2.53	1.01	72.33	4.63	2.91	1.00	71.63	4.61	3.28	1.00	70.93	4.58	3.65	0.99	70.21
		20	-	-	-	-	5.31	2.54	1.15	91.21	5.28	2.92	1.15	90.32	5.25	3.29	1.14	89.44	5.21	3.66	1.13	87.49
	5	15	2.07	1.94	0.36	12.09	2.38	2.37	0.41	15.40	2.76	2.76	0.48	19.79	3.15	3.15	0.54	24.73	3.53	3.53	0.61	30.30
		17	3.01	1.94	0.52	22.84	3.00	2.32	0.52	22.68	3.09	2.72	0.53	23.89	3.27	3.13	0.57	26.63	3.54	3.53	0.61	30.49
		19	-	-	-	-	4.27	2.36	0.74	42.02	4.24	2.74	0.73	41.59	4.25	3.21	0.73	53.50	4.20	3.49	0.72	40.59
		20	-	-	-	-	4.92	2.37	0.85	53.25	4.89	2.75	0.84	52.74	4.86	3.13	0.84	52.23	4.83	3.50	0.83	51.72
6	15	1.82	1.77	0.26	6.33	2.19	2.19	0.31	9.63	2.60	2.60	0.37	12.99	2.99	2.99	0.43	16.54	3.38	3.38	0.48	20.38	
	17	2.48	1.72	0.36	11.97	2.58	2.13	0.37	12.86	2.79	2.56	0.40	14.64	3.05	2.98	0.44	17.12	3.38	3.38	0.49	20.43	
	19	-	-	-	-	3.83	2.18	0.55	25.28	3.80	2.56	0.55	25.02	3.79	2.94	0.55	24.89	3.87	3.33	0.56	25.75	
	20	-	-	-	-	4.50	2.20	0.64	33.16	4.47	2.58	0.64	32.84	4.45	2.95	0.64	32.51	4.42	3.32	0.63	32.16	
9	3	15	1.97	1.91	0.57	26.56	2.30	2.30	0.66	34.60	2.69	2.69	0.78	45.77	3.06	3.06	0.88	56.68	3.44	3.44	1.00	70.24
		17	2.92	1.90	0.84	52.05	2.90	2.28	0.83	51.38	2.94	2.67	0.85	52.63	3.10	3.06	0.89	58.00	3.44	3.44	1.00	70.43
		19	-	-	-	-	4.12	2.30	1.19	95.32	4.10	2.68	1.18	94.32	4.08	3.05	1.18	94.31	4.05	3.42	1.18	93.83
		20	-	-	-	-	4.77	2.31	1.39	125.23	4.75	2.69	1.38	123.98	4.72	3.06	1.38	122.71	4.68	3.43	1.35	119.54
	4	15	1.76	1.75	0.38	13.45	2.15	2.15	0.46	18.78	2.54	2.54	0.55	25.09	2.92	2.92	0.63	31.56	3.30	3.30	0.71	38.90
		17	2.48	1.72	0.54	24.08	2.52	2.11	0.55	24.67	2.68	2.52	0.58	27.40	2.93	2.92	0.63	31.78	3.30	3.30	0.71	39.00
		19	-	-	-	-	3.73	2.13	0.80	48.03	3.70	2.51	0.80	47.52	3.68	2.89	0.79	46.98	3.71	3.27	0.80	47.76
		20	-	-	-	-	4.38	2.15	0.94	63.62	4.35	2.52	0.94	62.98	4.33	2.90	0.93	62.32	4.30	3.27	0.93	61.68
	5	15	1.57	1.56	0.27	7.01	1.98	1.98	0.34	11.06	2.38	2.38	0.41	15.19	2.77	2.77	0.48	19.58	3.15	3.15	0.54	24.43
		17	1.98	1.51	0.34	11.02	2.18	1.94	0.37	12.95	2.44	2.37	0.42	15.76	2.77	2.77	0.48	19.61	3.16	3.16	0.54	24.49
		19	-	-	-	-	3.28	1.95	0.56	26.04	3.25	2.33	0.56	25.71	3.29	2.72	0.57	26.25	3.42	3.12	0.59	28.21
		20	-	-	-	-	3.96	1.98	0.68	36.19	3.93	2.36	0.68	35.81	3.91	2.73	0.67	35.43	3.90	3.11	0.67	35.27
6	15	1.42	1.42	0.20	3.35	1.80	1.80	0.26	6.33	2.21	2.21	0.32	9.71	2.61	2.61	0.37	12.91	3.00	3.00	0.43	16.36	
	17	1.59	1.33	0.23	4.61	1.88	1.77	0.27	7.03	2.22	2.21	0.32	9.84	2.61	2.61	0.37	12.94	3.00	3.00	0.43	16.40	
	19	-	-	-	-	2.74	1.75	0.39	13.97	2.79	2.14	0.40	14.39	2.94	2.56	0.42	15.81	3.16	2.97	0.45	17.87	
	20	-	-	-	-	3.46	1.78	0.50	20.87	3.44	2.17	0.49	20.64	3.43	2.55	0.49	20.54	3.52	2.94	0.51	21.46	

Continued:

MDKH1-V500-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.53	1.53	0.44	16.63	1.92	1.92	0.55	24.65	2.31	2.31	0.66	34.00	2.69	2.69	0.77	43.94	3.06	3.06	0.88	55.17	
		17	1.92	1.49	0.55	24.59	2.05	1.90	0.59	27.77	2.31	2.31	0.66	34.14	2.69	2.69	0.77	44.06	3.06	3.06	0.88	55.31	
		19	-	-	-	-	3.16	1.90	0.90	58.15	3.13	2.28	0.90	57.46	3.13	2.66	0.90	57.31	3.23	3.05	0.92	60.52	
		20	-	-	-	-	3.82	1.92	1.10	82.17	3.78	2.30	1.08	79.93	3.76	2.67	1.08	79.05	3.73	3.04	1.07	78.04	
	4	15	1.35	1.35	0.29	8.21	1.76	1.76	0.38	12.97	2.16	2.16	0.46	18.32	2.54	2.54	0.55	24.30	2.92	2.92	0.63	31.05	
		17	1.52	1.32	0.33	10.11	1.81	1.75	0.39	13.55	2.16	2.16	0.46	18.34	2.55	2.55	0.55	24.36	2.93	2.93	0.63	31.13	
		19	-	-	-	-	2.70	1.73	0.58	26.87	2.70	2.11	0.58	26.85	2.81	2.52	0.60	28.86	3.01	2.92	0.65	32.62	
		20	-	-	-	-	3.37	1.75	0.72	39.49	3.35	2.13	0.72	39.03	3.33	2.51	0.72	38.82	3.37	2.89	0.72	39.42	
	5	15	1.19	1.19	0.20	3.52	1.58	1.58	0.27	7.30	2.00	2.00	0.34	11.03	2.39	2.39	0.41	15.02	2.78	2.78	0.48	19.41	
		17	1.24	1.15	0.21	3.97	1.59	1.58	0.27	7.36	2.00	2.00	0.34	11.05	2.40	2.40	0.41	15.06	2.78	2.78	0.48	19.46	
		19	-	-	-	-	2.16	1.53	0.37	12.61	2.31	1.94	0.40	13.97	2.54	2.37	0.44	16.59	2.82	2.78	0.49	19.85	
		20	-	-	-	-	2.88	1.56	0.50	20.58	2.86	1.94	0.49	20.28	2.91	2.34	0.50	20.97	3.06	2.75	0.53	22.88	
	6	15	1.04	1.04	0.15	1.70	1.42	1.42	0.20	3.54	1.81	1.81	0.26	6.52	2.22	2.22	0.32	9.62	2.62	2.62	0.37	12.73	
		17	1.06	1.03	0.15	1.74	1.42	1.42	0.20	3.54	1.81	1.81	0.26	6.54	2.22	2.22	0.32	9.64	2.62	2.62	0.38	12.76	
		19	-	-	-	-	1.67	1.32	0.24	5.38	1.96	1.77	0.28	7.70	2.28	2.21	0.33	10.08	2.63	2.63	0.38	12.83	
		20	-	-	-	-	2.23	1.33	0.32	9.64	2.32	1.74	0.33	10.35	2.53	2.17	0.36	11.97	2.78	2.59	0.40	14.06	
	13	3	15	1.13	1.13	0.32	9.93	1.53	1.53	0.44	16.71	1.93	1.93	0.55	24.66	2.31	2.31	0.66	33.29	2.68	2.68	0.77	43.59
			17	1.15	1.13	0.33	10.22	1.54	1.54	0.44	16.74	1.93	1.93	0.55	24.72	2.31	2.31	0.66	33.38	2.69	2.69	0.78	44.05
			19	-	-	-	-	2.07	1.50	0.59	27.67	2.16	1.90	0.62	29.67	2.36	2.30	0.67	34.67	2.69	2.69	0.77	43.79
			20	-	-	-	-	2.76	1.52	0.80	46.04	2.74	1.90	0.79	45.46	2.75	2.28	0.79	45.58	2.86	2.68	0.82	48.63
		4	15	0.95	0.95	0.21	3.67	1.36	1.36	0.29	8.23	1.77	1.77	0.38	12.85	2.16	2.16	0.47	18.31	2.55	2.55	0.55	24.24
			17	0.95	0.95	0.21	3.67	1.36	1.36	0.29	8.25	1.77	1.77	0.38	12.88	2.17	2.17	0.47	18.35	2.55	2.55	0.55	24.30
			19	-	-	-	-	1.62	1.32	0.35	11.06	1.87	1.75	0.40	14.16	2.18	2.17	0.47	18.54	2.55	2.55	0.55	24.37
			20	-	-	-	-	2.24	1.33	0.48	19.37	2.26	1.72	0.49	19.64	2.41	2.13	0.52	21.95	2.63	2.54	0.57	25.61
5		15	0.80	0.80	0.14	1.48	1.19	1.19	0.20	3.63	1.59	1.59	0.27	7.32	2.00	2.00	0.34	10.84	2.40	2.40	0.41	14.87	
		17	0.80	0.80	0.14	1.48	1.19	1.19	0.20	3.64	1.59	1.59	0.27	7.34	2.00	2.00	0.34	10.86	2.40	2.40	0.41	14.90	
		19	-	-	-	-	1.27	1.14	0.22	4.37	1.62	1.59	0.28	7.58	2.01	2.00	0.34	10.88	2.41	2.41	0.41	14.94	
		20	-	-	-	-	1.59	1.10	0.27	7.29	1.84	1.54	0.32	9.34	2.12	1.98	0.36	11.92	2.43	2.40	0.42	15.21	
6		15	0.61	0.61	0.09	0.92	1.05	1.05	0.15	1.67	1.42	1.42	0.20	3.66	1.82	1.82	0.26	6.69	2.24	2.24	0.32	9.65	
		17	0.61	0.61	0.09	0.92	1.05	1.05	0.15	1.68	1.43	1.43	0.20	3.67	1.83	1.83	0.26	6.71	2.24	2.24	0.32	9.67	
		19	-	-	-	-	1.08	1.02	0.15	1.78	1.43	1.43	0.20	3.70	1.83	1.83	0.26	6.73	2.24	2.24	0.32	9.69	
		20	-	-	-	-	1.21	0.95	0.17	2.38	1.51	1.38	0.22	4.33	1.87	1.82	0.27	6.99	2.25	2.25	0.32	9.72	
15		3	15	0.72	0.72	0.20	3.72	1.13	1.13	0.32	9.69	1.54	1.54	0.44	16.51	1.92	1.92	0.55	23.95	2.30	2.30	0.66	32.76
			17	0.72	0.72	0.20	3.73	1.13	1.13	0.32	9.71	1.54	1.54	0.44	16.55	1.92	1.92	0.55	24.01	2.31	2.31	0.66	32.84
			19	-	-	-	-	1.18	1.12	0.34	10.39	1.54	1.53	0.44	16.53	1.93	1.93	0.55	24.08	2.31	2.31	0.66	32.93
			20	-	-	-	-	1.56	1.10	0.45	16.95	1.71	1.51	0.49	19.84	1.96	1.92	0.56	24.73	2.31	2.31	0.66	32.95
		4	15	0.56	0.56	0.12	1.23	0.95	0.95	0.20	3.77	1.37	1.37	0.29	8.20	1.78	1.78	0.38	12.88	2.16	2.16	0.46	17.88
			17	0.56	0.56	0.12	1.23	0.96	0.96	0.20	3.78	1.37	1.37	0.29	8.22	1.78	1.78	0.38	12.91	2.17	2.17	0.46	17.92
			19	-	-	-	-	0.96	0.96	0.21	3.81	1.37	1.37	0.29	8.24	1.78	1.78	0.38	12.95	2.17	2.17	0.47	17.97
			20	-	-	-	-	1.08	0.91	0.23	5.18	1.43	1.36	0.31	8.78	1.78	1.78	0.38	12.98	2.17	2.17	0.47	18.00
	5	15	0.36	0.36	0.06	0.62	0.81	0.81	0.14	1.47	1.20	1.20	0.21	3.87	1.61	1.61	0.28	7.41	2.01	2.01	0.35	10.86	
		17	0.36	0.36	0.06	0.62	0.81	0.81	0.14	1.47	1.20	1.20	0.21	3.88	1.61	1.61	0.28	7.43	2.01	2.01	0.35	10.88	
		19	-	-	-	-	0.81	0.81	0.14	1.47	1.20	1.20	0.21	3.90	1.61	1.61	0.28	7.45	2.02	2.02	0.35	10.91	
		20	-	-	-	-	0.85	0.78	0.15	1.61	1.20	1.19	0.21	3.95	1.61	1.61	0.28	7.45	2.02	2.02	0.35	10.92	
	6	15	-	-	-	-	0.62	0.62	0.09	0.89	1.05	1.05	0.15	1.72	1.43	1.43	0.21	3.89	1.84	1.84	0.26	6.81	
		17	-	-	-	-	0.62	0.62	0.09	0.89	1.05	1.05	0.15	1.72	1.43	1.43	0.21	3.90	1.84	1.84	0.26	6.83	
		19	-	-	-	-	0.62	0.62	0.09	0.89	1.06	1.06	0.15	1.73	1.43	1.43	0.21	3.91	1.85	1.85	0.27	6.85	
		20	-	-	-	-	0.63	0.62	0.09	0.90	1.06	1.05	0.15	1.73	1.44	1.44	0.21	3.92	1.85	1.85	0.27	6.86	

MDKH1-V700-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
5	3	15	4.21	3.24	1.21	51.98	4.20	3.71	1.20	51.61	4.32	4.20	1.24	54.33	4.68	4.68	1.35	63.22	5.14	5.14	1.49	74.55	
		17	5.62	3.25	1.61	85.97	5.59	3.73	1.60	85.18	5.56	4.19	1.60	84.38	5.53	4.66	1.59	83.64	5.53	5.12	1.59	83.60	
		19	-	-	-	-	7.09	3.74	2.04	129.79	7.06	4.21	2.03	128.60	7.03	4.68	2.03	128.47	7.00	5.14	2.03	128.46	
		20	-	-	-	-	7.88	3.74	2.27	156.52	7.85	4.22	2.26	155.18	7.81	4.68	2.25	153.93	7.77	5.15	2.24	152.59	
	4	15	3.68	2.99	0.79	24.90	3.77	3.48	0.81	26.05	4.03	3.99	0.87	29.23	4.47	4.47	0.96	34.85	4.93	4.93	1.06	41.37	
		17	5.12	3.02	1.10	44.07	5.09	3.49	1.09	43.66	5.07	3.96	1.09	43.26	5.06	4.43	1.09	43.12	5.17	4.92	1.11	44.81	
		19	-	-	-	-	6.61	3.51	1.42	68.66	6.57	3.99	1.41	68.06	6.54	4.45	1.41	67.46	6.51	4.92	1.40	66.87	
		20	-	-	-	-	7.41	3.52	1.59	83.90	7.37	4.00	1.59	83.17	7.34	4.46	1.58	82.45	7.30	4.93	1.57	81.74	
	5	15	3.15	2.73	0.54	13.01	3.41	3.26	0.59	15.02	3.78	3.77	0.65	17.90	4.25	4.25	0.73	21.70	4.72	4.72	0.81	26.00	
		17	4.56	2.77	0.78	24.44	4.53	3.24	0.78	24.21	4.52	3.72	0.77	24.06	4.62	4.21	0.79	25.05	4.84	4.71	0.83	27.19	
		19	-	-	-	-	6.10	3.29	1.05	40.67	6.07	3.76	1.05	40.31	6.04	4.23	1.04	39.95	6.00	4.69	1.04	39.60	
		20	-	-	-	-	6.91	3.30	1.19	50.51	6.86	3.77	1.18	49.56	6.83	4.24	1.17	49.14	6.80	4.70	1.17	48.72	
6	15	2.69	2.47	0.39	6.77	3.06	3.01	0.44	8.99	3.53	3.53	0.51	11.64	4.02	4.02	0.58	14.53	4.50	4.50	0.64	17.48		
	17	3.93	2.50	0.56	13.95	3.91	2.97	0.56	13.81	4.02	3.47	0.58	14.46	4.24	3.99	0.61	15.89	4.55	4.49	0.65	17.84		
	19	-	-	-	-	5.51	3.03	0.79	24.69	5.48	3.50	0.78	24.47	5.45	3.97	0.78	24.25	5.44	4.44	0.78	24.14		
	20	-	-	-	-	6.35	3.06	0.91	31.72	6.32	3.53	0.91	31.44	6.29	4.00	0.90	31.16	6.26	4.47	0.90	30.89		
7	3	15	3.18	2.76	0.92	31.92	3.35	3.26	0.97	35.05	3.74	3.74	1.07	41.86	4.21	4.21	1.22	51.79	4.68	4.68	1.35	62.03	
		17	4.57	2.77	1.31	59.30	4.55	3.25	1.31	58.81	4.52	3.72	1.30	58.46	4.55	4.19	1.31	58.81	4.74	4.68	1.37	63.39	
		19	-	-	-	-	6.07	3.27	1.76	98.75	6.03	3.74	1.75	97.82	6.00	4.21	1.74	96.92	5.96	4.67	1.72	94.55	
		20	-	-	-	-	6.86	3.27	2.00	122.90	6.83	3.75	1.99	121.84	6.79	4.21	1.98	120.75	6.76	4.68	1.97	119.65	
	4	15	2.74	2.53	0.59	15.01	3.06	3.04	0.66	18.01	3.53	3.53	0.76	22.94	4.00	4.00	0.86	28.52	4.48	4.48	0.97	34.89	
		17	4.02	2.53	0.86	28.68	4.01	3.01	0.87	28.79	4.02	3.49	0.87	29.01	4.19	3.99	0.91	31.10	4.49	4.48	0.97	35.12	
		19	-	-	-	-	5.54	3.04	1.20	50.49	5.51	3.51	1.19	50.04	5.48	3.98	1.19	49.56	5.45	4.45	1.18	49.07	
		20	-	-	-	-	6.35	3.05	1.37	63.67	6.32	3.52	1.37	63.38	6.28	3.99	1.36	62.81	6.25	4.46	1.35	62.25	
	5	15	2.34	2.27	0.40	7.62	2.80	2.80	0.48	10.55	3.30	3.30	0.57	13.93	3.79	3.79	0.65	17.60	4.26	4.26	0.73	21.56	
		17	3.38	2.26	0.58	14.50	3.40	2.75	0.58	14.62	3.58	3.26	0.62	16.04	3.87	3.77	0.67	18.25	4.27	4.26	0.73	21.60	
		19	-	-	-	-	4.98	2.80	0.86	28.28	4.95	3.27	0.86	28.01	4.94	4.08	0.85	44.70	4.94	4.22	0.85	27.95	
		20	-	-	-	-	5.78	2.81	1.00	36.42	5.75	3.29	0.99	36.09	5.72	3.76	0.99	35.76	5.69	4.22	0.98	35.43	
6	15	2.10	2.08	0.30	3.67	2.55	2.55	0.36	6.07	3.05	3.05	0.44	8.90	3.55	3.55	0.51	11.54	4.04	4.04	0.58	14.35		
	17	2.62	1.95	0.38	6.51	2.84	2.48	0.41	7.79	3.18	3.02	0.46	9.55	3.58	3.55	0.51	11.67	4.04	4.04	0.58	14.39		
	19	-	-	-	-	4.32	2.53	0.62	16.03	4.29	3.00	0.61	15.85	4.31	3.49	0.62	16.04	4.47	3.99	0.64	17.09		
	20	-	-	-	-	5.18	2.56	0.74	21.96	5.15	3.04	0.74	21.75	5.12	3.51	0.74	21.54	5.10	3.98	0.73	21.38		
9	3	15	2.33	2.30	0.67	18.28	2.79	2.79	0.80	24.89	3.27	3.27	0.94	32.70	3.74	3.74	1.08	41.33	4.21	4.21	1.22	51.12	
		17	3.43	2.28	0.99	35.50	3.41	2.76	0.98	35.07	3.50	3.25	1.01	36.76	3.77	3.75	1.09	42.37	4.22	4.22	1.22	51.12	
		19	-	-	-	-	4.93	2.78	1.42	66.90	4.91	3.25	1.41	66.25	4.88	3.72	1.41	65.58	4.85	4.19	1.40	64.99	
		20	-	-	-	-	5.75	2.79	1.67	88.62	5.71	3.27	1.66	87.51	5.69	3.74	1.65	86.94	5.64	4.20	1.63	84.73	
	4	15	2.06	2.06	0.44	9.05	2.57	2.57	0.56	13.29	3.06	3.06	0.66	17.76	3.54	3.54	0.76	22.83	4.01	4.01	0.86	28.17	
		17	2.79	2.02	0.60	15.11	2.89	2.53	0.62	16.10	3.16	3.04	0.68	18.76	3.54	3.54	0.76	22.87	4.01	4.01	0.86	28.24	
		19	-	-	-	-	4.36	2.55	0.94	32.58	4.34	3.02	0.93	32.25	4.31	3.49	0.93	31.95	4.40	3.98	0.95	33.11	
		20	-	-	-	-	5.19	2.57	1.13	44.47	5.16	3.04	1.12	44.03	5.14	3.51	1.11	43.60	5.10	3.98	1.11	43.15	
	5	15	1.82	1.82	0.31	4.19	2.32	2.32	0.40	7.46	2.82	2.82	0.49	10.53	3.32	3.32	0.57	13.97	3.80	3.80	0.65	17.45	
		17	2.12	1.74	0.37	6.21	2.45	2.29	0.42	8.28	2.85	2.82	0.49	10.70	3.33	3.33	0.57	13.99	3.80	3.80	0.65	17.49	
		19	-	-	-	-	3.71	2.29	0.64	16.74	3.69	2.77	0.64	16.57	3.80	3.27	0.65	17.42	4.02	3.77	0.69	19.21	
		20	-	-	-	-	4.57	2.32	0.79	23.87	4.54	2.80	0.78	23.63	4.51	3.27	0.78	23.36	4.53	3.75	0.78	23.57	
6	15	1.64	1.64	0.24	1.99	2.09	2.09	0.30	3.76	2.57	2.57	0.37	6.34	3.08	3.08	0.44	8.92	3.58	3.58	0.51	11.49		
	17	1.78	1.56	0.26	2.44	2.13	2.07	0.31	3.96	2.57	2.57	0.37	6.36	3.08	3.08	0.44	8.94	3.58	3.58	0.51	11.51		
	19	-	-	-	-	2.91	1.99	0.42	8.05	3.07	2.51	0.44	8.83	3.35	3.04	0.48	10.24	3.68	3.56	0.53	12.08		
	20	-	-	-	-	3.85	2.05	0.55	13.01	3.82	2.52	0.55	12.84	3.86	3.01	0.55	13.05	4.04	3.52	0.58	14.10		

Continued:

MDKH1-V700-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.82	1.82	0.52	11.64	2.31	2.31	0.66	17.56	2.80	2.80	0.80	24.35	3.27	3.27	0.93	31.92	3.75	3.75	1.08	40.88	
		17	2.19	1.78	0.62	15.96	2.42	2.30	0.69	18.90	2.80	2.79	0.80	24.37	3.28	3.28	0.94	32.00	3.75	3.75	1.08	40.97	
		19	-	-	-	-	3.73	2.30	1.07	40.55	3.71	2.77	1.07	40.07	3.72	3.25	1.07	40.39	3.89	3.74	1.11	42.98	
		20	-	-	-	-	4.53	2.30	1.30	56.17	4.50	2.78	1.29	55.58	4.48	3.25	1.28	55.00	4.46	3.72	1.28	55.03	
	4	15	1.56	1.56	0.33	5.12	2.08	2.08	0.45	8.96	2.58	2.58	0.55	12.93	3.07	3.07	0.66	17.37	3.54	3.54	0.76	22.27	
		17	1.68	1.53	0.36	6.03	2.10	2.08	0.45	9.10	2.58	2.58	0.55	12.95	3.07	3.07	0.66	17.40	3.55	3.55	0.76	22.32	
		19	-	-	-	-	3.06	2.04	0.66	17.26	3.10	2.53	0.66	17.62	3.29	3.04	0.71	19.61	3.60	3.55	0.77	22.86	
		20	-	-	-	-	3.92	2.07	0.84	26.49	3.89	2.54	0.83	26.07	3.87	3.02	0.83	25.82	3.97	3.51	0.85	27.01	
	5	15	1.38	1.38	0.24	2.07	1.84	1.84	0.32	4.45	2.34	2.34	0.40	7.55	2.85	2.85	0.49	10.51	3.33	3.33	0.57	13.64	
		17	1.41	1.36	0.24	2.19	1.84	1.83	0.32	4.46	2.35	2.35	0.40	7.57	2.85	2.85	0.49	10.53	3.34	3.34	0.57	13.67	
		19	-	-	-	-	2.32	1.76	0.40	7.41	2.60	2.30	0.45	8.98	2.95	2.83	0.51	11.13	3.35	3.34	0.57	13.74	
		20	-	-	-	-	3.18	1.80	0.55	12.55	3.18	2.29	0.55	12.63	3.31	2.79	0.57	13.45	3.57	3.31	0.61	15.43	
	6	15	1.17	1.17	0.17	1.19	1.65	1.65	0.24	2.08	2.10	2.10	0.30	3.98	2.60	2.60	0.37	6.46	3.10	3.10	0.44	8.84	
		17	1.17	1.17	0.17	1.19	1.65	1.65	0.24	2.08	2.11	2.11	0.30	4.00	2.60	2.60	0.37	6.48	3.11	3.11	0.44	8.86	
		19	-	-	-	-	1.84	1.55	0.26	2.80	2.19	2.07	0.31	4.43	2.62	2.60	0.37	6.58	3.11	3.11	0.44	8.87	
		20	-	-	-	-	2.27	1.48	0.33	4.85	2.48	2.01	0.35	5.90	2.83	2.55	0.40	7.53	3.21	3.09	0.46	9.34	
	13	3	15	1.32	1.32	0.38	6.74	1.83	1.83	0.53	11.74	2.32	2.32	0.67	17.65	2.80	2.80	0.81	24.39	3.27	3.27	0.94	31.52
			17	1.32	1.32	0.38	6.77	1.83	1.83	0.53	11.77	2.33	2.33	0.67	17.68	2.81	2.81	0.81	24.45	3.28	3.28	0.94	31.59
			19	-	-	-	-	2.38	1.79	0.68	18.36	2.54	2.30	0.73	20.50	2.84	2.81	0.82	24.89	3.28	3.28	0.94	31.67
			20	-	-	-	-	3.21	1.81	0.92	30.35	3.18	2.28	0.91	29.91	3.22	2.77	0.92	30.60	3.42	3.27	0.98	33.95
		4	15	1.11	1.11	0.24	2.14	1.58	1.58	0.34	5.34	2.09	2.09	0.45	8.93	2.59	2.59	0.56	12.82	3.08	3.08	0.66	17.38
			17	1.11	1.11	0.24	2.14	1.58	1.58	0.34	5.35	2.10	2.10	0.45	8.95	2.59	2.59	0.56	12.85	3.08	3.08	0.66	17.42
			19	-	-	-	-	1.78	1.54	0.38	6.75	2.16	2.08	0.46	9.40	2.60	2.59	0.56	12.86	3.09	3.09	0.67	17.46
			20	-	-	-	-	2.45	1.54	0.53	11.65	2.53	2.04	0.54	12.34	2.80	2.57	0.60	14.73	3.13	3.08	0.67	17.89
5		15	0.90	0.90	0.15	1.05	1.38	1.38	0.24	2.12	1.84	1.84	0.32	4.59	2.36	2.36	0.40	7.47	2.86	2.86	0.49	10.35	
		17	0.90	0.90	0.15	1.05	1.38	1.38	0.24	2.12	1.85	1.85	0.32	4.61	2.36	2.36	0.41	7.48	2.86	2.86	0.49	10.37	
		19	-	-	-	-	1.43	1.34	0.25	2.35	1.85	1.85	0.32	4.64	2.36	2.36	0.41	7.50	2.87	2.87	0.49	10.39	
		20	-	-	-	-	1.67	1.26	0.29	3.56	2.01	1.80	0.34	5.58	2.43	2.35	0.42	7.84	2.87	2.87	0.49	10.42	
6		15	0.66	0.66	0.09	0.63	1.18	1.18	0.17	1.13	1.66	1.66	0.24	2.14	2.11	2.11	0.30	4.13	2.62	2.62	0.38	6.53	
		17	0.66	0.66	0.09	0.63	1.18	1.18	0.17	1.14	1.66	1.66	0.24	2.15	2.12	2.12	0.30	4.14	2.62	2.62	0.38	6.55	
		19	-	-	-	-	1.19	1.17	0.17	1.15	1.66	1.65	0.24	2.15	2.12	2.12	0.30	4.16	2.63	2.63	0.38	6.56	
		20	-	-	-	-	1.32	1.10	0.19	1.29	1.71	1.62	0.24	2.35	2.13	2.12	0.30	4.20	2.63	2.63	0.38	6.57	
15		3	15	0.83	0.83	0.24	2.16	1.33	1.33	0.38	6.62	1.83	1.83	0.52	11.47	2.33	2.33	0.67	17.45	2.80	2.80	0.80	23.73
			17	0.83	0.83	0.24	2.17	1.33	1.33	0.38	6.63	1.84	1.84	0.52	11.49	2.33	2.33	0.67	17.48	2.81	2.81	0.80	23.78
			19	-	-	-	-	1.35	1.32	0.38	6.81	1.84	1.83	0.52	11.49	2.33	2.33	0.67	17.53	2.81	2.81	0.80	23.84
			20	-	-	-	-	1.71	1.29	0.49	10.16	1.97	1.81	0.56	12.98	2.35	2.33	0.67	17.69	2.81	2.81	0.80	23.87
		4	15	0.62	0.62	0.13	0.87	1.11	1.11	0.24	2.20	1.59	1.59	0.34	5.49	2.11	2.11	0.45	8.89	2.60	2.60	0.56	12.86
			17	0.62	0.62	0.13	0.87	1.11	1.11	0.24	2.20	1.60	1.60	0.34	5.50	2.11	2.11	0.45	8.90	2.61	2.61	0.56	12.89
			19	-	-	-	-	1.11	1.10	0.24	2.19	1.60	1.60	0.34	5.52	2.11	2.11	0.45	8.93	2.61	2.61	0.56	12.92
			20	-	-	-	-	1.19	1.06	0.26	2.68	1.62	1.59	0.35	5.65	2.11	2.11	0.45	8.92	2.61	2.61	0.56	12.94
	5	15	0.37	0.37	0.06	0.41	0.91	0.91	0.16	1.02	1.39	1.39	0.24	2.26	1.87	1.87	0.32	4.85	2.38	2.38	0.41	7.53	
		17	0.37	0.37	0.06	0.41	0.91	0.91	0.16	1.02	1.39	1.39	0.24	2.26	1.87	1.87	0.32	4.86	2.38	2.38	0.41	7.54	
		19	-	-	-	-	0.91	0.91	0.16	1.02	1.39	1.39	0.24	2.27	1.87	1.87	0.32	4.87	2.39	2.39	0.41	7.56	
		20	-	-	-	-	0.93	0.90	0.16	1.04	1.39	1.39	0.24	2.27	1.87	1.87	0.32	4.88	2.39	2.39	0.41	7.57	
	6	15	-	-	-	-	0.67	0.67	0.10	0.61	1.20	1.20	0.17	1.11	1.66	1.66	0.24	2.27	2.13	2.13	0.31	4.36	
		17	-	-	-	-	0.67	0.67	0.10	0.61	1.20	1.20	0.17	1.11	1.66	1.66	0.24	2.28	2.14	2.14	0.31	4.38	
		19	-	-	-	-	0.67	0.67	0.10	0.61	1.20	1.20	0.17	1.11	1.66	1.66	0.24	2.28	2.14	2.14	0.31	4.39	
		20	-	-	-	-	0.67	0.67	0.10	0.61	1.20	1.20	0.17	1.11	1.67	1.67	0.24	2.29	2.14	2.14	0.31	4.40	

MDKH1-V800-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	5.30	4.03	1.52	38.31	5.28	4.60	1.51	38.01	5.40	5.20	1.55	39.65	5.78	5.78	1.65	44.57	6.34	6.34	1.82	52.36	
		17	7.04	4.06	2.03	63.52	7.00	4.64	2.02	62.89	6.96	5.20	2.01	62.27	6.91	5.76	1.98	60.66	6.90	6.33	1.99	61.42	
		19	-	-	-	-	8.83	4.65	2.54	93.75	8.78	5.22	2.54	93.50	8.74	5.79	2.53	92.86	8.69	6.35	2.51	91.96	
		20	-	-	-	-	9.81	4.67	2.84	113.97	9.76	5.24	2.83	112.79	9.69	5.80	2.79	110.05	9.64	6.36	2.78	109.65	
	4	15	4.68	3.74	1.01	18.97	4.78	4.34	1.03	19.67	5.05	4.96	1.09	21.68	5.54	5.54	1.19	25.17	6.11	6.11	1.31	29.76	
		17	6.45	3.78	1.38	32.60	6.41	4.36	1.38	32.27	6.37	4.93	1.37	31.95	6.35	5.50	1.36	31.79	6.47	6.08	1.39	32.78	
		19	-	-	-	-	8.28	4.40	1.78	50.26	8.23	4.97	1.77	49.78	8.19	5.53	1.76	49.30	8.14	6.09	1.75	48.83	
		20	-	-	-	-	9.28	4.42	2.00	61.78	9.22	4.99	1.99	61.19	9.17	5.56	1.98	60.60	9.12	6.11	1.97	59.90	
	5	15	4.01	3.42	0.69	9.83	4.30	4.06	0.74	11.12	4.72	4.69	0.81	13.04	5.30	5.30	0.91	15.97	5.87	5.87	1.01	19.04	
		17	5.80	3.49	1.00	18.62	5.77	4.07	0.99	18.43	5.74	4.64	0.99	18.30	5.85	5.24	1.01	18.88	6.08	5.85	1.05	20.21	
		19	-	-	-	-	7.69	4.13	1.33	30.18	7.65	4.70	1.32	29.89	7.60	5.27	1.31	29.59	7.56	5.83	1.30	29.30	
		20	-	-	-	-	8.69	4.15	1.50	37.25	8.64	4.72	1.49	36.90	8.59	5.29	1.48	36.55	8.55	5.85	1.47	36.20	
6	15	3.53	3.15	0.51	4.75	3.90	3.79	0.56	6.20	4.41	4.41	0.63	8.29	5.02	5.02	0.72	10.60	5.61	5.61	0.80	12.86		
	17	5.01	3.14	0.72	10.56	4.98	3.72	0.71	10.45	5.10	4.34	0.73	10.89	5.36	4.97	0.77	11.90	5.72	5.59	0.82	13.27		
	19	-	-	-	-	7.00	3.82	1.00	18.58	6.96	4.40	1.00	18.39	6.92	4.97	0.99	18.21	6.89	5.53	0.99	18.11		
	20	-	-	-	-	8.03	3.86	1.15	23.50	7.98	4.43	1.14	23.27	7.94	5.00	1.14	23.05	7.89	5.57	1.13	22.82		
7	3	15	4.01	3.43	1.15	23.44	4.20	4.04	1.20	25.38	4.64	4.64	1.34	30.58	5.22	5.22	1.51	37.38	5.78	5.78	1.66	44.06	
		17	5.74	3.46	1.65	43.60	5.71	4.04	1.64	43.13	5.67	4.61	1.63	42.64	5.69	5.18	1.64	42.93	5.88	5.77	1.69	45.48	
		19	-	-	-	-	7.58	4.07	2.20	71.57	7.53	4.64	2.18	70.85	7.48	5.21	2.16	69.53	7.44	5.77	2.15	68.89	
		20	-	-	-	-	8.54	4.08	2.47	87.63	8.50	4.65	2.47	87.66	8.45	5.22	2.45	86.80	8.41	5.78	2.44	85.94	
	4	15	3.47	3.15	0.75	11.24	3.85	3.80	0.83	13.47	4.40	4.40	0.94	16.72	4.98	4.98	1.07	20.67	5.55	5.55	1.19	24.90	
		17	5.10	3.18	1.10	21.52	5.06	3.76	1.09	21.27	5.08	4.34	1.09	21.40	5.26	4.94	1.13	22.69	5.59	5.55	1.20	25.21	
		19	-	-	-	-	6.97	3.80	1.50	36.83	6.93	4.38	1.49	36.45	6.88	4.95	1.48	36.08	6.84	5.51	1.47	35.70	
		20	-	-	-	-	7.97	3.82	1.73	46.95	7.93	4.40	1.72	46.49	7.88	4.97	1.71	46.02	7.83	5.53	1.70	45.57	
	5	15	3.02	2.88	0.52	5.27	3.51	3.51	0.60	7.60	4.12	4.12	0.71	10.24	4.72	4.72	0.81	12.87	5.31	5.31	0.91	15.75	
		17	4.32	2.85	0.74	11.06	4.34	3.44	0.75	11.13	4.54	4.07	0.78	12.02	4.86	4.70	0.84	13.53	5.32	5.31	0.92	15.81	
		19	-	-	-	-	6.30	3.52	1.08	21.00	6.26	4.09	1.08	20.78	6.21	4.75	1.06	37.30	6.24	5.24	1.07	20.67	
		20	-	-	-	-	7.33	3.55	1.27	27.47	7.29	4.13	1.26	27.19	7.25	4.70	1.25	26.91	7.20	5.27	1.24	26.64	
6	15	2.76	2.69	0.40	2.58	3.27	3.27	0.47	4.06	3.84	3.84	0.55	6.14	4.44	4.44	0.64	8.42	5.04	5.04	0.72	10.51		
	17	3.48	2.50	0.50	4.80	3.69	3.14	0.53	5.59	4.04	3.79	0.58	6.93	4.49	4.43	0.64	8.61	5.05	5.05	0.72	10.53		
	19	-	-	-	-	5.52	3.19	0.79	12.22	5.48	3.77	0.78	12.07	5.51	4.36	0.79	12.17	5.70	4.98	0.82	13.12		
	20	-	-	-	-	6.59	3.25	0.95	16.57	6.55	3.82	0.94	16.39	6.51	4.40	0.93	16.21	6.48	4.96	0.93	16.08		
9	3	15	2.94	2.87	0.84	13.57	3.48	3.48	1.00	18.11	4.06	4.06	1.17	23.66	4.64	4.64	1.34	30.15	5.21	5.21	1.50	36.30	
		17	4.36	2.86	1.26	27.01	4.32	3.44	1.25	26.43	4.42	4.04	1.28	27.63	4.69	4.64	1.36	30.71	5.21	5.21	1.50	36.40	
		19	-	-	-	-	6.21	3.47	1.80	49.85	6.17	4.05	1.79	49.31	6.13	4.62	1.78	48.78	6.10	5.19	1.77	48.30	
		20	-	-	-	-	7.18	3.48	2.07	63.48	7.15	4.07	2.08	63.96	7.10	4.63	2.05	62.76	7.07	5.20	2.05	62.50	
	4	15	2.59	2.59	0.56	6.44	3.21	3.21	0.69	9.66	3.81	3.81	0.82	12.93	4.40	4.40	0.95	16.54	4.98	4.98	1.08	20.49	
		17	3.57	2.54	0.77	11.56	3.69	3.16	0.79	12.20	3.98	3.79	0.86	13.98	4.41	4.41	0.95	16.61	4.99	4.99	1.08	20.54	
		19	-	-	-	-	5.55	3.20	1.20	24.72	5.51	3.78	1.19	24.45	5.48	4.35	1.19	24.20	5.56	4.94	1.20	24.86	
		20	-	-	-	-	6.54	3.22	1.41	32.58	6.50	3.80	1.40	32.23	6.46	4.37	1.39	31.89	6.42	4.94	1.38	31.53	
	5	15	2.36	2.36	0.41	2.82	2.93	2.93	0.50	5.05	3.54	3.54	0.61	7.72	4.14	4.14	0.71	10.15	4.73	4.73	0.81	12.73	
		17	2.80	2.22	0.48	4.51	3.14	2.87	0.54	5.99	3.59	3.53	0.62	7.94	4.15	4.15	0.71	10.17	4.74	4.74	0.82	12.76	
		19	-	-	-	-	4.75	2.89	0.82	12.79	4.72	3.47	0.81	12.65	4.84	4.07	0.83	13.18	5.09	4.70	0.88	14.43	
		20	-	-	-	-	5.82	2.93	1.00	18.05	5.78	3.51	1.00	17.85	5.74	4.08	0.99	17.63	5.76	4.66	0.99	17.74	
6	15	2.14	2.14	0.31	1.55	2.72	2.72	0.39	2.54	3.28	3.28	0.47	4.22	3.86	3.86	0.55	6.36	4.47	4.47	0.64	8.43		
	17	2.40	2.02	0.34	1.88	2.81	2.66	0.40	2.79	3.29	3.28	0.47	4.26	3.87	3.87	0.55	6.38	4.48	4.48	0.64	8.46		
	19	-	-	-	-	3.77	2.51	0.54	6.04	3.94	3.14	0.57	6.65	4.26	3.79	0.61	7.74	4.65	4.44	0.67	9.03		
	20	-	-	-	-	4.95	2.60	0.71	10.01	4.91	3.18	0.70	9.87	4.95	3.77	0.71	10.00	5.14	4.39	0.74	10.69		

Continued:

MDKH1-V800-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	2.28	2.28	0.65	8.59	2.89	2.89	0.82	12.85	3.48	3.48	0.99	17.68	4.06	4.06	1.16	23.07	4.64	4.64	1.32	28.94	
		17	2.81	2.23	0.80	12.20	3.06	2.87	0.88	14.30	3.49	3.49	0.99	17.72	4.07	4.07	1.16	23.13	4.64	4.64	1.33	29.01	
		19	-	-	-	-	4.71	2.87	1.34	29.68	4.67	3.44	1.33	29.30	4.69	4.03	1.34	29.48	4.87	4.63	1.39	31.44	
		20	-	-	-	-	5.72	2.89	1.65	42.17	5.69	3.47	1.64	41.69	5.65	4.04	1.63	41.21	5.61	4.61	1.62	40.75	
	4	15	2.01	2.01	0.43	3.40	2.61	2.61	0.56	6.52	3.23	3.23	0.69	9.50	3.83	3.83	0.82	12.68	4.41	4.41	0.94	16.16	
		17	2.19	1.94	0.47	4.29	2.65	2.60	0.57	6.73	3.23	3.23	0.69	9.52	3.83	3.83	0.82	12.71	4.41	4.41	0.95	16.20	
		19	-	-	-	-	3.92	2.56	0.84	13.21	3.96	3.16	0.85	13.42	4.17	3.78	0.89	14.70	4.51	4.40	0.97	16.81	
		20	-	-	-	-	4.98	2.61	1.07	19.90	4.95	3.19	1.06	19.66	4.92	3.76	1.05	19.46	5.02	4.36	1.08	20.19	
	5	15	1.80	1.80	0.31	1.54	2.37	2.37	0.41	2.97	2.95	2.95	0.51	5.28	3.56	3.56	0.61	7.74	4.16	4.16	0.72	10.08	
		17	1.88	1.76	0.32	1.66	2.38	2.37	0.41	2.99	2.95	2.95	0.51	5.30	3.57	3.57	0.61	7.76	4.17	4.17	0.72	10.11	
		19	-	-	-	-	3.01	2.22	0.52	5.56	3.32	2.88	0.57	6.82	3.73	3.54	0.64	8.34	4.20	4.17	0.72	10.22	
		20	-	-	-	-	4.12	2.28	0.71	9.86	4.09	2.87	0.70	9.75	4.25	3.49	0.73	10.39	4.52	4.12	0.78	11.59	
	6	15	1.54	1.54	0.22	1.04	2.16	2.16	0.31	1.53	2.72	2.72	0.39	2.67	3.29	3.29	0.47	4.43	3.88	3.88	0.56	6.43	
		17	1.55	1.53	0.22	1.05	2.16	2.16	0.31	1.53	2.73	2.73	0.39	2.68	3.30	3.30	0.47	4.44	3.89	3.89	0.56	6.45	
		19	-	-	-	-	2.51	2.00	0.36	2.14	2.89	2.64	0.41	3.13	3.35	3.28	0.48	4.63	3.89	3.89	0.56	6.47	
		20	-	-	-	-	3.07	1.91	0.44	3.73	3.28	2.55	0.47	4.41	3.62	3.20	0.52	5.55	4.06	3.85	0.58	6.99	
	13	3	15	1.67	1.67	0.48	4.65	2.29	2.29	0.66	8.66	2.89	2.89	0.83	12.69	3.49	3.49	1.00	17.69	4.07	4.07	1.17	23.02
			17	1.68	1.67	0.48	4.74	2.30	2.30	0.66	8.68	2.90	2.90	0.83	12.72	3.49	3.49	1.00	17.73	4.07	4.07	1.17	23.08
			19	-	-	-	-	3.03	2.24	0.87	13.73	3.22	2.86	0.93	15.41	3.56	3.49	1.02	18.27	4.08	4.08	1.17	23.13
			20	-	-	-	-	4.10	2.27	1.18	23.31	4.06	2.86	1.17	22.97	4.10	3.45	1.18	23.32	4.30	4.05	1.24	25.36
		4	15	1.45	1.45	0.31	1.54	2.02	2.02	0.44	3.64	2.63	2.63	0.56	6.58	3.24	3.24	0.69	9.40	3.83	3.83	0.82	12.52
			17	1.45	1.44	0.31	1.54	2.02	2.02	0.44	3.65	2.63	2.63	0.56	6.60	3.24	3.24	0.69	9.43	3.84	3.84	0.82	12.55
			19	-	-	-	-	2.31	1.94	0.50	5.11	2.74	2.60	0.59	7.08	3.25	3.25	0.70	9.47	3.84	3.84	0.82	12.59
			20	-	-	-	-	3.17	1.94	0.68	9.04	3.26	2.56	0.70	9.50	3.54	3.20	0.76	10.96	3.93	3.83	0.84	13.06
5		15	1.18	1.18	0.20	0.92	1.81	1.81	0.31	1.52	2.37	2.37	0.41	3.06	2.96	2.96	0.51	5.37	3.58	3.58	0.61	7.61	
		17	1.18	1.18	0.20	0.92	1.81	1.81	0.31	1.52	2.37	2.37	0.41	3.07	2.96	2.96	0.51	5.39	3.58	3.58	0.61	7.63	
		19	-	-	-	-	1.92	1.74	0.33	1.75	2.40	2.36	0.41	3.15	2.97	2.97	0.51	5.40	3.59	3.59	0.62	7.65	
		20	-	-	-	-	2.27	1.63	0.39	2.74	2.62	2.28	0.45	4.02	3.08	2.94	0.53	5.83	3.60	3.58	0.62	7.71	
6		15	0.89	0.89	0.13	0.56	1.55	1.55	0.22	0.99	2.17	2.17	0.31	1.52	2.72	2.72	0.39	2.75	3.30	3.30	0.47	4.55	
		17	0.89	0.89	0.13	0.56	1.55	1.55	0.22	0.99	2.17	2.17	0.31	1.53	2.73	2.73	0.39	2.76	3.30	3.30	0.47	4.57	
		19	-	-	-	-	1.58	1.52	0.23	1.01	2.17	2.17	0.31	1.53	2.73	2.73	0.39	2.77	3.31	3.31	0.47	4.58	
		20	-	-	-	-	1.79	1.42	0.26	1.14	2.29	2.09	0.33	1.73	2.76	2.71	0.40	2.86	3.31	3.31	0.47	4.58	
15		3	15	1.09	1.09	0.31	1.53	1.67	1.67	0.48	4.70	2.30	2.30	0.66	8.44	2.90	2.90	0.83	12.53	3.49	3.49	1.00	17.43
			17	1.09	1.09	0.31	1.53	1.67	1.67	0.48	4.71	2.30	2.30	0.66	8.46	2.90	2.90	0.83	12.57	3.49	3.49	1.00	17.48
			19	-	-	-	-	1.71	1.66	0.49	4.98	2.30	2.29	0.66	8.45	2.91	2.91	0.83	12.60	3.50	3.50	1.01	17.52
			20	-	-	-	-	2.21	1.62	0.63	7.92	2.51	2.27	0.72	9.83	2.94	2.90	0.84	12.83	3.50	3.50	1.01	17.54
		4	15	0.82	0.82	0.18	0.77	1.45	1.45	0.31	1.54	2.02	2.02	0.43	3.73	2.64	2.64	0.57	6.56	3.25	3.25	0.70	9.42
			17	0.82	0.82	0.18	0.77	1.45	1.45	0.31	1.54	2.03	2.03	0.43	3.74	2.64	2.64	0.57	6.57	3.26	3.26	0.70	9.44
			19	-	-	-	-	1.46	1.46	0.31	1.55	2.03	2.03	0.43	3.75	2.65	2.65	0.57	6.59	3.26	3.26	0.70	9.47
			20	-	-	-	-	1.61	1.37	0.34	2.01	2.07	2.01	0.44	3.96	2.65	2.64	0.57	6.58	3.26	3.26	0.70	9.48
	5	15	0.51	0.51	0.09	0.38	1.20	1.20	0.21	0.89	1.82	1.82	0.31	1.57	2.38	2.38	0.41	3.25	2.98	2.98	0.51	5.52	
		17	0.51	0.51	0.09	0.38	1.20	1.20	0.21	0.89	1.82	1.82	0.31	1.58	2.38	2.38	0.41	3.26	2.99	2.99	0.52	5.54	
		19	-	-	-	-	1.20	1.20	0.21	0.89	1.82	1.82	0.31	1.58	2.39	2.39	0.41	3.27	2.99	2.99	0.52	5.55	
		20	-	-	-	-	1.25	1.16	0.21	0.93	1.83	1.82	0.32	1.60	2.39	2.39	0.41	3.28	3.00	3.00	0.52	5.56	
	6	15	-	-	-	-	0.91	0.91	0.13	0.55	1.57	1.57	0.22	0.96	2.17	2.17	0.31	1.57	2.73	2.73	0.39	2.91	
		17	-	-	-	-	0.91	0.91	0.13	0.55	1.57	1.57	0.23	0.96	2.18	2.18	0.31	1.58	2.74	2.74	0.39	2.92	
		19	-	-	-	-	0.91	0.91	0.13	0.55	1.57	1.57	0.23	0.96	2.18	2.18	0.31	1.58	2.74	2.74	0.39	2.93	
		20	-	-	-	-	0.91	0.91	0.13	0.55	1.57	1.56	0.23	0.96	2.18	2.18	0.31	1.59	2.74	2.74	0.39	2.94	

MDKH2-V150-R3																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	1.28	0.97	0.37	19.85	1.28	1.11	0.37	19.73	1.31	1.25	0.38	20.51	1.40	1.40	0.40	22.91	1.53	1.53	0.44	26.66
		17	1.70	0.98	0.49	31.86	1.69	1.12	0.48	31.51	1.68	1.26	0.48	31.16	1.67	1.39	0.48	30.81	1.67	1.52	0.48	30.78
		19	-	-	-	-	2.14	1.13	0.62	47.84	2.13	1.26	0.61	47.32	2.11	1.40	0.61	46.82	2.10	1.53	0.60	45.99
		20	-	-	-	-	2.37	1.13	0.68	56.56	2.36	1.27	0.68	55.96	2.34	1.40	0.67	55.36	2.33	1.53	0.67	54.78
	4	15	1.12	0.90	0.24	9.60	1.15	1.04	0.25	9.92	1.22	1.19	0.26	10.95	1.34	1.34	0.29	12.83	1.47	1.47	0.32	15.14
		17	1.56	0.92	0.34	16.84	1.55	1.05	0.33	16.65	1.54	1.19	0.33	16.47	1.54	1.33	0.33	16.44	1.57	1.47	0.34	16.94
		19	-	-	-	-	2.00	1.06	0.43	25.59	1.99	1.20	0.43	25.31	1.98	1.34	0.42	25.04	1.97	1.47	0.42	24.78
		20	-	-	-	-	2.24	1.07	0.48	31.06	2.23	1.21	0.48	30.74	2.22	1.34	0.48	30.41	2.20	1.47	0.47	30.10
	5	15	0.98	0.83	0.17	4.13	1.04	0.98	0.18	4.87	1.14	1.13	0.19	6.07	1.27	1.27	0.22	7.89	1.41	1.41	0.24	9.61
		17	1.38	0.83	0.24	9.26	1.37	0.97	0.24	9.15	1.37	1.11	0.24	9.14	1.40	1.26	0.24	9.52	1.46	1.40	0.25	10.22
		19	-	-	-	-	1.86	1.00	0.32	15.39	1.84	1.13	0.32	15.22	1.83	1.27	0.32	15.06	1.82	1.40	0.31	14.89
		20	-	-	-	-	2.10	1.00	0.36	19.00	2.09	1.14	0.36	18.80	2.07	1.28	0.36	18.60	2.06	1.41	0.36	18.41
6	15	0.89	0.78	0.13	2.04	0.97	0.93	0.14	2.49	1.08	1.08	0.15	3.29	1.21	1.21	0.17	4.51	1.35	1.35	0.19	5.96	
	17	1.20	0.75	0.17	4.43	1.20	0.89	0.17	4.41	1.23	1.04	0.18	4.73	1.29	1.19	0.18	5.34	1.37	1.34	0.20	6.25	
	19	-	-	-	-	1.68	0.92	0.24	9.40	1.66	1.05	0.24	9.29	1.65	1.19	0.24	9.18	1.65	1.33	0.24	9.19	
	20	-	-	-	-	1.93	0.93	0.28	12.05	1.92	1.07	0.28	11.92	1.91	1.20	0.27	11.79	1.90	1.34	0.27	11.66	
7	3	15	0.97	0.83	0.28	12.02	1.02	0.98	0.29	13.02	1.12	1.12	0.32	15.58	1.26	1.26	0.36	19.00	1.39	1.39	0.40	22.32
		17	1.39	0.84	0.40	22.26	1.38	0.98	0.40	22.00	1.37	1.11	0.39	21.73	1.38	1.25	0.40	21.95	1.42	1.39	0.41	23.14
		19	-	-	-	-	1.83	0.99	0.53	36.30	1.82	1.12	0.53	35.90	1.81	1.26	0.52	35.50	1.80	1.39	0.52	35.11
		20	-	-	-	-	2.07	0.99	0.59	44.13	2.05	1.12	0.59	43.65	2.04	1.26	0.59	43.17	2.03	1.39	0.58	42.71
	4	15	0.84	0.76	0.18	5.11	0.93	0.91	0.20	6.56	1.06	1.06	0.23	8.58	1.20	1.20	0.26	10.60	1.34	1.34	0.29	12.82
		17	1.23	0.77	0.26	11.01	1.22	0.90	0.26	10.87	1.23	1.05	0.26	11.01	1.27	1.19	0.28	11.76	1.35	1.34	0.29	13.01
		19	-	-	-	-	1.69	0.92	0.36	18.81	1.68	1.06	0.36	18.60	1.66	1.19	0.36	18.40	1.65	1.33	0.36	18.19
		20	-	-	-	-	1.93	0.93	0.41	23.67	1.92	1.06	0.41	23.41	1.90	1.20	0.41	23.16	1.89	1.33	0.41	22.91
	5	15	0.76	0.71	0.13	2.18	0.86	0.86	0.15	3.04	1.00	1.00	0.17	4.50	1.13	1.13	0.20	6.25	1.28	1.28	0.22	7.96
		17	1.03	0.68	0.18	4.90	1.04	0.82	0.18	5.04	1.09	0.98	0.19	5.68	1.17	1.13	0.20	6.68	1.28	1.28	0.22	7.99
		19	-	-	-	-	1.51	0.85	0.26	10.66	1.50	0.98	0.26	10.53	1.50	1.14	0.26	13.94	1.50	1.26	0.26	10.55
		20	-	-	-	-	1.77	0.86	0.30	13.85	1.76	0.99	0.30	13.70	1.74	1.13	0.30	13.55	1.73	1.27	0.30	13.40
6	15	0.68	0.66	0.10	1.39	0.81	0.81	0.12	1.73	0.95	0.95	0.14	2.45	1.08	1.08	0.16	3.49	1.21	1.21	0.17	4.72	
	17	0.89	0.62	0.13	2.08	0.93	0.77	0.13	2.35	1.00	0.93	0.14	2.85	1.09	1.08	0.16	3.62	1.21	1.21	0.17	4.74	
	19	-	-	-	-	1.30	0.76	0.19	5.69	1.29	0.90	0.19	5.59	1.31	1.04	0.19	5.78	1.36	1.19	0.19	6.25	
	20	-	-	-	-	1.57	0.78	0.23	8.31	1.56	0.91	0.22	8.21	1.55	1.05	0.22	8.10	1.55	1.19	0.22	8.09	
9	3	15	0.71	0.69	0.20	6.87	0.84	0.84	0.24	9.27	0.98	0.98	0.28	12.08	1.12	1.12	0.32	15.19	1.26	1.26	0.36	18.41
		17	1.05	0.69	0.30	13.55	1.04	0.83	0.30	13.40	1.07	0.97	0.31	13.96	1.13	1.12	0.33	15.55	1.26	1.26	0.36	18.47
		19	-	-	-	-	1.50	0.84	0.43	25.02	1.49	0.98	0.43	24.73	1.48	1.11	0.43	24.44	1.48	1.25	0.42	24.24
		20	-	-	-	-	1.74	0.84	0.50	32.28	1.73	0.98	0.50	32.16	1.72	1.12	0.50	32.05	1.71	1.25	0.49	31.69
	4	15	0.64	0.64	0.14	2.61	0.78	0.78	0.17	4.40	0.92	0.92	0.20	6.49	1.06	1.06	0.23	8.43	1.20	1.20	0.26	10.39
		17	0.85	0.61	0.18	5.43	0.88	0.76	0.19	5.99	0.96	0.91	0.21	7.05	1.06	1.06	0.23	8.47	1.20	1.20	0.26	10.42
		19	-	-	-	-	1.34	0.77	0.29	12.44	1.33	0.91	0.29	12.29	1.32	1.05	0.28	12.21	1.35	1.19	0.29	12.59
		20	-	-	-	-	1.59	0.78	0.34	16.70	1.57	0.92	0.34	16.50	1.56	1.05	0.34	16.30	1.55	1.19	0.33	16.10
	5	15	0.58	0.58	0.10	1.37	0.73	0.73	0.12	2.00	0.86	0.86	0.15	3.16	1.00	1.00	0.17	4.69	1.14	1.14	0.20	6.38
		17	0.71	0.55	0.12	1.92	0.78	0.70	0.13	2.44	0.87	0.85	0.15	3.31	1.00	1.00	0.17	4.71	1.14	1.14	0.20	6.40
		19	-	-	-	-	1.13	0.69	0.19	6.24	1.12	0.83	0.19	6.21	1.16	0.98	0.20	6.63	1.22	1.13	0.21	7.31
		20	-	-	-	-	1.40	0.70	0.24	9.15	1.39	0.84	0.24	9.03	1.38	0.98	0.24	8.92	1.39	1.12	0.24	9.05
6	15	0.52	0.52	0.08	1.00	0.67	0.67	0.10	1.29	0.81	0.81	0.12	1.72	0.95	0.95	0.14	2.52	1.08	1.08	0.15	3.61	
	17	0.59	0.49	0.08	1.12	0.70	0.66	0.10	1.35	0.82	0.81	0.12	1.74	0.95	0.95	0.14	2.53	1.08	1.08	0.16	3.62	
	19	-	-	-	-	0.94	0.62	0.13	2.48	0.97	0.76	0.14	2.74	1.04	0.92	0.15	3.25	1.12	1.07	0.16	4.01	
	20	-	-	-	-	1.17	0.62	0.17	4.47	1.16	0.76	0.17	4.38	1.18	0.90	0.17	4.57	1.23	1.05	0.18	5.08	

Continued:

		MDKH2-V150-R3																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	0.55	0.55	0.16	3.79	0.70	0.70	0.20	6.55	0.84	0.84	0.24	9.04	0.98	0.98	0.28	11.75	1.12	1.12	0.32	14.81	
		17	0.67	0.53	0.19	6.09	0.74	0.69	0.21	7.23	0.84	0.84	0.24	9.06	0.98	0.98	0.28	11.79	1.12	1.12	0.32	14.86	
		19	-	-	-	-	1.14	0.69	0.33	15.32	1.13	0.83	0.32	15.10	1.14	0.97	0.33	15.26	1.18	1.12	0.34	16.10	
		20	-	-	-	-	1.39	0.70	0.40	21.21	1.38	0.84	0.39	20.96	1.37	0.98	0.39	20.70	1.36	1.11	0.39	20.51	
	4	15	0.50	0.50	0.11	1.45	0.64	0.64	0.14	2.62	0.78	0.78	0.17	4.44	0.92	0.92	0.20	6.45	1.06	1.06	0.23	8.24	
		17	0.55	0.48	0.12	1.79	0.65	0.63	0.14	2.75	0.78	0.78	0.17	4.45	0.92	0.92	0.20	6.47	1.06	1.06	0.23	8.27	
		19	-	-	-	-	0.93	0.61	0.20	6.59	0.95	0.76	0.20	6.81	1.01	0.91	0.22	7.52	1.09	1.06	0.23	8.60	
		20	-	-	-	-	1.20	0.63	0.26	10.13	1.19	0.77	0.26	9.99	1.19	0.91	0.25	9.94	1.22	1.05	0.26	10.35	
	5	15	0.44	0.44	0.08	0.97	0.59	0.59	0.10	1.33	0.73	0.73	0.13	2.08	0.86	0.86	0.15	3.31	1.00	1.00	0.17	4.87	
		17	0.46	0.43	0.08	1.02	0.59	0.59	0.10	1.33	0.73	0.73	0.13	2.09	0.86	0.86	0.15	3.33	1.00	1.00	0.17	4.88	
		19	-	-	-	-	0.75	0.54	0.13	2.30	0.81	0.70	0.14	2.84	0.90	0.85	0.15	3.72	1.01	1.00	0.17	4.96	
		20	-	-	-	-	0.97	0.54	0.17	4.51	0.97	0.68	0.17	4.52	1.01	0.83	0.17	5.03	1.09	0.99	0.19	5.82	
	6	15	0.38	0.38	0.05	0.68	0.53	0.53	0.08	0.96	0.68	0.68	0.10	1.24	0.81	0.81	0.12	1.76	0.95	0.95	0.14	2.64	
		17	0.38	0.37	0.05	0.69	0.53	0.53	0.08	0.96	0.68	0.68	0.10	1.24	0.82	0.82	0.12	1.77	0.95	0.95	0.14	2.65	
		19	-	-	-	-	0.63	0.49	0.09	1.13	0.73	0.65	0.10	1.38	0.83	0.81	0.12	1.87	0.95	0.95	0.14	2.66	
		20	-	-	-	-	0.78	0.48	0.11	1.62	0.83	0.63	0.12	1.86	0.90	0.78	0.13	2.31	0.99	0.93	0.14	2.98	
	13	3	15	0.41	0.41	0.12	1.84	0.55	0.55	0.16	4.04	0.70	0.70	0.20	6.59	0.84	0.84	0.24	9.03	0.98	0.98	0.28	11.72
			17	0.42	0.41	0.12	1.90	0.55	0.55	0.16	4.06	0.70	0.70	0.20	6.61	0.84	0.84	0.24	9.06	0.98	0.98	0.28	11.76
			19	-	-	-	-	0.73	0.54	0.21	7.13	0.78	0.69	0.22	7.92	0.86	0.84	0.25	9.36	0.98	0.98	0.28	11.78
			20	-	-	-	-	0.99	0.55	0.28	11.91	0.98	0.69	0.28	11.72	1.00	0.83	0.29	11.99	1.04	0.98	0.30	12.81
		4	15	0.36	0.36	0.08	0.94	0.50	0.50	0.11	1.48	0.64	0.64	0.14	2.78	0.78	0.78	0.17	4.65	0.92	0.92	0.20	6.39
			17	0.36	0.35	0.08	0.94	0.50	0.50	0.11	1.48	0.64	0.64	0.14	2.79	0.78	0.78	0.17	4.67	0.92	0.92	0.20	6.41
			19	-	-	-	-	0.58	0.48	0.12	2.11	0.67	0.63	0.14	3.12	0.78	0.78	0.17	4.70	0.93	0.93	0.20	6.43
			20	-	-	-	-	0.75	0.46	0.16	4.23	0.78	0.61	0.17	4.68	0.85	0.77	0.18	5.55	0.95	0.92	0.20	6.68
5		15	0.29	0.29	0.05	0.60	0.44	0.44	0.08	0.92	0.59	0.59	0.10	1.29	0.73	0.73	0.12	2.14	0.86	0.86	0.15	3.40	
		17	0.29	0.29	0.05	0.60	0.44	0.44	0.08	0.92	0.59	0.59	0.10	1.30	0.73	0.73	0.12	2.15	0.86	0.86	0.15	3.42	
		19	-	-	-	-	0.48	0.43	0.08	0.99	0.60	0.59	0.10	1.33	0.73	0.73	0.12	2.15	0.86	0.86	0.15	3.43	
		20	-	-	-	-	0.58	0.40	0.10	1.25	0.66	0.56	0.11	1.67	0.76	0.71	0.13	2.39	0.87	0.86	0.15	3.48	
6		15	0.22	0.22	0.03	0.37	0.38	0.38	0.05	0.65	0.53	0.53	0.08	0.91	0.68	0.68	0.10	1.20	0.81	0.81	0.12	1.80	
		17	0.22	0.22	0.03	0.37	0.38	0.38	0.05	0.65	0.53	0.53	0.08	0.91	0.68	0.68	0.10	1.20	0.81	0.81	0.12	1.80	
		19	-	-	-	-	0.39	0.37	0.06	0.66	0.53	0.53	0.08	0.91	0.68	0.68	0.10	1.21	0.82	0.82	0.12	1.81	
		20	-	-	-	-	0.44	0.35	0.06	0.74	0.57	0.51	0.08	0.97	0.69	0.67	0.10	1.24	0.82	0.82	0.12	1.81	
15		3	15	0.27	0.27	0.08	0.90	0.41	0.41	0.12	1.86	0.55	0.55	0.16	4.08	0.70	0.70	0.20	6.41	0.84	0.84	0.24	8.77
			17	0.27	0.27	0.08	0.90	0.41	0.41	0.12	1.87	0.55	0.55	0.16	4.09	0.70	0.70	0.20	6.43	0.84	0.84	0.24	8.79
			19	-	-	-	-	0.42	0.41	0.12	2.02	0.55	0.55	0.16	4.09	0.70	0.70	0.20	6.45	0.84	0.84	0.24	8.82
			20	-	-	-	-	0.53	0.39	0.15	3.62	0.60	0.54	0.17	4.96	0.71	0.70	0.20	6.57	0.84	0.84	0.24	8.83
		4	15	0.20	0.20	0.04	0.50	0.36	0.36	0.08	0.89	0.50	0.50	0.11	1.48	0.64	0.64	0.14	2.84	0.78	0.78	0.17	4.67
			17	0.20	0.20	0.04	0.50	0.36	0.36	0.08	0.89	0.50	0.50	0.11	1.49	0.64	0.64	0.14	2.86	0.78	0.78	0.17	4.68
			19	-	-	-	-	0.36	0.36	0.08	0.90	0.50	0.50	0.11	1.49	0.64	0.64	0.14	2.87	0.78	0.78	0.17	4.70
			20	-	-	-	-	0.40	0.34	0.09	1.01	0.52	0.50	0.11	1.61	0.64	0.64	0.14	2.87	0.78	0.78	0.17	4.71
	5	15	0.12	0.12	0.02	0.24	0.29	0.29	0.05	0.58	0.45	0.45	0.08	0.89	0.59	0.59	0.10	1.32	0.73	0.73	0.13	2.26	
		17	0.12	0.12	0.02	0.24	0.30	0.30	0.05	0.58	0.45	0.45	0.08	0.89	0.59	0.59	0.10	1.32	0.73	0.73	0.13	2.26	
		19	-	-	-	-	0.30	0.29	0.05	0.58	0.45	0.45	0.08	0.89	0.59	0.59	0.10	1.32	0.73	0.73	0.13	2.27	
		20	-	-	-	-	0.31	0.29	0.05	0.60	0.45	0.45	0.08	0.90	0.59	0.59	0.10	1.32	0.73	0.73	0.13	2.28	
	6	15	-	-	-	-	0.22	0.22	0.03	0.36	0.38	0.38	0.06	0.63	0.54	0.54	0.08	0.87	0.68	0.68	0.10	1.20	
		17	-	-	-	-	0.22	0.22	0.03	0.36	0.39	0.39	0.06	0.63	0.54	0.54	0.08	0.88	0.68	0.68	0.10	1.21	
		19	-	-	-	-	0.22	0.22	0.03	0.36	0.39	0.39	0.06	0.63	0.54	0.54	0.08	0.88	0.68	0.68	0.10	1.21	
		20	-	-	-	-	0.22	0.22	0.03	0.36	0.39	0.38	0.06	0.63	0.54	0.54	0.08	0.88	0.68	0.68	0.10	1.21	

MDKH2-V250-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
5	3	15	2.00	1.52	0.58	21.28	1.99	1.73	0.57	21.14	2.04	1.95	0.59	21.98	2.17	2.17	0.63	24.57	2.38	2.38	0.68	28.41	
		17	2.65	1.53	0.76	34.14	2.63	1.74	0.75	33.77	2.62	1.95	0.75	33.41	2.60	2.16	0.74	33.04	2.60	2.37	0.74	33.01	
		19	-	-	-	-	3.33	1.75	0.96	50.87	3.31	1.97	0.95	50.76	3.29	2.18	0.95	50.23	3.27	2.38	0.94	49.70	
		20	-	-	-	-	3.69	1.76	1.06	60.67	3.67	1.97	1.05	60.03	3.65	2.18	1.04	59.40	3.63	2.39	1.04	58.78	
	4	15	1.74	1.40	0.37	10.16	1.79	1.63	0.38	10.64	1.90	1.86	0.41	11.74	2.08	2.08	0.45	13.75	2.30	2.30	0.49	16.40	
		17	2.43	1.43	0.52	18.04	2.42	1.64	0.52	17.84	2.40	1.85	0.52	17.64	2.40	2.07	0.52	17.61	2.44	2.28	0.53	18.15	
		19	-	-	-	-	3.12	1.66	0.67	27.42	3.10	1.87	0.66	27.13	3.08	2.08	0.66	26.84	3.06	2.29	0.66	26.56	
		20	-	-	-	-	3.49	1.66	0.75	33.31	3.47	1.88	0.74	32.96	3.45	2.09	0.74	32.62	3.43	2.30	0.74	32.27	
	5	15	1.52	1.29	0.26	4.58	1.62	1.52	0.28	5.39	1.77	1.76	0.30	6.69	1.98	1.98	0.34	8.56	2.20	2.20	0.38	10.30	
		17	2.16	1.30	0.37	9.96	2.14	1.52	0.37	9.85	2.14	1.73	0.37	9.83	2.19	1.96	0.38	10.21	2.28	2.19	0.39	10.95	
		19	-	-	-	-	2.89	1.55	0.50	16.49	2.87	1.77	0.49	16.31	2.85	1.98	0.49	16.14	2.84	2.18	0.49	15.96	
		20	-	-	-	-	3.27	1.56	0.56	20.36	3.25	1.78	0.56	20.15	3.23	1.99	0.56	19.94	3.21	2.20	0.55	19.73	
	6	15	1.38	1.21	0.20	2.22	1.51	1.45	0.22	2.75	1.68	1.68	0.24	3.65	1.89	1.89	0.27	5.01	2.10	2.10	0.30	6.57	
		17	1.87	1.17	0.27	4.92	1.86	1.39	0.27	4.90	1.91	1.62	0.27	5.24	2.01	1.86	0.29	5.91	2.14	2.09	0.31	6.87	
		19	-	-	-	-	2.61	1.43	0.37	10.10	2.60	1.64	0.37	9.99	2.58	1.85	0.37	9.87	2.58	2.07	0.37	9.88	
		20	-	-	-	-	3.02	1.45	0.43	12.92	3.00	1.66	0.43	12.78	2.98	1.88	0.43	12.65	2.96	2.08	0.42	12.51	
	7	3	15	1.51	1.29	0.43	12.87	1.58	1.52	0.45	13.95	1.75	1.74	0.50	16.70	1.96	1.96	0.57	20.36	2.17	2.17	0.62	23.93
			17	2.17	1.30	0.62	23.85	2.15	1.52	0.62	23.58	2.14	1.73	0.61	23.29	2.15	1.95	0.62	23.51	2.22	2.17	0.64	24.80
			19	-	-	-	-	2.86	1.53	0.83	38.90	2.84	1.75	0.82	38.47	2.82	1.96	0.82	38.06	2.80	2.17	0.81	37.64
			20	-	-	-	-	3.22	1.54	0.93	47.32	3.20	1.75	0.92	46.81	3.18	1.96	0.91	46.32	3.16	2.17	0.91	45.82
4		15	1.30	1.18	0.28	5.65	1.44	1.42	0.31	7.17	1.65	1.65	0.36	9.20	1.87	1.87	0.40	11.36	2.09	2.09	0.45	13.74	
		17	1.92	1.19	0.41	11.90	1.90	1.41	0.41	11.74	1.92	1.63	0.41	11.88	1.98	1.86	0.43	12.60	2.10	2.09	0.45	13.94	
		19	-	-	-	-	2.63	1.43	0.56	20.16	2.61	1.65	0.56	19.94	2.59	1.86	0.56	19.72	2.57	2.07	0.55	19.49	
		20	-	-	-	-	3.00	1.44	0.65	25.37	2.98	1.66	0.64	25.09	2.96	1.87	0.64	24.82	2.95	2.08	0.63	24.55	
5		15	1.18	1.11	0.20	2.40	1.34	1.34	0.23	3.37	1.55	1.55	0.27	4.98	1.77	1.77	0.30	6.84	1.99	1.99	0.34	8.56	
		17	1.60	1.06	0.27	5.42	1.62	1.28	0.28	5.57	1.70	1.52	0.29	6.24	1.82	1.76	0.31	7.28	1.99	1.99	0.34	8.59	
		19	-	-	-	-	2.36	1.32	0.41	11.43	2.34	1.53	0.40	11.30	2.35	1.79	0.40	13.33	2.34	1.96	0.40	11.31	
		20	-	-	-	-	2.75	1.33	0.47	14.88	2.73	1.55	0.47	14.71	2.72	1.76	0.47	14.54	2.70	1.97	0.46	14.37	
6		15	1.06	1.03	0.15	1.45	1.26	1.26	0.18	1.87	1.47	1.47	0.21	2.71	1.68	1.68	0.24	3.88	1.89	1.89	0.27	5.23	
		17	1.38	0.97	0.20	2.29	1.45	1.20	0.21	2.59	1.56	1.44	0.22	3.16	1.70	1.67	0.24	4.02	1.89	1.89	0.27	5.25	
		19	-	-	-	-	2.03	1.18	0.29	6.26	2.02	1.40	0.29	6.16	2.04	1.62	0.29	6.34	2.12	1.85	0.30	6.82	
		20	-	-	-	-	2.45	1.21	0.35	8.93	2.44	1.43	0.35	8.83	2.42	1.64	0.35	8.72	2.42	1.85	0.35	8.70	
9		3	15	1.10	1.08	0.32	7.42	1.31	1.31	0.38	9.93	1.53	1.53	0.44	12.94	1.74	1.74	0.50	16.32	1.96	1.96	0.56	19.74
			17	1.64	1.07	0.47	14.55	1.63	1.29	0.47	14.37	1.66	1.52	0.48	15.01	1.77	1.74	0.51	16.67	1.96	1.96	0.56	19.80
			19	-	-	-	-	2.34	1.31	0.68	27.25	2.33	1.52	0.67	26.93	2.31	1.74	0.67	26.41	2.30	1.95	0.66	25.97
			20	-	-	-	-	2.71	1.31	0.78	34.60	2.69	1.53	0.77	34.22	2.67	1.74	0.77	33.83	2.66	1.95	0.76	33.44
	4	15	0.99	0.99	0.22	2.89	1.21	1.21	0.26	4.79	1.43	1.43	0.31	7.03	1.65	1.65	0.36	9.03	1.87	1.87	0.40	11.14	
		17	1.32	0.94	0.28	5.97	1.38	1.18	0.30	6.53	1.49	1.42	0.32	7.59	1.66	1.66	0.36	9.07	1.87	1.87	0.40	11.17	
		19	-	-	-	-	2.09	1.20	0.45	13.53	2.07	1.42	0.45	13.36	2.06	1.63	0.44	13.09	2.10	1.85	0.45	13.66	
		20	-	-	-	-	2.47	1.22	0.53	17.94	2.45	1.43	0.53	17.73	2.44	1.64	0.53	17.51	2.42	1.85	0.52	17.29	
	5	15	0.91	0.91	0.16	1.44	1.13	1.13	0.19	2.21	1.34	1.34	0.23	3.51	1.55	1.55	0.27	5.18	1.77	1.77	0.31	6.91	
		17	1.11	0.85	0.19	2.11	1.21	1.09	0.21	2.70	1.36	1.33	0.23	3.67	1.55	1.55	0.27	5.20	1.78	1.78	0.31	6.93	
		19	-	-	-	-	1.76	1.07	0.30	6.79	1.75	1.29	0.30	6.75	1.81	1.52	0.31	7.16	1.91	1.76	0.33	7.85	
		20	-	-	-	-	2.18	1.10	0.37	9.81	2.16	1.31	0.37	9.69	2.15	1.53	0.37	9.57	2.16	1.75	0.37	9.70	
	6	15	0.82	0.82	0.12	1.05	1.05	1.05	0.15	1.35	1.26	1.26	0.18	1.88	1.47	1.47	0.21	2.80	1.68	1.68	0.24	4.00	
		17	0.93	0.77	0.13	1.18	1.09	1.02	0.16	1.43	1.27	1.26	0.18	1.91	1.47	1.47	0.21	2.81	1.68	1.68	0.24	4.02	
		19	-	-	-	-	1.46	0.96	0.21	2.74	1.51	1.19	0.22	3.04	1.61	1.43	0.23	3.61	1.75	1.66	0.25	4.44	
		20	-	-	-	-	1.82	0.96	0.26	4.95	1.81	1.18	0.26	4.85	1.84	1.40	0.26	5.05	1.92	1.64	0.27	5.57	

Continued:

		MDKH2-V250-R3																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	0.86	0.86	0.24	4.20	1.09	1.09	0.31	7.04	1.31	1.31	0.37	9.69	1.53	1.53	0.44	12.60	1.74	1.74	0.50	15.77	
		17	1.05	0.83	0.30	6.60	1.15	1.08	0.33	7.75	1.31	1.31	0.37	9.71	1.53	1.53	0.44	12.63	1.75	1.75	0.50	15.82	
		19	-	-	-	-	1.78	1.08	0.51	16.27	1.76	1.29	0.50	16.04	1.77	1.51	0.51	16.21	1.84	1.74	0.52	17.25	
		20	-	-	-	-	2.16	1.09	0.62	22.73	2.14	1.31	0.61	22.46	2.13	1.52	0.61	22.19	2.12	1.73	0.60	21.98	
	4	15	0.78	0.78	0.17	1.57	0.99	0.99	0.21	2.91	1.21	1.21	0.26	4.90	1.43	1.43	0.31	6.93	1.66	1.66	0.35	8.84	
		17	0.86	0.75	0.18	1.98	1.01	0.98	0.22	3.04	1.21	1.21	0.26	4.91	1.44	1.44	0.31	6.95	1.66	1.66	0.36	8.86	
		19	-	-	-	-	1.46	0.96	0.31	7.09	1.48	1.18	0.32	7.31	1.57	1.42	0.34	8.06	1.70	1.65	0.36	9.22	
		20	-	-	-	-	1.87	0.98	0.40	10.86	1.86	1.19	0.40	10.72	1.85	1.41	0.40	10.65	1.89	1.64	0.41	11.09	
	5	15	0.69	0.69	0.12	1.02	0.92	0.92	0.16	1.42	1.13	1.13	0.19	2.31	1.34	1.34	0.23	3.68	1.56	1.56	0.27	5.33	
		17	0.72	0.67	0.12	1.06	0.92	0.92	0.16	1.43	1.13	1.13	0.19	2.32	1.34	1.34	0.23	3.69	1.56	1.56	0.27	5.35	
		19	-	-	-	-	1.17	0.85	0.20	2.55	1.26	1.09	0.22	3.15	1.40	1.32	0.24	4.12	1.57	1.56	0.27	5.43	
		20	-	-	-	-	1.51	0.84	0.26	4.98	1.51	1.07	0.26	4.98	1.58	1.30	0.27	5.50	1.69	1.54	0.29	6.30	
	6	15	0.59	0.59	0.08	0.71	0.83	0.83	0.12	1.00	1.05	1.05	0.15	1.31	1.27	1.27	0.18	1.94	1.47	1.47	0.21	2.93	
		17	0.60	0.58	0.09	0.72	0.83	0.82	0.12	1.00	1.05	1.05	0.15	1.32	1.27	1.27	0.18	1.95	1.47	1.47	0.21	2.94	
		19	-	-	-	-	0.98	0.77	0.14	1.18	1.13	1.02	0.16	1.49	1.29	1.26	0.19	2.06	1.48	1.48	0.21	2.95	
		20	-	-	-	-	1.22	0.74	0.18	1.78	1.29	0.98	0.18	2.05	1.40	1.22	0.20	2.56	1.54	1.45	0.22	3.30	
	13	3	15	0.64	0.64	0.18	2.04	0.86	0.86	0.25	4.46	1.09	1.09	0.31	7.06	1.31	1.31	0.38	9.68	1.53	1.53	0.44	12.56
			17	0.65	0.64	0.19	2.11	0.86	0.86	0.25	4.47	1.09	1.09	0.31	7.08	1.31	1.31	0.38	9.70	1.53	1.53	0.44	12.60
			19	-	-	-	-	1.14	0.84	0.33	7.65	1.21	1.08	0.35	8.48	1.34	1.31	0.38	10.03	1.53	1.53	0.44	12.63
			20	-	-	-	-	1.54	0.85	0.44	12.52	1.53	1.07	0.44	12.56	1.54	1.29	0.44	12.62	1.62	1.52	0.46	13.72
		4	15	0.56	0.56	0.12	0.99	0.78	0.78	0.17	1.62	0.99	0.99	0.21	3.09	1.21	1.21	0.26	5.09	1.44	1.44	0.31	6.85
			17	0.56	0.55	0.12	0.99	0.78	0.78	0.17	1.62	1.00	1.00	0.21	3.10	1.22	1.22	0.26	5.11	1.44	1.44	0.31	6.87
			19	-	-	-	-	0.90	0.74	0.19	2.33	1.04	0.98	0.22	3.45	1.22	1.22	0.26	5.06	1.44	1.44	0.31	6.89
			20	-	-	-	-	1.17	0.72	0.25	4.66	1.22	0.96	0.26	5.12	1.33	1.20	0.28	5.98	1.48	1.44	0.32	7.16
5		15	0.45	0.45	0.08	0.63	0.69	0.69	0.12	0.96	0.92	0.92	0.16	1.40	1.13	1.13	0.19	2.37	1.34	1.34	0.23	3.77	
		17	0.45	0.45	0.08	0.63	0.69	0.69	0.12	0.97	0.92	0.92	0.16	1.40	1.13	1.13	0.19	2.38	1.34	1.34	0.23	3.78	
		19	-	-	-	-	0.74	0.66	0.13	1.03	0.93	0.91	0.16	1.45	1.13	1.13	0.19	2.39	1.35	1.35	0.23	3.80	
		20	-	-	-	-	0.91	0.63	0.16	1.36	1.03	0.87	0.18	1.85	1.17	1.11	0.20	2.65	1.35	1.34	0.23	3.84	
6		15	0.34	0.34	0.05	0.39	0.59	0.59	0.08	0.68	0.83	0.83	0.12	0.95	1.05	1.05	0.15	1.29	1.26	1.26	0.18	1.99	
		17	0.34	0.34	0.05	0.39	0.59	0.59	0.09	0.68	0.83	0.83	0.12	0.95	1.06	1.06	0.15	1.29	1.27	1.27	0.18	2.00	
		19	-	-	-	-	0.61	0.58	0.09	0.69	0.83	0.83	0.12	0.96	1.06	1.06	0.15	1.29	1.27	1.27	0.18	2.01	
		20	-	-	-	-	0.69	0.54	0.10	0.78	0.88	0.80	0.13	1.01	1.08	1.05	0.15	1.34	1.27	1.27	0.18	2.01	
15		3	15	0.42	0.42	0.12	0.94	0.64	0.64	0.18	2.07	0.86	0.86	0.25	4.47	1.09	1.09	0.31	6.87	1.31	1.31	0.37	9.40
			17	0.42	0.42	0.12	0.95	0.64	0.64	0.18	2.08	0.86	0.86	0.25	4.49	1.09	1.09	0.31	6.89	1.31	1.31	0.37	9.42
			19	-	-	-	-	0.66	0.63	0.19	2.23	0.86	0.86	0.25	4.48	1.09	1.09	0.31	6.91	1.31	1.31	0.38	9.45
			20	-	-	-	-	0.82	0.60	0.23	3.99	0.94	0.85	0.27	5.36	1.11	1.09	0.32	7.04	1.32	1.31	0.38	9.46
		4	15	0.32	0.32	0.07	0.53	0.56	0.56	0.12	0.93	0.78	0.78	0.17	1.64	0.99	0.99	0.21	3.16	1.22	1.22	0.26	5.06
			17	0.32	0.32	0.07	0.53	0.56	0.56	0.12	0.93	0.78	0.78	0.17	1.65	0.99	0.99	0.21	3.17	1.22	1.22	0.26	5.08
			19	-	-	-	-	0.56	0.56	0.12	0.94	0.78	0.78	0.17	1.65	1.00	1.00	0.21	3.18	1.22	1.22	0.26	5.09
			20	-	-	-	-	0.63	0.52	0.14	1.06	0.80	0.77	0.17	1.78	1.00	0.99	0.21	3.18	1.22	1.22	0.26	5.10
	5	15	0.20	0.20	0.03	0.26	0.46	0.46	0.08	0.61	0.70	0.70	0.12	0.93	0.92	0.92	0.16	1.44	1.13	1.13	0.19	2.50	
		17	0.20	0.20	0.03	0.26	0.46	0.46	0.08	0.61	0.70	0.70	0.12	0.93	0.92	0.92	0.16	1.45	1.13	1.13	0.19	2.51	
		19	-	-	-	-	0.46	0.46	0.08	0.61	0.70	0.70	0.12	0.93	0.92	0.92	0.16	1.45	1.13	1.13	0.20	2.52	
		20	-	-	-	-	0.48	0.45	0.08	0.63	0.70	0.70	0.12	0.94	0.92	0.92	0.16	1.45	1.13	1.13	0.20	2.53	
	6	15	-	-	-	-	0.35	0.35	0.05	0.38	0.60	0.60	0.09	0.65	0.83	0.83	0.12	0.91	1.06	1.06	0.15	1.31	
		17	-	-	-	-	0.35	0.35	0.05	0.38	0.60	0.60	0.09	0.66	0.84	0.84	0.12	0.92	1.06	1.06	0.15	1.31	
		19	-	-	-	-	0.35	0.35	0.05	0.38	0.60	0.60	0.09	0.66	0.84	0.84	0.12	0.92	1.06	1.06	0.15	1.32	
		20	-	-	-	-	0.35	0.35	0.05	0.38	0.60	0.60	0.09	0.66	0.84	0.84	0.12	0.92	1.06	1.06	0.15	1.32	

MDKH2-V350-R3																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	2.92	2.19	0.84	53.46	2.90	2.50	0.83	52.90	2.95	2.81	0.84	54.38	3.13	3.12	0.90	60.15	3.42	3.42	0.98	70.55	
		17	3.84	2.21	1.10	86.30	3.82	2.51	1.10	85.35	3.80	2.82	1.09	84.47	3.77	3.12	1.08	83.59	3.76	3.41	1.08	83.02	
		19	-	-	-	-	4.80	2.53	1.39	128.47	4.78	2.83	1.39	128.48	4.75	3.13	1.38	127.10	4.72	3.43	1.37	125.76	
		20	-	-	-	-	5.32	2.53	1.54	153.36	5.29	2.84	1.53	151.76	5.26	3.14	1.52	150.24	5.23	3.43	1.51	149.05	
	4	15	2.62	2.05	0.56	26.91	2.65	2.37	0.57	27.48	2.77	2.70	0.60	29.68	3.01	3.01	0.65	34.24	3.32	3.32	0.71	40.35	
		17	3.57	2.08	0.77	45.83	3.55	2.39	0.76	45.35	3.53	2.69	0.76	44.88	3.51	2.99	0.75	44.50	3.55	3.30	0.76	45.35	
		19	-	-	-	-	4.54	2.40	0.98	69.60	4.52	2.71	0.97	68.88	4.49	3.01	0.97	68.19	4.46	3.31	0.96	67.50	
		20	-	-	-	-	5.07	2.41	1.09	84.24	5.04	2.72	1.08	83.39	5.01	3.02	1.08	82.53	4.98	3.32	1.07	81.72	
	5	15	2.31	1.91	0.40	14.87	2.43	2.24	0.42	16.17	2.61	2.58	0.45	18.39	2.89	2.89	0.50	21.72	3.20	3.20	0.55	25.78	
		17	3.26	1.94	0.56	26.55	3.24	2.24	0.56	26.27	3.22	2.55	0.55	26.00	3.25	2.86	0.56	26.46	3.35	3.18	0.58	27.90	
		19	-	-	-	-	4.26	2.27	0.73	42.10	4.23	2.58	0.73	41.67	4.21	2.88	0.72	41.25	4.19	3.18	0.72	40.83	
		20	-	-	-	-	4.80	2.29	0.83	51.86	4.77	2.59	0.82	51.38	4.74	2.90	0.82	51.05	4.72	3.19	0.81	50.57	
6	15	2.01	1.75	0.29	7.90	2.20	2.10	0.32	9.72	2.46	2.45	0.35	12.07	2.77	2.77	0.40	14.81	3.08	3.08	0.44	17.62		
	17	2.91	1.78	0.42	16.06	2.89	2.09	0.41	15.86	2.92	2.41	0.42	16.13	3.01	2.73	0.43	16.94	3.17	3.06	0.45	18.51		
	19	-	-	-	-	3.94	2.13	0.56	26.82	3.92	2.44	0.56	26.54	3.90	2.74	0.56	26.27	3.87	3.04	0.55	26.01		
	20	-	-	-	-	4.49	2.15	0.65	33.79	4.47	2.46	0.64	33.46	4.44	2.76	0.64	33.12	4.42	3.06	0.63	32.79		
7	3	15	2.24	1.88	0.65	33.74	2.31	2.20	0.67	35.72	2.52	2.51	0.72	40.85	2.82	2.82	0.81	49.83	3.12	3.12	0.90	59.41	
		17	3.16	1.89	0.91	60.74	3.14	2.20	0.90	60.07	3.12	2.50	0.90	59.39	3.12	2.81	0.90	59.34	3.20	3.12	0.92	62.46	
		19	-	-	-	-	4.14	2.21	1.20	98.53	4.11	2.52	1.19	97.49	4.09	2.82	1.19	96.47	4.06	3.12	1.17	94.02	
		20	-	-	-	-	4.66	2.22	1.36	121.61	4.63	2.53	1.35	120.35	4.60	2.83	1.34	119.08	4.57	3.12	1.32	116.03	
	4	15	1.97	1.74	0.43	16.42	2.13	2.08	0.46	18.66	2.40	2.40	0.52	22.90	2.71	2.71	0.58	28.16	3.01	3.01	0.65	34.15	
		17	2.86	1.76	0.62	31.21	2.84	2.07	0.62	30.86	2.84	2.37	0.61	30.75	2.90	2.69	0.63	32.02	3.05	3.01	0.66	34.89	
		19	-	-	-	-	3.85	2.09	0.83	52.16	3.83	2.40	0.83	51.61	3.81	2.70	0.82	51.07	3.78	3.00	0.82	50.53	
		20	-	-	-	-	4.38	2.10	0.94	64.47	4.35	2.40	0.94	64.18	4.33	2.71	0.94	63.64	4.30	3.01	0.93	63.23	
	5	15	1.71	1.60	0.29	8.46	1.96	1.95	0.34	11.06	2.28	2.28	0.39	14.23	2.59	2.59	0.45	17.73	2.90	2.90	0.50	21.48	
		17	2.50	1.60	0.43	16.72	2.49	1.91	0.43	16.61	2.56	2.24	0.44	17.37	2.70	2.57	0.46	19.05	2.91	2.90	0.50	21.66	
		19	-	-	-	-	3.54	1.95	0.61	30.43	3.52	2.26	0.61	30.11	3.50	2.65	0.60	34.08	3.49	2.87	0.60	29.68	
		20	-	-	-	-	4.07	1.96	0.70	38.48	4.05	2.27	0.70	38.08	4.02	2.58	0.69	37.69	4.00	2.88	0.69	37.30	
6	15	1.55	1.49	0.22	4.14	1.82	1.81	0.26	6.26	2.14	2.14	0.31	9.18	2.46	2.46	0.35	11.87	2.77	2.77	0.40	14.57		
	17	2.05	1.41	0.29	8.42	2.14	1.75	0.31	9.22	2.30	2.10	0.33	10.60	2.52	2.45	0.36	12.34	2.78	2.78	0.40	14.61		
	19	-	-	-	-	3.17	1.80	0.46	18.31	3.15	2.11	0.45	18.09	3.14	2.41	0.45	18.02	3.20	2.73	0.46	18.61		
	20	-	-	-	-	3.74	1.82	0.54	24.32	3.72	2.13	0.53	24.06	3.69	2.44	0.53	23.80	3.67	2.74	0.53	23.54		
9	3	15	1.63	1.57	0.47	19.07	1.90	1.90	0.54	24.75	2.21	2.21	0.63	32.15	2.51	2.51	0.72	40.24	2.82	2.82	0.82	49.66	
		17	2.42	1.57	0.70	37.64	2.40	1.87	0.69	37.14	2.43	2.19	0.70	37.93	2.56	2.51	0.74	41.41	2.82	2.82	0.82	49.80	
		19	-	-	-	-	3.41	1.89	0.98	68.21	3.38	2.20	0.97	67.44	3.36	2.50	0.97	66.68	3.34	2.80	0.96	65.92	
		20	-	-	-	-	3.94	1.90	1.14	89.10	3.91	2.21	1.13	87.54	3.89	2.51	1.13	87.17	3.86	2.81	1.12	86.23	
	4	15	1.45	1.44	0.31	9.57	1.78	1.78	0.38	13.60	2.09	2.09	0.45	17.88	2.40	2.40	0.52	22.69	2.71	2.71	0.59	27.96	
		17	2.06	1.42	0.44	17.38	2.09	1.74	0.45	17.85	2.22	2.07	0.48	19.73	2.42	2.41	0.52	23.04	2.71	2.71	0.59	27.93	
		19	-	-	-	-	3.09	1.76	0.67	34.75	3.07	2.07	0.66	34.36	3.05	2.37	0.66	33.95	3.07	2.68	0.66	34.47	
		20	-	-	-	-	3.63	1.78	0.79	46.45	3.61	2.09	0.78	45.94	3.59	2.39	0.78	45.45	3.57	2.69	0.77	44.95	
	5	15	1.31	1.31	0.23	4.43	1.63	1.63	0.28	7.71	1.96	1.96	0.34	10.89	2.28	2.28	0.39	14.16	2.59	2.59	0.45	17.49	
		17	1.64	1.24	0.28	7.81	1.80	1.60	0.31	9.40	2.02	1.95	0.35	11.41	2.29	2.28	0.39	14.19	2.60	2.60	0.45	17.54	
		19	-	-	-	-	2.72	1.61	0.47	18.98	2.70	1.92	0.47	18.73	2.73	2.24	0.47	19.12	2.83	2.56	0.49	20.35	
		20	-	-	-	-	3.28	1.64	0.57	26.15	3.26	1.94	0.56	25.86	3.24	2.25	0.56	25.57	3.23	2.55	0.56	25.47	
6	15	1.20	1.20	0.17	2.23	1.51	1.51	0.22	3.99	1.82	1.82	0.26	6.53	2.15	2.15	0.31	9.26	2.47	2.47	0.35	11.76		
	17	1.38	1.12	0.20	3.13	1.59	1.47	0.23	4.57	1.84	1.82	0.26	6.69	2.15	2.15	0.31	9.28	2.47	2.47	0.35	11.79		
	19	-	-	-	-	2.27	1.44	0.33	10.16	2.31	1.76	0.33	10.50	2.44	2.10	0.35	11.52	2.62	2.44	0.38	12.96		
	20	-	-	-	-	2.88	1.48	0.41	15.24	2.86	1.79	0.41	15.05	2.85	2.10	0.41	15.00	2.92	2.42	0.42	15.64		

Continued:

		MDKH2-V350-R3																				
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
11	3	15	1.26	1.26	0.36	11.99	1.58	1.58	0.45	17.68	1.90	1.90	0.54	24.14	2.21	2.21	0.63	31.28	2.51	2.51	0.72	39.66
		17	1.60	1.23	0.46	17.97	1.70	1.57	0.49	20.03	1.91	1.90	0.54	24.30	2.21	2.21	0.63	31.37	2.52	2.52	0.72	39.77
		19	-	-	-	-	2.62	1.57	0.76	42.70	2.61	1.88	0.75	42.19	2.60	2.19	0.75	42.03	2.67	2.50	0.76	43.39
		20	-	-	-	-	3.15	1.58	0.90	57.99	3.13	1.89	0.90	57.31	3.11	2.19	0.89	56.67	3.09	2.50	0.88	55.96
	4	15	1.12	1.12	0.24	5.35	1.45	1.45	0.31	9.35	1.78	1.78	0.38	13.18	2.09	2.09	0.45	17.42	2.40	2.40	0.51	22.06
		17	1.26	1.08	0.27	7.16	1.50	1.44	0.32	9.82	1.78	1.78	0.38	13.19	2.10	2.10	0.45	17.46	2.41	2.41	0.52	22.12
		19	-	-	-	-	2.24	1.43	0.48	19.59	2.24	1.74	0.48	19.59	2.33	2.07	0.50	20.92	2.49	2.40	0.53	23.36
		20	-	-	-	-	2.81	1.45	0.60	28.79	2.79	1.76	0.60	28.43	2.77	2.06	0.59	28.06	2.80	2.38	0.60	28.64
	5	15	1.01	1.01	0.17	2.29	1.32	1.32	0.23	4.67	1.64	1.64	0.28	7.88	1.97	1.97	0.34	10.81	2.29	2.29	0.39	13.80
		17	1.07	0.98	0.18	2.65	1.33	1.32	0.23	4.76	1.65	1.65	0.28	7.90	1.97	1.97	0.34	10.83	2.29	2.29	0.39	13.84
		19	-	-	-	-	1.80	1.26	0.31	9.22	1.92	1.60	0.33	10.33	2.10	1.95	0.36	12.05	2.32	2.28	0.40	14.18
		20	-	-	-	-	2.40	1.29	0.41	15.04	2.37	1.60	0.41	14.61	2.42	1.93	0.42	15.34	2.54	2.26	0.44	16.64
6	15	0.88	0.88	0.13	1.41	1.21	1.21	0.17	2.30	1.51	1.51	0.22	4.19	1.83	1.83	0.26	6.68	2.16	2.16	0.31	9.15	
	17	0.90	0.86	0.13	1.44	1.21	1.21	0.17	2.30	1.52	1.52	0.22	4.21	1.83	1.83	0.26	6.70	2.16	2.16	0.31	9.18	
	19	-	-	-	-	1.44	1.11	0.21	3.69	1.64	1.46	0.23	5.15	1.89	1.82	0.27	7.15	2.17	2.16	0.31	9.24	
	20	-	-	-	-	1.84	1.09	0.26	6.80	1.93	1.43	0.28	7.46	2.10	1.78	0.30	8.71	2.30	2.13	0.33	10.21	
13	3	15	0.93	0.93	0.27	7.06	1.27	1.27	0.36	12.03	1.59	1.59	0.46	17.69	1.90	1.90	0.55	24.08	2.20	2.20	0.63	30.77
		17	0.95	0.93	0.27	7.35	1.27	1.27	0.36	12.05	1.59	1.59	0.46	17.73	1.90	1.90	0.55	24.14	2.21	2.21	0.63	30.86
		19	-	-	-	-	1.74	1.24	0.50	20.69	1.80	1.56	0.52	21.99	1.95	1.90	0.56	25.30	2.21	2.21	0.63	30.91
		20	-	-	-	-	2.29	1.25	0.65	32.84	2.27	1.56	0.65	32.37	2.27	1.87	0.65	32.47	2.36	2.19	0.68	34.70
	4	15	0.81	0.81	0.17	2.36	1.12	1.12	0.24	5.56	1.46	1.46	0.31	9.26	1.78	1.78	0.38	13.01	2.10	2.10	0.45	17.35
		17	0.81	0.81	0.18	2.37	1.13	1.13	0.24	5.58	1.46	1.46	0.31	9.28	1.78	1.78	0.38	13.04	2.10	2.10	0.45	17.40
		19	-	-	-	-	1.35	1.08	0.29	8.09	1.55	1.44	0.33	10.31	1.80	1.78	0.38	13.21	2.10	2.10	0.45	17.45
		20	-	-	-	-	1.86	1.10	0.40	13.95	1.88	1.42	0.40	14.19	2.00	1.75	0.43	16.01	2.18	2.09	0.47	18.50
	5	15	0.68	0.68	0.12	1.25	1.01	1.01	0.17	2.33	1.32	1.32	0.23	4.80	1.65	1.65	0.28	7.80	1.97	1.97	0.34	10.59
		17	0.68	0.68	0.12	1.25	1.01	1.01	0.17	2.34	1.32	1.32	0.23	4.81	1.65	1.65	0.28	7.82	1.98	1.98	0.34	10.62
		19	-	-	-	-	1.09	0.96	0.19	2.91	1.35	1.31	0.23	5.08	1.65	1.65	0.28	7.83	1.98	1.98	0.34	10.65
		20	-	-	-	-	1.33	0.91	0.23	4.97	1.52	1.27	0.26	6.71	1.75	1.63	0.30	8.67	2.01	1.97	0.34	10.88
6	15	0.53	0.53	0.08	0.79	0.89	0.89	0.13	1.34	1.21	1.21	0.17	2.35	1.52	1.52	0.22	4.32	1.84	1.84	0.26	6.80	
	17	0.53	0.53	0.08	0.79	0.89	0.89	0.13	1.34	1.21	1.21	0.17	2.35	1.52	1.52	0.22	4.34	1.84	1.84	0.26	6.82	
	19	-	-	-	-	0.92	0.86	0.13	1.39	1.22	1.21	0.17	2.40	1.52	1.52	0.22	4.35	1.85	1.85	0.26	6.84	
	20	-	-	-	-	1.06	0.80	0.15	1.72	1.30	1.16	0.19	2.87	1.56	1.50	0.22	4.63	1.85	1.85	0.26	6.87	
15	3	15	0.61	0.61	0.17	2.39	0.93	0.93	0.27	6.98	1.26	1.26	0.36	11.70	1.59	1.59	0.46	17.42	1.89	1.89	0.54	23.35
		17	0.61	0.61	0.17	2.39	0.94	0.94	0.27	7.00	1.27	1.27	0.36	11.73	1.59	1.59	0.46	17.47	1.90	1.90	0.54	23.42
		19	-	-	-	-	0.98	0.92	0.28	7.55	1.27	1.26	0.36	11.72	1.59	1.59	0.46	17.52	1.90	1.90	0.54	23.49
		20	-	-	-	-	1.30	0.90	0.37	12.17	1.42	1.24	0.41	14.25	1.62	1.58	0.47	18.12	1.90	1.90	0.54	23.49
	4	15	0.48	0.48	0.10	1.05	0.81	0.81	0.17	2.41	1.13	1.13	0.24	5.73	1.46	1.46	0.31	9.23	1.78	1.78	0.38	12.99
		17	0.48	0.48	0.10	1.05	0.81	0.81	0.17	2.42	1.13	1.13	0.24	5.75	1.47	1.47	0.32	9.26	1.79	1.79	0.39	13.02
		19	-	-	-	-	0.82	0.81	0.18	2.46	1.13	1.13	0.24	5.77	1.47	1.47	0.32	9.30	1.79	1.79	0.39	13.06
		20	-	-	-	-	0.92	0.76	0.20	3.45	1.18	1.12	0.25	6.29	1.47	1.47	0.32	9.36	1.79	1.79	0.39	13.08
	5	15	0.31	0.31	0.05	0.54	0.69	0.69	0.12	1.20	1.01	1.01	0.17	2.47	1.33	1.33	0.23	5.05	1.66	1.66	0.29	7.82
		17	0.31	0.31	0.05	0.54	0.69	0.69	0.12	1.21	1.01	1.01	0.17	2.48	1.33	1.33	0.23	5.06	1.66	1.66	0.29	7.84
		19	-	-	-	-	0.69	0.69	0.12	1.21	1.02	1.02	0.17	2.48	1.33	1.33	0.23	5.08	1.66	1.66	0.29	7.86
		20	-	-	-	-	0.73	0.66	0.13	1.28	1.03	1.01	0.18	2.56	1.33	1.33	0.23	5.08	1.66	1.66	0.29	7.88
6	15	-	-	-	-	0.53	0.53	0.08	0.76	0.89	0.89	0.13	1.30	1.21	1.21	0.17	2.47	1.52	1.52	0.22	4.55	
	17	-	-	-	-	0.53	0.53	0.08	0.77	0.89	0.89	0.13	1.30	1.21	1.21	0.17	2.48	1.52	1.52	0.22	4.56	
	19	-	-	-	-	0.54	0.54	0.08	0.77	0.90	0.90	0.13	1.30	1.21	1.21	0.17	2.49	1.53	1.53	0.22	4.58	
	20	-	-	-	-	0.54	0.53	0.08	0.77	0.90	0.90	0.13	1.30	1.22	1.22	0.17	2.49	1.53	1.53	0.22	4.59	

MDKH2)-V500-R3																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
5	3	15	3.61	2.72	1.04	77.73	3.59	3.10	1.04	77.42	3.64	3.49	1.05	78.52	3.88	3.88	1.12	88.62	4.26	4.26	1.23	104.58
		17	4.75	2.73	1.38	127.02	4.73	3.12	1.37	125.77	4.70	3.49	1.36	123.30	4.67	3.87	1.35	121.82	4.65	4.24	1.34	121.65
		19	-	-	-	-	5.94	3.13	1.71	185.67	5.91	3.51	1.70	183.89	5.88	3.88	1.70	182.19	5.84	4.25	1.69	180.43
		20	-	-	-	-	6.59	3.13	1.90	222.42	6.55	3.51	1.89	220.41	6.52	3.89	1.88	218.34	6.48	4.26	1.87	216.32
	4	15	3.23	2.54	0.69	38.53	3.27	2.94	0.70	39.55	3.43	3.34	0.74	42.67	3.74	3.74	0.80	49.56	4.11	4.11	0.89	59.14
		17	4.40	2.57	0.95	65.71	4.37	2.95	0.94	65.06	4.35	3.33	0.94	64.66	4.33	3.71	0.94	64.67	4.38	4.09	0.94	65.25
		19	-	-	-	-	5.62	2.97	1.22	101.72	5.59	3.35	1.21	100.76	5.55	3.73	1.20	99.78	5.53	4.10	1.20	98.88
		20	-	-	-	-	6.27	2.98	1.36	123.37	6.23	3.36	1.35	122.27	6.19	3.74	1.34	119.75	6.16	4.11	1.33	118.64
	5	15	2.84	2.36	0.49	20.97	2.98	2.77	0.51	22.82	3.23	3.19	0.55	26.12	3.59	3.59	0.62	31.59	3.97	3.97	0.68	37.56
		17	4.02	2.40	0.69	38.37	4.00	2.78	0.69	38.00	3.98	3.16	0.69	37.60	4.01	3.55	0.69	38.24	4.14	3.95	0.71	40.43
		19	-	-	-	-	5.25	2.81	0.90	60.42	5.22	3.19	0.90	59.84	5.19	3.57	0.89	59.28	5.17	3.94	0.89	58.79
		20	-	-	-	-	5.91	2.82	1.02	74.18	5.88	3.20	1.01	73.62	5.85	3.58	1.01	73.18	5.82	3.96	1.01	72.86
6	15	2.48	2.17	0.36	12.24	2.73	2.61	0.39	14.40	3.04	3.03	0.43	17.22	3.43	3.43	0.49	21.14	3.81	3.81	0.55	25.36	
	17	3.58	2.20	0.51	22.72	3.56	2.58	0.51	22.46	3.59	2.98	0.51	22.80	3.71	3.39	0.53	24.21	3.92	3.80	0.56	26.53	
	19	-	-	-	-	4.85	2.63	0.69	38.32	4.83	3.01	0.69	37.96	4.80	3.39	0.69	37.60	4.77	3.77	0.68	37.24	
	20	-	-	-	-	5.53	2.65	0.80	48.37	5.51	3.03	0.79	47.93	5.48	3.41	0.79	47.48	5.45	3.79	0.78	47.04	
7	3	15	2.74	2.32	0.79	47.43	2.85	2.72	0.82	51.14	3.12	3.11	0.90	59.26	3.50	3.50	1.01	73.00	3.88	3.88	1.12	87.69
		17	3.90	2.33	1.12	87.60	3.88	2.72	1.12	87.68	3.86	3.10	1.12	87.11	3.85	3.48	1.12	87.00	3.96	3.87	1.14	90.05
		19	-	-	-	-	5.10	2.73	1.48	141.16	5.08	3.12	1.48	140.98	5.05	3.50	1.47	140.52	5.02	3.87	1.45	136.88
		20	-	-	-	-	5.76	2.74	1.68	176.62	5.73	3.13	1.67	174.98	5.70	3.51	1.66	173.35	5.66	3.88	1.65	171.73
	4	15	2.41	2.15	0.52	23.06	2.63	2.57	0.57	26.70	2.97	2.97	0.64	33.36	3.36	3.36	0.73	41.12	3.74	3.74	0.81	49.47
		17	3.52	2.17	0.76	44.58	3.50	2.55	0.76	44.10	3.49	2.94	0.76	43.91	3.58	3.34	0.77	45.89	3.78	3.74	0.82	50.36
		19	-	-	-	-	4.75	2.58	1.03	74.77	4.72	2.96	1.02	74.02	4.69	3.34	1.02	73.29	4.67	3.71	1.01	72.54
		20	-	-	-	-	5.41	2.59	1.17	94.19	5.38	2.97	1.17	93.28	5.35	3.35	1.16	92.39	5.32	3.73	1.15	91.50
	5	15	2.12	1.98	0.36	12.56	2.43	2.42	0.42	15.95	2.82	2.82	0.48	20.44	3.21	3.21	0.55	25.51	3.59	3.59	0.62	31.25
		17	3.08	1.98	0.53	23.71	3.06	2.37	0.53	23.53	3.15	2.77	0.54	24.74	3.34	3.19	0.58	27.53	3.61	3.60	0.62	31.46
		19	-	-	-	-	4.35	2.41	0.75	43.49	4.33	2.79	0.75	43.05	4.30	3.25	0.74	54.22	4.29	3.55	0.74	42.44
		20	-	-	-	-	5.01	2.42	0.86	55.09	4.98	2.80	0.86	54.55	4.96	3.18	0.85	54.02	4.93	3.56	0.85	53.49
6	15	1.86	1.80	0.27	6.68	2.23	2.23	0.32	10.02	2.65	2.65	0.38	13.54	3.05	3.05	0.44	17.10	3.44	3.44	0.49	21.04	
	17	2.54	1.76	0.36	12.52	2.65	2.18	0.38	13.55	2.85	2.61	0.41	15.19	3.11	3.04	0.45	17.73	3.44	3.44	0.49	21.09	
	19	-	-	-	-	3.91	2.22	0.56	26.24	3.89	2.61	0.56	25.97	3.87	2.99	0.56	25.82	3.95	3.39	0.57	26.67	
	20	-	-	-	-	4.59	2.24	0.66	34.35	4.56	2.63	0.65	34.02	4.54	3.01	0.65	33.68	4.51	3.39	0.65	33.33	
9	3	15	2.01	1.95	0.58	27.70	2.35	2.34	0.67	35.68	2.74	2.74	0.79	47.18	3.12	3.12	0.90	58.40	3.49	3.49	1.01	71.35
		17	2.97	1.93	0.86	53.84	2.95	2.32	0.85	53.14	2.99	2.71	0.86	54.38	3.16	3.12	0.92	60.73	3.50	3.50	1.01	71.53
		19	-	-	-	-	4.20	2.34	1.21	98.47	4.17	2.72	1.21	97.45	4.15	3.10	1.20	96.40	4.12	3.48	1.19	95.32
		20	-	-	-	-	4.86	2.35	1.42	129.17	4.83	2.74	1.41	128.03	4.81	3.12	1.40	126.71	4.78	3.49	1.39	125.37
	4	15	1.80	1.79	0.39	13.90	2.19	2.19	0.47	19.38	2.59	2.59	0.56	25.88	2.97	2.97	0.64	32.55	3.36	3.36	0.73	40.54
		17	2.54	1.75	0.55	25.00	2.57	2.15	0.56	25.57	2.72	2.56	0.59	27.98	2.99	2.98	0.64	32.79	3.36	3.36	0.73	40.64
		19	-	-	-	-	3.80	2.17	0.82	49.69	3.78	2.56	0.81	49.16	3.75	2.94	0.81	48.60	3.78	3.33	0.82	49.36
		20	-	-	-	-	4.46	2.19	0.96	65.76	4.44	2.57	0.96	65.09	4.41	2.95	0.95	64.43	4.38	3.33	0.95	63.76
	5	15	1.60	1.60	0.28	7.36	2.02	2.02	0.35	11.44	2.43	2.43	0.42	15.62	2.82	2.82	0.49	20.21	3.21	3.21	0.55	25.20
		17	2.03	1.55	0.35	11.51	2.23	1.98	0.38	13.46	2.49	2.41	0.43	16.32	2.83	2.82	0.49	20.25	3.21	3.21	0.55	25.26
		19	-	-	-	-	3.35	1.99	0.58	27.06	3.32	2.38	0.57	26.70	3.36	2.77	0.58	27.26	3.49	3.18	0.60	29.03
		20	-	-	-	-	4.04	2.02	0.70	37.49	4.01	2.40	0.69	37.08	3.99	2.78	0.69	36.70	3.98	3.17	0.69	36.51
6	15	1.44	1.44	0.21	3.53	1.83	1.83	0.26	6.65	2.25	2.25	0.32	10.06	2.66	2.66	0.38	13.34	3.06	3.06	0.44	16.89	
	17	1.62	1.36	0.23	4.90	1.92	1.80	0.28	7.41	2.27	2.25	0.33	10.21	2.66	2.66	0.38	13.37	3.06	3.06	0.44	16.93	
	19	-	-	-	-	2.81	1.78	0.40	14.58	2.85	2.19	0.41	14.97	3.01	2.61	0.43	16.40	3.23	3.03	0.46	18.50	
	20	-	-	-	-	3.54	1.82	0.51	21.70	3.52	2.21	0.51	21.45	3.51	2.60	0.50	21.34	3.59	3.00	0.52	22.24	

Continued:

		MDKH2-V500-R3																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.56	1.56	0.44	17.18	1.96	1.96	0.56	25.43	2.35	2.35	0.67	35.05	2.73	2.73	0.78	45.30	3.11	3.11	0.89	56.85	
		17	1.96	1.52	0.56	25.52	2.09	1.94	0.60	28.60	2.36	2.35	0.68	35.21	2.74	2.74	0.78	45.41	3.12	3.12	0.89	57.00	
		19	-	-	-	-	3.22	1.94	0.92	60.15	3.20	2.32	0.91	59.43	3.19	2.71	0.91	59.25	3.29	3.11	0.95	63.44	
		20	-	-	-	-	3.89	1.95	1.12	84.90	3.86	2.34	1.12	83.96	3.84	2.72	1.11	83.05	3.81	3.10	1.10	82.05	
	4	15	1.38	1.38	0.30	8.53	1.80	1.80	0.38	13.40	2.20	2.20	0.47	18.91	2.59	2.59	0.56	25.07	2.98	2.98	0.64	32.01	
		17	1.56	1.34	0.33	10.54	1.85	1.79	0.40	14.04	2.20	2.20	0.47	18.93	2.59	2.59	0.56	25.13	2.98	2.98	0.64	32.09	
		19	-	-	-	-	2.76	1.76	0.59	27.90	2.76	2.15	0.59	27.86	2.87	2.56	0.62	29.90	3.07	2.97	0.66	33.68	
		20	-	-	-	-	3.44	1.78	0.74	40.90	3.42	2.17	0.73	40.44	3.39	2.55	0.73	39.93	3.44	2.94	0.74	40.78	
	5	15	1.21	1.21	0.21	3.71	1.62	1.62	0.28	7.62	2.04	2.04	0.35	11.41	2.44	2.44	0.42	15.52	2.83	2.83	0.49	20.03	
		17	1.27	1.18	0.22	4.20	1.62	1.62	0.28	7.69	2.04	2.04	0.35	11.43	2.44	2.44	0.42	15.55	2.84	2.84	0.49	20.08	
		19	-	-	-	-	2.21	1.56	0.38	12.95	2.36	1.98	0.40	14.52	2.59	2.41	0.45	17.19	2.87	2.83	0.49	20.51	
		20	-	-	-	-	2.95	1.60	0.51	21.38	2.92	1.98	0.50	21.08	2.98	2.38	0.51	21.76	3.13	2.80	0.54	23.69	
	6	15	1.06	1.06	0.15	1.76	1.45	1.45	0.21	3.73	1.85	1.85	0.26	6.83	2.27	2.27	0.32	9.95	2.67	2.67	0.38	13.15	
		17	1.08	1.05	0.16	1.81	1.45	1.45	0.21	3.73	1.85	1.85	0.26	6.85	2.27	2.27	0.32	9.97	2.67	2.67	0.38	13.18	
		19	-	-	-	-	1.71	1.35	0.24	5.72	2.01	1.81	0.29	8.05	2.33	2.25	0.33	10.46	2.68	2.68	0.38	13.26	
		20	-	-	-	-	2.30	1.36	0.33	10.14	2.38	1.78	0.34	10.81	2.59	2.21	0.37	12.44	2.84	2.64	0.41	14.71	
	13	3	15	1.15	1.15	0.33	10.27	1.56	1.56	0.45	17.25	1.96	1.96	0.56	25.43	2.35	2.35	0.67	34.32	2.73	2.73	0.79	45.25
			17	1.17	1.15	0.34	10.60	1.56	1.56	0.45	17.28	1.96	1.96	0.56	25.49	2.35	2.35	0.67	34.41	2.74	2.74	0.79	45.36
			19	-	-	-	-	2.12	1.52	0.61	28.71	2.20	1.93	0.63	30.70	2.41	2.35	0.69	35.81	2.74	2.74	0.79	45.44
			20	-	-	-	-	2.82	1.55	0.81	47.67	2.80	1.93	0.81	47.04	2.80	2.32	0.81	47.12	2.91	2.72	0.83	49.76
		4	15	0.97	0.97	0.21	3.87	1.39	1.39	0.30	8.52	1.80	1.80	0.39	13.28	2.20	2.20	0.47	18.90	2.59	2.59	0.56	25.00
			17	0.97	0.97	0.21	3.87	1.39	1.39	0.30	8.54	1.80	1.80	0.39	13.31	2.21	2.21	0.48	18.94	2.60	2.60	0.56	25.06
			19	-	-	-	-	1.66	1.34	0.36	11.52	1.92	1.78	0.41	14.88	2.22	2.21	0.48	19.15	2.60	2.60	0.56	25.13
			20	-	-	-	-	2.29	1.36	0.49	20.15	2.31	1.76	0.50	20.41	2.46	2.17	0.53	22.74	2.68	2.59	0.58	26.46
5		15	0.82	0.82	0.14	1.52	1.21	1.21	0.21	3.83	1.63	1.63	0.28	7.60	2.04	2.04	0.35	11.20	2.44	2.44	0.42	15.35	
		17	0.82	0.82	0.14	1.52	1.21	1.21	0.21	3.84	1.63	1.63	0.28	7.62	2.04	2.04	0.35	11.23	2.45	2.45	0.42	15.38	
		19	-	-	-	-	1.30	1.17	0.22	4.63	1.66	1.62	0.28	7.88	2.05	2.04	0.35	11.24	2.45	2.45	0.42	15.42	
		20	-	-	-	-	1.64	1.13	0.28	7.69	1.88	1.58	0.32	9.74	2.16	2.02	0.37	12.36	2.48	2.45	0.43	15.72	
6		15	0.63	0.63	0.09	0.94	1.07	1.07	0.15	1.74	1.45	1.45	0.21	3.86	1.86	1.86	0.27	6.97	2.28	2.28	0.33	9.97	
		17	0.63	0.63	0.09	0.94	1.07	1.07	0.15	1.74	1.45	1.45	0.21	3.87	1.87	1.87	0.27	6.99	2.29	2.29	0.33	10.00	
		19	-	-	-	-	1.10	1.04	0.16	1.86	1.46	1.45	0.21	3.90	1.87	1.87	0.27	7.01	2.29	2.29	0.33	10.02	
		20	-	-	-	-	1.24	0.96	0.18	2.51	1.55	1.41	0.22	4.58	1.91	1.85	0.27	7.29	2.29	2.29	0.33	10.05	
15		3	15	0.73	0.73	0.21	3.92	1.15	1.15	0.33	10.02	1.57	1.57	0.45	17.04	1.96	1.96	0.56	24.71	2.34	2.34	0.67	33.77
			17	0.73	0.73	0.21	3.94	1.16	1.16	0.33	10.05	1.57	1.57	0.45	17.08	1.96	1.96	0.56	24.77	2.35	2.35	0.67	33.86
			19	-	-	-	-	1.21	1.14	0.34	10.78	1.57	1.56	0.45	17.07	1.96	1.96	0.56	24.83	2.35	2.35	0.67	33.95
			20	-	-	-	-	1.60	1.12	0.46	17.63	1.75	1.54	0.50	20.57	1.99	1.96	0.57	25.54	2.35	2.35	0.67	33.96
		4	15	0.57	0.57	0.12	1.26	0.97	0.97	0.21	3.98	1.40	1.40	0.30	8.49	1.81	1.81	0.39	13.31	2.20	2.20	0.47	18.45
			17	0.57	0.57	0.12	1.26	0.98	0.98	0.21	3.99	1.40	1.40	0.30	8.50	1.81	1.81	0.39	13.34	2.21	2.21	0.47	18.50
			19	-	-	-	-	0.98	0.98	0.21	4.02	1.40	1.40	0.30	8.52	1.82	1.82	0.39	13.37	2.21	2.21	0.47	18.55
			20	-	-	-	-	1.11	0.93	0.24	5.49	1.46	1.38	0.31	9.17	1.82	1.82	0.39	13.42	2.21	2.21	0.47	18.57
	5	15	0.37	0.37	0.06	0.64	0.83	0.83	0.14	1.52	1.22	1.22	0.21	4.08	1.64	1.64	0.28	7.68	2.05	2.05	0.35	11.22	
		17	0.37	0.37	0.06	0.64	0.83	0.83	0.14	1.53	1.22	1.22	0.21	4.10	1.64	1.64	0.28	7.70	2.05	2.05	0.35	11.24	
		19	-	-	-	-	0.83	0.83	0.14	1.53	1.22	1.22	0.21	4.11	1.65	1.65	0.28	7.71	2.06	2.06	0.35	11.27	
		20	-	-	-	-	0.87	0.80	0.15	1.69	1.23	1.22	0.21	4.17	1.64	1.64	0.28	7.71	2.06	2.06	0.35	11.29	
	6	15	-	-	-	-	0.64	0.64	0.09	0.91	1.07	1.07	0.15	1.80	1.46	1.46	0.21	4.10	1.88	1.88	0.27	7.00	
		17	-	-	-	-	0.64	0.64	0.09	0.91	1.08	1.08	0.15	1.81	1.46	1.46	0.21	4.11	1.88	1.88	0.27	7.02	
		19	-	-	-	-	0.64	0.64	0.09	0.92	1.08	1.08	0.15	1.81	1.46	1.46	0.21	4.12	1.88	1.88	0.27	7.03	
		20	-	-	-	-	0.64	0.63	0.09	0.92	1.08	1.07	0.15	1.81	1.47	1.47	0.21	4.13	1.88	1.88	0.27	7.04	

MDKH2-V700-R3																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	4.80	3.67	1.38	65.94	4.77	4.20	1.38	65.37	4.89	4.74	1.41	67.70	5.28	5.28	1.52	77.74	5.80	5.80	1.68	92.17
		17	6.37	3.68	1.85	108.73	6.34	4.21	1.84	107.77	6.31	4.74	1.83	106.78	6.27	5.26	1.82	105.81	6.27	5.79	1.81	105.52
		19	-	-	-	-	8.02	4.22	2.31	161.06	7.98	4.75	2.30	159.66	7.93	5.28	2.29	158.24	7.90	5.80	2.28	156.90
		20	-	-	-	-	8.91	4.23	2.57	193.67	8.86	4.76	2.56	192.03	8.82	5.28	2.54	190.46	8.78	5.80	2.53	188.90
	4	15	4.21	3.39	0.90	31.36	4.30	3.95	0.92	32.59	4.57	4.51	0.98	36.30	5.05	5.05	1.08	43.09	5.57	5.57	1.20	51.13
		17	5.82	3.43	1.25	55.32	5.79	3.96	1.25	54.83	5.76	4.49	1.24	54.33	5.74	5.02	1.24	54.05	5.86	5.56	1.27	56.26
		19	-	-	-	-	7.50	3.98	1.62	86.54	7.45	4.51	1.60	84.76	7.42	5.04	1.60	84.05	7.38	5.56	1.59	83.31
		20	-	-	-	-	8.40	3.99	1.82	105.59	8.36	4.52	1.81	104.68	8.32	5.05	1.80	103.80	8.28	5.57	1.79	102.91
	5	15	3.64	3.12	0.63	16.80	3.90	3.71	0.67	18.89	4.29	4.27	0.74	22.05	4.81	4.81	0.83	26.90	5.35	5.35	0.92	32.48
		17	5.23	3.16	0.90	31.22	5.21	3.70	0.90	30.94	5.18	4.23	0.89	30.68	5.28	4.77	0.91	31.68	5.51	5.33	0.95	34.16
		19	-	-	-	-	6.94	3.73	1.20	50.87	6.91	4.26	1.19	50.45	6.86	4.78	1.18	49.48	6.82	5.31	1.17	49.04
		20	-	-	-	-	7.84	3.74	1.35	62.67	7.80	4.27	1.34	62.04	7.76	4.80	1.33	61.31	7.72	5.32	1.33	60.79
6	15	3.11	2.83	0.45	9.29	3.53	3.45	0.51	11.62	4.02	4.02	0.58	14.54	4.57	4.57	0.65	17.94	5.11	5.11	0.73	21.70	
	17	4.54	2.86	0.65	17.73	4.51	3.39	0.65	17.53	4.61	3.95	0.66	18.17	4.84	4.53	0.69	19.80	5.18	5.10	0.74	22.25	
	19	-	-	-	-	6.32	3.46	0.91	31.45	6.29	3.99	0.90	31.17	6.26	4.52	0.90	30.89	6.23	5.05	0.89	30.67	
	20	-	-	-	-	7.24	3.48	1.04	39.45	7.20	4.01	1.03	39.10	7.16	4.54	1.03	38.76	7.13	5.06	1.02	38.44	
7	3	15	3.61	3.12	1.05	39.90	3.79	3.68	1.09	42.84	4.23	4.23	1.22	52.01	4.75	4.75	1.37	63.55	5.28	5.28	1.52	76.28
		17	5.18	3.13	1.49	73.91	5.16	3.67	1.49	73.63	5.13	4.20	1.48	73.09	5.15	4.73	1.49	73.57	5.35	5.28	1.54	78.14
		19	-	-	-	-	6.86	3.69	2.00	122.89	6.83	4.22	1.99	121.83	6.79	4.75	1.98	120.73	6.76	5.27	1.97	119.62
		20	-	-	-	-	7.76	3.70	2.26	152.89	7.72	4.23	2.25	151.48	7.68	4.76	2.24	150.16	7.64	5.28	2.23	148.87
	4	15	3.13	2.87	0.67	18.65	3.48	3.45	0.75	22.43	4.00	4.00	0.86	28.41	4.53	4.53	0.98	35.54	5.06	5.06	1.10	43.12
		17	4.59	2.87	0.99	36.02	4.56	3.41	0.98	35.65	4.57	3.95	0.98	35.82	4.75	4.51	1.02	38.22	5.08	5.06	1.10	43.47
		19	-	-	-	-	6.30	3.44	1.36	63.02	6.26	3.98	1.36	62.42	6.23	4.50	1.35	61.87	6.19	5.03	1.34	61.27
		20	-	-	-	-	7.20	3.45	1.56	79.27	7.16	3.99	1.55	78.44	7.12	4.51	1.54	77.53	7.08	5.04	1.53	76.69
	5	15	2.71	2.60	0.47	9.96	3.20	3.20	0.55	13.20	3.75	3.75	0.65	17.33	4.29	4.29	0.74	21.84	4.83	4.83	0.84	26.95
		17	3.91	2.59	0.67	18.56	3.91	3.13	0.67	18.58	4.09	3.70	0.70	20.08	4.40	4.28	0.76	22.77	4.84	4.84	0.84	27.01
		19	-	-	-	-	5.67	3.18	0.98	35.16	5.64	3.71	0.97	34.83	5.60	4.62	0.96	50.67	5.62	4.77	0.97	34.65
		20	-	-	-	-	6.60	3.20	1.14	46.10	6.57	3.74	1.14	45.70	6.53	4.27	1.13	45.28	6.50	4.79	1.12	44.88
6	15	2.37	2.34	0.34	5.05	2.92	2.92	0.42	8.17	3.49	3.49	0.50	11.19	4.05	4.05	0.58	14.39	4.59	4.59	0.66	17.91	
	17	3.09	2.26	0.44	9.09	3.32	2.85	0.48	10.26	3.66	3.45	0.53	12.14	4.09	4.04	0.59	14.63	4.60	4.60	0.66	17.95	
	19	-	-	-	-	4.99	2.90	0.72	20.57	4.95	3.43	0.71	20.35	4.97	3.97	0.71	20.44	5.12	4.53	0.74	21.56	
	20	-	-	-	-	5.95	2.93	0.86	27.92	5.91	3.47	0.85	27.66	5.88	4.00	0.85	27.40	5.85	4.53	0.84	27.15	
9	3	15	2.65	2.60	0.76	22.77	3.16	3.16	0.92	31.26	3.70	3.70	1.07	40.68	4.23	4.23	1.22	51.11	4.75	4.75	1.37	62.79
		17	3.92	2.59	1.14	45.31	3.89	3.13	1.13	44.75	3.98	3.68	1.15	46.51	4.25	4.23	1.22	51.66	4.76	4.76	1.37	62.81
		19	-	-	-	-	5.59	3.14	1.61	83.37	5.56	3.68	1.60	82.54	5.53	4.21	1.60	81.75	5.50	4.73	1.59	80.95
		20	-	-	-	-	6.49	3.15	1.88	108.57	6.47	3.69	1.89	109.78	6.43	4.22	1.86	106.57	6.39	4.74	1.85	105.57
	4	15	2.36	2.36	0.51	11.35	2.92	2.92	0.63	16.36	3.47	3.47	0.75	22.04	4.00	4.00	0.86	28.09	4.53	4.53	0.98	34.84
		17	3.23	2.31	0.70	19.47	3.32	2.87	0.72	20.42	3.60	3.45	0.78	23.57	4.01	4.01	0.86	28.15	4.54	4.54	0.98	34.92
		19	-	-	-	-	4.99	2.90	1.08	41.46	4.96	3.43	1.07	41.04	4.92	3.96	1.06	40.05	5.01	4.51	1.09	41.81
		20	-	-	-	-	5.90	2.91	1.28	55.57	5.87	3.45	1.27	55.05	5.84	3.98	1.27	54.52	5.81	4.50	1.26	53.97
	5	15	2.07	2.07	0.36	5.84	2.65	2.65	0.46	9.47	3.22	3.22	0.55	13.14	3.77	3.77	0.65	17.20	4.31	4.31	0.74	21.63
		17	2.50	2.00	0.43	8.51	2.84	2.62	0.49	10.59	3.26	3.21	0.56	13.42	3.77	3.77	0.65	17.23	4.31	4.31	0.74	21.68
		19	-	-	-	-	4.28	2.62	0.74	21.34	4.25	3.15	0.73	21.08	4.35	3.71	0.75	21.95	4.58	4.27	0.79	24.03
		20	-	-	-	-	5.22	2.64	0.90	30.09	5.19	3.18	0.89	29.79	5.16	3.71	0.89	29.47	5.17	4.25	0.89	29.59
6	15	1.85	1.85	0.27	2.70	2.37	2.37	0.34	5.24	2.95	2.95	0.42	8.28	3.52	3.52	0.50	11.17	4.07	4.07	0.58	14.31	
	17	2.01	1.76	0.29	3.38	2.43	2.35	0.35	5.55	2.95	2.95	0.42	8.30	3.52	3.52	0.51	11.19	4.07	4.07	0.58	14.34	
	19	-	-	-	-	3.44	2.30	0.49	10.73	3.57	2.87	0.51	11.44	3.85	3.46	0.55	13.02	4.21	4.05	0.60	15.16	
	20	-	-	-	-	4.47	2.35	0.64	16.76	4.44	2.89	0.64	16.56	4.46	3.43	0.64	16.68	4.63	4.00	0.66	17.82	

Continued:

		MDKH2-V700-R3																				
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
11	3	15	2.07	2.07	0.59	14.61	2.62	2.62	0.75	21.78	3.16	3.16	0.90	30.09	3.70	3.70	1.07	40.03	4.23	4.23	1.21	49.78
		17	2.51	2.02	0.72	20.23	2.75	2.60	0.78	23.61	3.16	3.16	0.90	30.11	3.71	3.71	1.07	40.12	4.24	4.24	1.22	50.62
		19	-	-	-	-	4.25	2.60	1.22	50.74	4.22	3.14	1.21	50.16	4.22	3.67	1.21	49.52	4.41	4.23	1.27	54.16
		20	-	-	-	-	5.16	2.61	1.49	71.32	5.13	3.15	1.48	70.57	5.10	3.68	1.47	69.85	5.06	4.21	1.46	69.08
	4	15	1.79	1.79	0.38	6.92	2.37	2.37	0.51	11.21	2.93	2.93	0.63	16.06	3.48	3.48	0.74	21.52	4.01	4.01	0.86	27.56
		17	1.95	1.76	0.42	8.04	2.40	2.37	0.51	11.45	2.93	2.93	0.63	16.09	3.48	3.48	0.75	21.57	4.02	4.02	0.86	27.63
		19	-	-	-	-	3.52	2.33	0.76	22.00	3.55	2.87	0.76	22.27	3.75	3.44	0.80	24.54	4.08	4.01	0.88	28.43
		20	-	-	-	-	4.48	2.35	0.96	33.43	4.45	2.89	0.96	33.07	4.42	3.43	0.95	32.71	4.52	3.98	0.98	34.19
	5	15	1.55	1.55	0.27	2.84	2.10	2.10	0.36	6.11	2.68	2.68	0.46	9.48	3.24	3.24	0.55	12.97	3.79	3.79	0.65	17.10
		17	1.59	1.53	0.27	3.03	2.10	2.09	0.36	6.12	2.68	2.68	0.46	9.50	3.24	3.24	0.56	13.00	3.79	3.79	0.65	17.14
		19	-	-	-	-	2.73	2.03	0.47	9.76	3.00	2.63	0.52	11.49	3.36	3.21	0.58	13.83	3.81	3.79	0.66	17.27
		20	-	-	-	-	3.71	2.07	0.64	16.46	3.68	2.61	0.63	16.25	3.81	3.17	0.66	17.26	4.07	3.75	0.70	19.35
6	15	1.34	1.34	0.19	1.37	1.86	1.86	0.27	2.86	2.39	2.39	0.34	5.44	2.98	2.98	0.43	8.23	3.54	3.54	0.51	11.05	
	17	1.34	1.33	0.19	1.38	1.86	1.86	0.27	2.87	2.40	2.40	0.34	5.46	2.98	2.98	0.43	8.24	3.54	3.54	0.51	11.07	
	19	-	-	-	-	2.09	1.75	0.30	3.93	2.51	2.36	0.36	6.06	3.02	2.97	0.43	8.42	3.55	3.54	0.51	11.09	
	20	-	-	-	-	2.69	1.71	0.39	6.91	2.92	2.31	0.42	7.97	3.28	2.92	0.47	9.68	3.68	3.52	0.53	11.78	
13	3	15	1.51	1.51	0.43	8.48	2.08	2.08	0.59	14.37	2.63	2.63	0.76	21.85	3.17	3.17	0.90	29.73	3.70	3.70	1.06	38.99
		17	1.52	1.51	0.44	8.57	2.08	2.08	0.59	14.40	2.63	2.63	0.76	21.90	3.17	3.17	0.91	29.79	3.71	3.71	1.06	39.08
		19	-	-	-	-	2.73	2.03	0.79	23.27	2.89	2.60	0.83	25.62	3.21	3.17	0.92	30.42	3.71	3.71	1.06	39.19
		20	-	-	-	-	3.66	2.05	1.05	38.21	3.63	2.59	1.04	37.66	3.67	3.13	1.05	38.29	3.88	3.69	1.11	42.49
	4	15	1.25	1.25	0.27	2.96	1.81	1.81	0.39	6.98	2.39	2.39	0.51	11.14	2.94	2.94	0.63	16.11	3.49	3.49	0.75	21.52
		17	1.25	1.24	0.27	2.96	1.81	1.81	0.39	6.99	2.39	2.39	0.51	11.17	2.95	2.95	0.64	16.14	3.49	3.49	0.75	21.57
		19	-	-	-	-	2.07	1.76	0.44	8.76	2.48	2.37	0.53	11.86	2.95	2.95	0.64	16.18	3.49	3.49	0.75	21.62
		20	-	-	-	-	2.87	1.77	0.62	15.38	2.93	2.33	0.63	15.97	3.19	2.91	0.69	18.48	3.55	3.49	0.77	22.25
	5	15	1.03	1.03	0.18	1.20	1.55	1.55	0.27	2.93	2.11	2.11	0.36	6.17	2.69	2.69	0.46	9.35	3.25	3.25	0.56	12.88
		17	1.03	1.03	0.18	1.20	1.56	1.56	0.27	2.94	2.12	2.12	0.36	6.19	2.70	2.70	0.46	9.37	3.25	3.25	0.56	12.90
		19	-	-	-	-	1.62	1.52	0.28	3.28	2.13	2.12	0.37	6.25	2.69	2.69	0.46	9.39	3.26	3.26	0.56	12.93
		20	-	-	-	-	1.93	1.44	0.33	5.13	2.35	2.07	0.40	7.39	2.79	2.68	0.48	9.92	3.27	3.26	0.56	13.00
6	15	0.76	0.76	0.11	0.72	1.35	1.35	0.19	1.34	1.86	1.86	0.27	2.97	2.42	2.42	0.35	5.62	3.00	3.00	0.43	8.22	
	17	0.76	0.76	0.11	0.72	1.35	1.35	0.19	1.34	1.87	1.87	0.27	2.97	2.42	2.42	0.35	5.64	3.00	3.00	0.43	8.23	
	19	-	-	-	-	1.37	1.34	0.20	1.37	1.87	1.86	0.27	2.98	2.42	2.42	0.35	5.65	3.01	3.01	0.43	8.25	
	20	-	-	-	-	1.51	1.25	0.22	1.69	1.93	1.83	0.28	3.27	2.44	2.42	0.35	5.72	3.01	3.00	0.43	8.25	
15	3	15	0.94	0.94	0.27	3.00	1.52	1.52	0.43	8.31	2.09	2.09	0.60	14.48	2.63	2.63	0.75	21.26	3.17	3.17	0.91	29.33
		17	0.94	0.94	0.27	3.01	1.52	1.52	0.43	8.32	2.09	2.09	0.60	14.51	2.63	2.63	0.75	21.31	3.17	3.17	0.91	29.40
		19	-	-	-	-	1.55	1.51	0.44	8.62	2.09	2.08	0.60	14.50	2.64	2.64	0.75	21.36	3.18	3.18	0.91	29.47
		20	-	-	-	-	1.98	1.47	0.57	13.09	2.26	2.06	0.65	16.63	2.65	2.63	0.76	21.60	3.18	3.18	0.91	29.51
	4	15	0.71	0.71	0.15	1.00	1.25	1.25	0.27	3.05	1.83	1.83	0.39	6.98	2.40	2.40	0.52	11.21	2.95	2.95	0.64	15.95
		17	0.71	0.71	0.15	1.00	1.25	1.25	0.27	3.06	1.83	1.83	0.39	7.00	2.41	2.41	0.52	11.24	2.96	2.96	0.64	15.99
		19	-	-	-	-	1.25	1.24	0.27	3.05	1.83	1.83	0.39	7.01	2.41	2.41	0.52	11.26	2.96	2.96	0.64	16.02
		20	-	-	-	-	1.35	1.20	0.29	3.78	1.87	1.82	0.40	7.24	2.41	2.40	0.52	11.25	2.96	2.96	0.64	16.04
	5	15	0.43	0.43	0.07	0.47	1.04	1.04	0.18	1.18	1.57	1.57	0.27	3.14	2.14	2.14	0.37	6.29	2.71	2.71	0.47	9.40
		17	0.43	0.43	0.07	0.47	1.04	1.04	0.18	1.18	1.57	1.57	0.27	3.15	2.14	2.14	0.37	6.30	2.72	2.72	0.47	9.42
		19	-	-	-	-	1.04	1.04	0.18	1.18	1.57	1.57	0.27	3.16	2.15	2.15	0.37	6.32	2.72	2.72	0.47	9.44
		20	-	-	-	-	1.07	1.02	0.18	1.23	1.57	1.57	0.27	3.16	2.15	2.15	0.37	6.33	2.72	2.72	0.47	9.45
6	15	-	-	-	-	0.77	0.77	0.11	0.71	1.36	1.36	0.20	1.37	1.88	1.88	0.27	3.16	2.45	2.45	0.35	5.77	
	17	-	-	-	-	0.78	0.78	0.11	0.71	1.36	1.36	0.20	1.37	1.88	1.88	0.27	3.17	2.45	2.45	0.35	5.78	
	19	-	-	-	-	0.78	0.78	0.11	0.71	1.37	1.37	0.20	1.37	1.88	1.88	0.27	3.18	2.46	2.46	0.35	5.79	
	20	-	-	-	-	0.78	0.77	0.11	0.71	1.37	1.36	0.20	1.37	1.88	1.88	0.27	3.19	2.46	2.46	0.35	5.80	

MDKH2)-V800-R3																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	6.26	4.74	1.79	51.12	6.23	5.42	1.79	50.86	6.36	6.11	1.82	52.52	6.79	6.79	1.95	58.96	7.45	7.45	2.14	69.31
		17	8.28	4.77	2.38	83.29	8.23	5.44	2.36	82.46	8.18	6.11	2.35	81.64	8.14	6.77	2.33	80.83	8.12	7.43	2.33	80.51
		19	-	-	-	-	10.40	5.47	3.02	126.20	10.34	6.14	3.00	124.93	10.27	6.80	2.96	121.93	10.22	7.45	2.95	121.66
		20	-	-	-	-	11.52	5.48	3.32	149.58	11.47	6.15	3.32	149.09	11.40	6.81	3.30	147.92	11.34	7.47	3.27	145.47
	4	15	5.56	4.42	1.19	25.28	5.66	5.12	1.21	26.02	5.96	5.84	1.28	28.50	6.53	6.53	1.40	33.34	7.19	7.19	1.55	39.60
		17	7.64	4.47	1.64	43.65	7.59	5.14	1.63	43.21	7.55	5.81	1.62	42.79	7.52	6.48	1.61	42.50	7.63	7.16	1.64	43.63
		19	-	-	-	-	9.77	5.18	2.10	66.94	9.71	5.85	2.09	66.30	9.66	6.51	2.08	65.67	9.61	7.17	2.06	65.04
		20	-	-	-	-	10.91	5.19	2.35	81.32	10.85	5.87	2.34	80.54	10.80	6.53	2.32	79.78	10.74	7.19	2.31	79.03
	5	15	4.84	4.07	0.83	13.57	5.15	4.82	0.89	15.20	5.61	5.56	0.97	17.58	6.25	6.25	1.07	21.00	6.92	6.92	1.19	25.01
		17	6.90	4.14	1.18	24.88	6.86	4.81	1.18	24.63	6.83	5.48	1.17	24.41	6.93	6.18	1.19	25.05	7.19	6.89	1.23	26.69
		19	-	-	-	-	9.11	4.88	1.57	40.42	9.06	5.55	1.56	40.04	9.01	6.22	1.55	39.65	8.96	6.87	1.55	39.27
		20	-	-	-	-	10.26	4.90	1.76	49.31	10.21	5.57	1.75	48.85	10.15	6.24	1.74	48.39	10.10	6.89	1.73	47.94
6	15	4.18	3.72	0.60	7.36	4.65	4.50	0.67	9.24	5.26	5.25	0.75	11.51	5.95	5.95	0.85	14.22	6.63	6.63	0.95	16.98	
	17	6.09	3.78	0.87	14.74	6.05	4.45	0.87	14.57	6.14	5.16	0.88	14.97	6.40	5.89	0.92	16.07	6.78	6.61	0.97	17.63	
	19	-	-	-	-	8.35	4.54	1.19	25.13	8.30	5.22	1.19	24.88	8.26	5.88	1.18	24.65	8.22	6.54	1.18	24.46	
	20	-	-	-	-	9.56	4.58	1.37	31.89	9.50	5.26	1.36	31.59	9.45	5.93	1.36	31.29	9.40	6.59	1.35	30.99	
7	3	15	4.76	4.05	1.38	31.94	4.96	4.76	1.43	34.26	5.46	5.45	1.58	40.44	6.12	6.12	1.76	48.77	6.79	6.79	1.96	58.53
		17	6.78	4.08	1.96	58.49	6.75	4.75	1.95	58.06	6.70	5.42	1.94	57.43	6.72	6.10	1.94	57.60	6.92	6.78	1.99	60.33
		19	-	-	-	-	8.90	4.78	2.57	93.90	8.85	5.45	2.55	92.97	8.80	6.12	2.54	92.04	8.75	6.77	2.52	91.09
		20	-	-	-	-	10.05	4.79	2.90	116.24	9.99	5.46	2.89	115.09	9.93	6.13	2.87	113.95	9.88	6.79	2.85	112.80
	4	15	4.16	3.74	0.90	15.33	4.56	4.48	0.98	17.78	5.18	5.18	1.11	22.16	5.86	5.86	1.26	27.36	6.53	6.53	1.41	33.30
		17	6.08	3.77	1.32	29.38	6.04	4.45	1.31	29.06	6.04	5.13	1.31	29.08	6.22	5.83	1.35	30.61	6.59	6.53	1.43	33.80
		19	-	-	-	-	8.25	4.49	1.79	49.81	8.20	5.16	1.78	49.32	8.15	5.83	1.77	48.83	8.10	6.49	1.75	48.31
		20	-	-	-	-	9.41	4.51	2.04	62.61	9.35	5.18	2.03	62.00	9.30	5.85	2.02	61.40	9.24	6.51	1.99	60.26
	5	15	3.60	3.41	0.62	7.98	4.19	4.18	0.72	10.50	4.89	4.89	0.84	13.65	5.58	5.58	0.96	17.18	6.26	6.26	1.08	20.80
		17	5.23	3.41	0.90	15.33	5.23	4.09	0.90	15.30	5.43	4.82	0.94	16.34	5.77	5.55	0.99	18.11	6.27	6.27	1.08	20.90
		19	-	-	-	-	7.51	4.18	1.30	28.62	7.47	4.85	1.29	28.32	7.35	5.87	1.27	44.12	7.42	6.19	1.28	28.05
		20	-	-	-	-	8.68	4.20	1.49	36.43	8.63	4.87	1.49	36.07	8.58	5.54	1.48	35.72	8.53	6.20	1.47	35.37
6	15	3.22	3.14	0.46	3.92	3.84	3.84	0.55	6.16	4.57	4.57	0.65	8.86	5.28	5.28	0.76	11.36	5.97	5.97	0.86	14.07	
	17	4.20	2.98	0.60	7.54	4.45	3.73	0.64	8.45	4.86	4.51	0.70	9.86	5.36	5.26	0.77	11.67	5.98	5.98	0.86	14.09	
	19	-	-	-	-	6.65	3.82	0.95	16.83	6.61	4.49	0.95	16.63	6.61	5.18	0.95	16.66	6.78	5.88	0.97	17.41	
	20	-	-	-	-	7.89	3.87	1.13	22.56	7.84	4.55	1.13	22.33	7.79	5.22	1.12	22.10	7.75	5.88	1.11	21.88	
9	3	15	3.48	3.38	1.00	18.12	4.10	4.10	1.18	23.99	4.78	4.78	1.38	31.75	5.45	5.45	1.57	39.31	6.12	6.12	1.77	48.68
		17	5.15	3.37	1.48	35.58	5.11	4.05	1.47	35.12	5.20	4.74	1.50	36.23	5.52	5.45	1.59	40.14	6.13	6.13	1.78	48.81
		19	-	-	-	-	7.31	4.08	2.11	65.46	7.26	4.76	2.09	64.76	7.22	5.43	2.08	64.06	7.19	6.09	2.09	64.37
		20	-	-	-	-	8.46	4.10	2.44	84.65	8.41	4.77	2.43	83.76	8.36	5.44	2.41	82.88	8.31	6.10	2.40	82.01
	4	15	3.09	3.08	0.67	9.06	3.81	3.81	0.82	12.88	4.51	4.51	0.97	17.22	5.19	5.19	1.12	21.99	5.87	5.87	1.27	27.27
		17	4.31	3.02	0.93	15.91	4.41	3.74	0.95	16.57	4.72	4.47	1.02	18.70	5.21	5.20	1.12	22.11	5.88	5.88	1.27	27.34
		19	-	-	-	-	6.57	3.78	1.41	32.78	6.53	4.46	1.41	32.42	6.48	5.13	1.40	32.07	6.57	5.81	1.42	32.81
		20	-	-	-	-	7.76	3.81	1.68	44.17	7.71	4.49	1.67	43.71	7.67	5.16	1.66	43.26	7.62	5.82	1.65	42.79
	5	15	2.76	2.76	0.48	4.33	3.48	3.48	0.60	7.48	4.20	4.20	0.72	10.40	4.91	4.91	0.84	13.52	5.59	5.59	0.96	16.90
		17	3.38	2.63	0.58	7.05	3.78	3.42	0.65	8.68	4.29	4.19	0.74	10.76	4.91	4.91	0.85	13.54	5.60	5.60	0.96	16.94
		19	-	-	-	-	5.72	3.44	0.98	17.51	5.67	4.12	0.98	17.29	5.78	4.82	0.99	17.84	6.03	5.54	1.04	19.24
		20	-	-	-	-	6.94	3.48	1.20	24.43	6.90	4.16	1.19	24.17	6.85	4.83	1.18	23.89	6.85	5.51	1.18	23.91
6	15	2.52	2.52	0.36	2.10	3.18	3.18	0.46	3.89	3.87	3.87	0.56	6.40	4.60	4.60	0.66	8.85	5.30	5.30	0.76	11.27	
	17	2.81	2.36	0.40	2.79	3.29	3.12	0.47	4.28	3.89	3.87	0.56	6.47	4.60	4.60	0.66	8.87	5.31	5.31	0.76	11.30	
	19	-	-	-	-	4.67	3.03	0.67	9.04	4.81	3.76	0.69	9.52	5.13	4.51	0.74	10.65	5.56	5.26	0.80	12.19	
	20	-	-	-	-	6.01	3.12	0.86	13.90	5.96	3.80	0.86	13.72	5.97	4.49	0.86	13.77	6.16	5.20	0.88	14.53	

Continued:

		MDKH2-V800-R3																				
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
11	3	15	2.70	2.70	0.77	11.47	3.41	3.41	0.97	17.05	4.10	4.10	1.17	23.42	4.78	4.78	1.36	30.48	5.46	5.46	1.57	38.80
		17	3.36	2.64	0.96	16.60	3.63	3.38	1.03	18.93	4.11	4.11	1.17	23.50	4.79	4.79	1.37	30.56	5.46	5.46	1.57	38.90
		19	-	-	-	-	5.59	3.39	1.61	40.48	5.55	4.06	1.60	39.99	5.56	4.74	1.60	40.02	5.74	5.44	1.65	42.43
		20	-	-	-	-	6.74	3.40	1.93	55.39	6.70	4.08	1.92	55.01	6.67	4.76	1.92	55.05	6.63	5.42	1.91	54.44
	4	15	2.37	2.37	0.51	5.24	3.11	3.11	0.67	8.90	3.82	3.82	0.82	12.65	4.51	4.51	0.97	16.82	5.19	5.19	1.11	21.41
		17	2.62	2.30	0.56	6.59	3.17	3.09	0.68	9.22	3.82	3.82	0.82	12.67	4.52	4.52	0.97	16.87	5.20	5.20	1.11	21.46
		19	-	-	-	-	4.71	3.05	1.01	18.05	4.73	3.74	1.01	18.19	4.96	4.46	1.06	19.72	5.33	5.19	1.14	22.38
		20	-	-	-	-	5.93	3.09	1.27	26.88	5.89	3.77	1.26	26.56	5.84	4.44	1.25	25.95	5.95	5.14	1.28	27.04
	5	15	2.11	2.11	0.36	2.18	2.78	2.78	0.48	4.58	3.51	3.51	0.60	7.54	4.23	4.23	0.73	10.34	4.92	4.92	0.84	13.28
		17	2.20	2.05	0.38	2.43	2.79	2.79	0.48	4.61	3.52	3.52	0.61	7.56	4.24	4.24	0.73	10.37	4.93	4.93	0.85	13.32
		19	-	-	-	-	3.70	2.67	0.64	8.23	4.02	3.43	0.69	9.47	4.46	4.19	0.77	11.29	4.97	4.92	0.85	13.53
		20	-	-	-	-	4.97	2.73	0.85	13.48	4.93	3.41	0.85	13.29	5.08	4.13	0.87	13.99	5.39	4.87	0.93	15.62
6	15	1.83	1.83	0.26	1.24	2.53	2.53	0.36	2.19	3.19	3.19	0.46	4.10	3.90	3.90	0.56	6.49	4.62	4.62	0.66	8.74	
	17	1.85	1.81	0.27	1.25	2.53	2.53	0.36	2.19	3.20	3.20	0.46	4.12	3.91	3.91	0.56	6.50	4.63	4.63	0.66	8.76	
	19	-	-	-	-	2.92	2.34	0.42	3.26	3.41	3.11	0.49	4.85	3.99	3.88	0.57	6.76	4.64	4.64	0.66	8.79	
	20	-	-	-	-	3.71	2.28	0.53	5.86	3.96	3.04	0.57	6.68	4.39	3.81	0.63	7.98	4.87	4.58	0.70	9.53	
13	3	15	1.99	1.99	0.57	6.78	2.72	2.72	0.78	11.53	3.42	3.42	0.98	17.09	4.11	4.11	1.18	23.40	4.78	4.78	1.36	30.03
		17	2.01	1.98	0.58	6.92	2.72	2.72	0.78	11.56	3.42	3.42	0.98	17.13	4.11	4.11	1.18	23.46	4.78	4.78	1.37	30.11
		19	-	-	-	-	3.65	2.65	1.05	19.10	3.82	3.38	1.10	20.69	4.20	4.11	1.21	24.29	4.79	4.79	1.37	30.18
		20	-	-	-	-	4.85	2.68	1.39	30.79	4.81	3.36	1.37	30.34	4.84	4.05	1.38	30.67	5.07	4.76	1.45	33.26
	4	15	1.70	1.70	0.37	2.26	2.38	2.38	0.51	5.43	3.12	3.12	0.67	8.83	3.83	3.83	0.82	12.51	4.52	4.52	0.97	16.79
		17	1.70	1.69	0.37	2.26	2.39	2.39	0.51	5.44	3.13	3.13	0.67	8.86	3.83	3.83	0.82	12.54	4.53	4.53	0.98	16.83
		19	-	-	-	-	2.79	2.31	0.60	7.31	3.28	3.09	0.70	9.61	3.85	3.84	0.83	12.63	4.54	4.54	0.98	16.88
		20	-	-	-	-	3.85	2.32	0.83	12.61	3.92	3.04	0.84	13.00	4.24	3.78	0.91	14.99	4.66	4.52	1.00	17.64
	5	15	1.40	1.40	0.24	1.09	2.11	2.11	0.36	2.23	2.79	2.79	0.48	4.70	3.53	3.53	0.61	7.43	4.24	4.24	0.73	10.15
		17	1.41	1.41	0.24	1.09	2.11	2.11	0.36	2.24	2.80	2.80	0.48	4.71	3.53	3.53	0.61	7.45	4.24	4.24	0.73	10.18
		19	-	-	-	-	2.24	2.03	0.38	2.64	2.83	2.79	0.49	4.85	3.53	3.53	0.61	7.46	4.25	4.25	0.73	10.20
		20	-	-	-	-	2.69	1.91	0.46	4.30	3.16	2.71	0.54	6.12	3.70	3.49	0.64	8.06	4.28	4.25	0.73	10.33
6	15	1.06	1.06	0.15	0.68	1.84	1.84	0.26	1.18	2.53	2.53	0.36	2.25	3.20	3.20	0.46	4.23	3.93	3.93	0.56	6.53	
	17	1.06	1.06	0.15	0.68	1.84	1.84	0.26	1.18	2.53	2.53	0.36	2.26	3.21	3.21	0.46	4.25	3.93	3.93	0.56	6.54	
	19	-	-	-	-	1.89	1.80	0.27	1.22	2.54	2.53	0.36	2.27	3.21	3.21	0.46	4.26	3.94	3.94	0.56	6.56	
	20	-	-	-	-	2.13	1.68	0.31	1.48	2.67	2.44	0.38	2.62	3.26	3.19	0.47	4.41	3.94	3.94	0.56	6.57	
15	3	15	1.27	1.27	0.36	2.29	1.99	1.99	0.57	6.63	2.72	2.72	0.78	11.23	3.42	3.42	0.98	16.86	4.10	4.10	1.17	22.72
		17	1.27	1.27	0.36	2.29	2.00	2.00	0.57	6.65	2.72	2.72	0.78	11.26	3.43	3.43	0.99	16.90	4.10	4.10	1.17	22.78
		19	-	-	-	-	2.06	1.98	0.59	7.01	2.72	2.71	0.78	11.24	3.43	3.43	0.99	16.95	4.11	4.11	1.17	22.85
		20	-	-	-	-	2.68	1.93	0.77	10.98	3.00	2.68	0.86	13.28	3.48	3.42	1.00	17.33	4.11	4.11	1.17	22.87
	4	15	0.98	0.98	0.21	0.92	1.69	1.69	0.36	2.31	2.40	2.40	0.51	5.54	3.13	3.13	0.67	8.77	3.84	3.84	0.83	12.52
		17	0.98	0.98	0.21	0.92	1.70	1.70	0.36	2.32	2.41	2.41	0.52	5.56	3.14	3.14	0.67	8.79	3.85	3.85	0.83	12.55
		19	-	-	-	-	1.70	1.70	0.36	2.33	2.41	2.41	0.52	5.58	3.14	3.14	0.67	8.81	3.85	3.85	0.83	12.58
		20	-	-	-	-	1.88	1.60	0.40	3.08	2.48	2.39	0.53	5.88	3.14	3.14	0.67	8.81	3.86	3.86	0.83	12.60
	5	15	0.62	0.62	0.11	0.45	1.42	1.42	0.25	1.06	2.12	2.12	0.37	2.37	2.82	2.82	0.49	4.92	3.55	3.55	0.61	7.46
		17	0.62	0.62	0.11	0.45	1.43	1.43	0.25	1.06	2.12	2.12	0.37	2.38	2.82	2.82	0.49	4.93	3.56	3.56	0.61	7.48
		19	-	-	-	-	1.43	1.42	0.25	1.06	2.12	2.12	0.37	2.39	2.83	2.83	0.49	4.95	3.56	3.56	0.61	7.50
		20	-	-	-	-	1.49	1.38	0.26	1.11	2.13	2.12	0.37	2.42	2.83	2.82	0.49	4.95	3.56	3.56	0.61	7.51
6	15	-	-	-	-	1.08	1.08	0.16	0.66	1.86	1.86	0.27	1.16	2.54	2.54	0.36	2.38	3.23	3.23	0.46	4.44	
	17	-	-	-	-	1.08	1.08	0.16	0.66	1.86	1.86	0.27	1.16	2.54	2.54	0.36	2.39	3.23	3.23	0.46	4.46	
	19	-	-	-	-	1.09	1.09	0.16	0.66	1.86	1.86	0.27	1.16	2.54	2.54	0.37	2.40	3.24	3.24	0.46	4.47	
	20	-	-	-	-	1.09	1.08	0.16	0.66	1.86	1.86	0.27	1.16	2.55	2.55	0.37	2.40	3.24	3.24	0.47	4.48	

MDV DC Fan Coil Unit



R4 series

MDKH1-V150-R4																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	1.51	1.11	0.43	34.74	1.50	1.25	0.43	34.32	1.51	1.40	0.43	34.56	1.55	1.55	0.44	36.40	1.69	1.69	0.48	42.08
		17	1.96	1.12	0.56	54.22	1.94	1.26	0.56	53.55	1.93	1.41	0.55	52.89	1.92	1.55	0.55	52.24	1.91	1.69	0.55	51.71
		19	-	-	-	-	2.42	1.27	0.69	78.24	2.40	1.41	0.69	77.73	2.39	1.56	0.69	77.43	2.37	1.69	0.68	76.50
		20	-	-	-	-	2.67	1.27	0.77	93.72	2.65	1.42	0.77	93.14	2.63	1.56	0.76	92.02	2.61	1.70	0.76	90.93
	4	15	1.40	1.06	0.30	18.74	1.41	1.20	0.30	18.81	1.44	1.36	0.31	19.54	1.51	1.51	0.33	21.37	1.65	1.65	0.35	24.66
		17	1.86	1.07	0.40	30.10	1.85	1.22	0.40	29.74	1.83	1.36	0.39	29.38	1.82	1.50	0.39	29.06	1.83	1.64	0.39	29.17
		19	-	-	-	-	2.33	1.23	0.50	44.33	2.31	1.37	0.50	43.80	2.30	1.51	0.49	43.29	2.28	1.65	0.49	42.78
		20	-	-	-	-	2.58	1.23	0.56	53.23	2.56	1.38	0.55	52.52	2.55	1.52	0.55	51.80	2.53	1.66	0.54	51.13
	5	15	1.27	0.99	0.22	10.46	1.30	1.15	0.22	11.01	1.36	1.31	0.23	12.04	1.47	1.47	0.25	13.74	1.61	1.61	0.28	16.25
		17	1.75	1.02	0.30	18.51	1.73	1.16	0.30	18.29	1.72	1.31	0.30	18.07	1.72	1.45	0.30	18.11	1.75	1.60	0.30	18.54
		19	-	-	-	-	2.23	1.18	0.38	27.84	2.21	1.32	0.38	27.51	2.20	1.46	0.38	27.19	2.18	1.60	0.37	26.87
		20	-	-	-	-	2.49	1.19	0.43	33.90	2.47	1.33	0.43	33.50	2.45	1.47	0.42	33.11	2.44	1.61	0.42	32.73
6	15	1.15	0.93	0.17	5.30	1.21	1.10	0.17	6.04	1.30	1.27	0.19	7.19	1.42	1.42	0.20	9.04	1.57	1.57	0.22	11.16	
	17	1.60	0.95	0.23	11.64	1.59	1.09	0.23	11.41	1.59	1.24	0.23	11.50	1.62	1.40	0.23	11.85	1.66	1.55	0.24	12.48	
	19	-	-	-	-	2.11	1.12	0.30	18.48	2.09	1.27	0.30	18.26	2.08	1.41	0.30	18.05	2.06	1.55	0.30	17.84	
	20	-	-	-	-	2.37	1.13	0.34	22.61	2.35	1.28	0.34	22.35	2.34	1.42	0.33	22.09	2.32	1.56	0.33	21.84	
7	3	15	1.18	0.95	0.34	22.43	1.20	1.10	0.34	23.00	1.26	1.26	0.36	25.11	1.40	1.40	0.41	30.56	1.54	1.54	0.45	36.06
		17	1.64	0.96	0.47	39.73	1.62	1.11	0.47	39.22	1.61	1.25	0.47	38.73	1.60	1.40	0.46	38.43	1.62	1.54	0.47	39.05
		19	-	-	-	-	2.10	1.12	0.60	60.54	2.08	1.26	0.60	59.78	2.07	1.40	0.60	59.06	2.05	1.54	0.59	58.55
		20	-	-	-	-	2.35	1.12	0.68	73.71	2.33	1.27	0.67	73.32	2.32	1.41	0.67	72.95	2.30	1.55	0.67	72.06
	4	15	1.07	0.90	0.23	11.63	1.12	1.06	0.24	12.65	1.22	1.22	0.26	14.58	1.36	1.36	0.29	17.52	1.51	1.51	0.32	20.78
		17	1.52	0.91	0.33	21.02	1.51	1.06	0.32	20.75	1.50	1.20	0.32	20.58	1.51	1.35	0.33	20.92	1.56	1.50	0.33	21.91
		19	-	-	-	-	2.00	1.07	0.43	34.00	1.99	1.22	0.43	33.59	1.97	1.36	0.43	33.19	1.96	1.50	0.42	32.78
		20	-	-	-	-	2.26	1.08	0.49	41.84	2.24	1.22	0.48	41.34	2.22	1.37	0.48	40.84	2.21	1.51	0.48	40.35
	5	15	0.96	0.84	0.16	5.45	1.04	1.01	0.18	6.80	1.17	1.17	0.20	8.93	1.32	1.32	0.23	11.31	1.47	1.47	0.25	13.52
		17	1.38	0.85	0.24	12.09	1.37	0.99	0.24	11.97	1.39	1.15	0.24	12.24	1.43	1.30	0.25	12.88	1.50	1.46	0.26	13.96
		19	-	-	-	-	1.88	1.02	0.32	20.58	1.87	1.16	0.32	20.33	1.87	1.36	0.32	20.10	1.84	1.45	0.32	19.92
		20	-	-	-	-	2.14	1.03	0.37	25.75	2.13	1.17	0.37	25.45	2.11	1.32	0.36	25.14	2.10	1.46	0.36	24.84
6	15	0.89	0.80	0.13	2.77	0.99	0.97	0.14	3.68	1.13	1.13	0.16	5.14	1.27	1.27	0.18	7.10	1.42	1.42	0.20	9.16	
	17	1.20	0.77	0.17	6.18	1.22	0.93	0.18	6.44	1.27	1.09	0.18	7.10	1.34	1.26	0.19	8.07	1.43	1.42	0.21	9.35	
	19	-	-	-	-	1.74	0.96	0.25	13.25	1.72	1.10	0.25	12.96	1.71	1.25	0.25	12.84	1.73	1.39	0.25	13.00	
	20	-	-	-	-	2.01	0.97	0.29	16.89	2.00	1.12	0.29	16.68	1.98	1.26	0.28	16.48	1.97	1.40	0.28	16.27	
9	3	15	0.86	0.80	0.25	12.91	0.96	0.96	0.28	15.61	1.11	1.11	0.32	19.86	1.25	1.25	0.36	24.52	1.40	1.40	0.40	29.90
		17	1.28	0.80	0.37	25.31	1.27	0.95	0.36	24.95	1.27	1.10	0.36	25.06	1.30	1.25	0.38	26.30	1.40	1.40	0.40	29.98
		19	-	-	-	-	1.76	0.96	0.51	44.33	1.74	1.11	0.50	43.77	1.73	1.25	0.50	43.22	1.72	1.39	0.50	42.66
		20	-	-	-	-	2.01	0.97	0.58	55.22	1.99	1.11	0.57	54.53	1.98	1.26	0.57	53.84	1.96	1.40	0.57	53.21
	4	15	0.78	0.75	0.17	5.89	0.91	0.91	0.20	8.57	1.07	1.07	0.23	11.35	1.21	1.21	0.26	14.16	1.36	1.36	0.29	17.21
		17	1.14	0.74	0.24	12.59	1.14	0.89	0.25	12.67	1.18	1.05	0.25	13.53	1.24	1.21	0.27	14.68	1.36	1.36	0.29	17.27
		19	-	-	-	-	1.64	0.91	0.35	23.80	1.63	1.06	0.35	23.50	1.62	1.20	0.35	23.20	1.62	1.35	0.35	23.21
		20	-	-	-	-	1.90	0.92	0.41	30.33	1.88	1.07	0.41	29.95	1.87	1.21	0.40	29.59	1.86	1.35	0.40	29.21
	5	15	0.73	0.71	0.12	2.68	0.87	0.87	0.15	4.32	1.02	1.02	0.18	6.59	1.17	1.17	0.20	8.98	1.32	1.32	0.23	11.10
		17	0.96	0.67	0.17	5.72	1.01	0.83	0.17	6.47	1.08	1.00	0.19	7.64	1.18	1.17	0.20	9.15	1.32	1.32	0.23	11.14
		19	-	-	-	-	1.49	0.85	0.26	13.67	1.48	1.00	0.25	13.48	1.48	1.15	0.26	13.54	1.51	1.30	0.26	14.07
		20	-	-	-	-	1.77	0.87	0.30	18.22	1.75	1.01	0.30	18.00	1.74	1.16	0.30	17.77	1.73	1.30	0.30	17.61
6	15	0.67	0.67	0.10	1.72	0.83	0.83	0.12	2.38	0.98	0.98	0.14	3.64	1.12	1.12	0.16	5.33	1.27	1.27	0.18	7.28	
	17	0.84	0.62	0.12	2.44	0.92	0.79	0.13	3.09	1.01	0.96	0.15	4.03	1.13	1.12	0.16	5.39	1.27	1.27	0.18	7.31	
	19	-	-	-	-	1.31	0.78	0.19	7.75	1.31	0.93	0.19	7.83	1.35	1.09	0.19	8.30	1.41	1.25	0.20	9.01	
	20	-	-	-	-	1.61	0.80	0.23	11.30	1.59	0.95	0.23	11.15	1.58	1.09	0.23	11.05	1.60	1.24	0.23	11.24	

Continued:

MDKH1-V150-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
11	3	15	0.65	0.65	0.19	7.68	0.81	0.81	0.23	11.29	0.96	0.96	0.27	15.19	1.11	1.11	0.32	19.25	1.25	1.25	0.36	23.76	
		17	0.88	0.64	0.25	13.03	0.91	0.80	0.26	13.79	0.98	0.96	0.28	15.55	1.11	1.11	0.32	19.32	1.25	1.25	0.36	23.84	
		19	-	-	-	-	1.38	0.80	0.40	28.29	1.37	0.95	0.39	27.88	1.36	1.10	0.39	27.59	1.38	1.24	0.39	28.18	
		20	-	-	-	-	1.64	0.81	0.47	38.32	1.63	0.96	0.47	37.54	1.61	1.10	0.46	37.06	1.60	1.24	0.46	36.56	
	4	15	0.61	0.61	0.13	3.05	0.76	0.76	0.16	5.59	0.91	0.91	0.20	8.50	1.07	1.07	0.23	11.06	1.21	1.21	0.26	13.78	
		17	0.73	0.57	0.16	5.05	0.81	0.75	0.17	6.57	0.92	0.92	0.20	8.58	1.07	1.07	0.23	11.09	1.22	1.22	0.26	13.82	
		19	-	-	-	-	1.23	0.75	0.26	14.14	1.23	0.89	0.26	14.03	1.25	1.05	0.27	14.47	1.30	1.20	0.28	15.40	
		20	-	-	-	-	1.51	0.76	0.32	19.91	1.49	0.91	0.32	19.64	1.48	1.05	0.32	19.38	1.49	1.20	0.32	19.46	
	5	15	0.56	0.56	0.10	1.66	0.72	0.72	0.12	2.68	0.87	0.87	0.15	4.50	1.02	1.02	0.18	6.76	1.17	1.17	0.20	8.92	
		17	0.63	0.53	0.11	1.99	0.74	0.71	0.13	2.94	0.87	0.87	0.15	4.51	1.02	1.02	0.18	6.79	1.17	1.17	0.20	8.95	
		19	-	-	-	-	1.04	0.67	0.18	7.13	1.08	0.83	0.19	7.65	1.14	1.00	0.20	8.51	1.22	1.16	0.21	9.58	
		20	-	-	-	-	1.34	0.69	0.23	11.23	1.33	0.84	0.23	11.06	1.34	0.99	0.23	11.18	1.37	1.15	0.24	11.67	
	6	15	0.50	0.50	0.07	1.22	0.67	0.67	0.10	1.64	0.83	0.83	0.12	2.43	0.97	0.97	0.14	3.79	1.12	1.12	0.16	5.46	
		17	0.54	0.48	0.08	1.29	0.68	0.66	0.10	1.67	0.83	0.83	0.12	2.44	0.98	0.98	0.14	3.81	1.12	1.12	0.16	5.49	
		19	-	-	-	-	0.88	0.61	0.13	2.92	0.96	0.78	0.14	3.63	1.05	0.95	0.15	4.60	1.15	1.12	0.16	5.79	
		20	-	-	-	-	1.12	0.61	0.16	5.43	1.13	0.77	0.16	5.64	1.19	0.93	0.17	6.29	1.26	1.09	0.18	7.14	
	13	3	15	0.50	0.50	0.14	4.05	0.65	0.65	0.19	7.81	0.81	0.81	0.23	11.21	0.96	0.96	0.27	14.97	1.10	1.10	0.32	19.08
			17	0.52	0.49	0.15	4.69	0.65	0.65	0.19	7.80	0.81	0.81	0.23	11.25	0.96	0.96	0.28	15.02	1.10	1.10	0.32	19.15
			19	-	-	-	-	0.96	0.64	0.27	14.91	0.97	0.79	0.28	15.31	1.02	0.95	0.29	16.60	1.11	1.10	0.32	19.19
			20	-	-	-	-	1.23	0.65	0.35	22.92	1.22	0.80	0.35	22.58	1.21	0.94	0.35	22.45	1.23	1.10	0.35	23.10
		4	15	0.45	0.45	0.10	1.62	0.61	0.61	0.13	3.22	0.76	0.76	0.16	5.74	0.91	0.91	0.20	8.38	1.06	1.06	0.23	10.84
			17	0.46	0.45	0.10	1.67	0.61	0.61	0.13	3.22	0.76	0.76	0.16	5.76	0.91	0.91	0.20	8.40	1.06	1.06	0.23	10.88
			19	-	-	-	-	0.78	0.57	0.17	6.07	0.85	0.74	0.18	7.36	0.94	0.91	0.20	8.82	1.07	1.06	0.23	10.89
			20	-	-	-	-	1.05	0.58	0.23	10.59	1.05	0.74	0.23	10.59	1.09	0.89	0.23	11.22	1.14	1.05	0.25	12.27
5		15	0.39	0.39	0.07	1.08	0.56	0.56	0.10	1.59	0.71	0.71	0.12	2.73	0.87	0.87	0.15	4.58	1.02	1.02	0.17	6.75	
		17	0.39	0.39	0.07	1.09	0.56	0.56	0.10	1.59	0.72	0.72	0.12	2.75	0.87	0.87	0.15	4.61	1.02	1.02	0.17	6.78	
		19	-	-	-	-	0.66	0.52	0.11	2.18	0.76	0.70	0.13	3.24	0.88	0.87	0.15	4.74	1.02	1.02	0.18	6.81	
		20	-	-	-	-	0.82	0.50	0.14	4.05	0.88	0.67	0.15	4.87	0.97	0.84	0.17	6.05	1.06	1.01	0.18	7.37	
6		15	0.32	0.32	0.05	0.72	0.50	0.50	0.07	1.15	0.67	0.67	0.10	1.58	0.82	0.82	0.12	2.47	0.97	0.97	0.14	3.88	
		17	0.32	0.32	0.05	0.72	0.50	0.50	0.07	1.15	0.67	0.67	0.10	1.58	0.82	0.82	0.12	2.48	0.97	0.97	0.14	3.90	
		19	-	-	-	-	0.55	0.47	0.08	1.25	0.69	0.66	0.10	1.67	0.83	0.83	0.12	2.51	0.98	0.98	0.14	3.92	
		20	-	-	-	-	0.66	0.44	0.09	1.54	0.77	0.63	0.11	2.12	0.88	0.80	0.13	2.98	0.99	0.97	0.14	4.13	
15		3	15	0.34	0.34	0.10	1.58	0.49	0.49	0.14	4.09	0.65	0.65	0.19	7.59	0.80	0.80	0.23	10.84	0.95	0.95	0.27	14.66
			17	0.34	0.34	0.10	1.58	0.50	0.50	0.14	4.11	0.65	0.65	0.19	7.62	0.81	0.81	0.23	10.88	0.96	0.96	0.27	14.72
			19	-	-	-	-	0.54	0.48	0.15	5.18	0.66	0.65	0.19	7.71	0.81	0.81	0.23	10.92	0.96	0.96	0.28	14.77
			20	-	-	-	-	0.74	0.48	0.21	9.42	0.78	0.64	0.22	10.27	0.85	0.80	0.24	11.88	0.96	0.95	0.27	14.75
		4	15	0.28	0.28	0.06	0.93	0.45	0.45	0.10	1.57	0.60	0.60	0.13	3.27	0.76	0.76	0.16	5.84	0.91	0.91	0.20	8.23
			17	0.28	0.28	0.06	0.93	0.45	0.45	0.10	1.57	0.61	0.61	0.13	3.28	0.76	0.76	0.16	5.86	0.91	0.91	0.20	8.26
			19	-	-	-	-	0.47	0.44	0.10	1.68	0.61	0.60	0.13	3.28	0.76	0.76	0.16	5.89	0.92	0.92	0.20	8.29
			20	-	-	-	-	0.56	0.41	0.12	2.69	0.66	0.58	0.14	4.18	0.78	0.76	0.17	6.14	0.91	0.91	0.20	8.28
	5	15	0.20	0.20	0.03	0.52	0.39	0.39	0.07	1.04	0.56	0.56	0.10	1.58	0.71	0.71	0.12	2.87	0.87	0.87	0.15	4.78	
		17	0.20	0.20	0.03	0.52	0.39	0.39	0.07	1.04	0.56	0.56	0.10	1.58	0.72	0.72	0.12	2.88	0.87	0.87	0.15	4.80	
		19	-	-	-	-	0.40	0.39	0.07	1.05	0.56	0.56	0.10	1.58	0.72	0.72	0.12	2.90	0.87	0.87	0.15	4.82	
		20	-	-	-	-	0.44	0.36	0.08	1.17	0.59	0.55	0.10	1.74	0.72	0.72	0.12	2.94	0.87	0.87	0.15	4.84	
	6	15	-	-	-	-	0.32	0.32	0.05	0.70	0.51	0.51	0.07	1.10	0.67	0.67	0.10	1.56	0.82	0.82	0.12	2.58	
		17	-	-	-	-	0.32	0.32	0.05	0.70	0.51	0.51	0.07	1.10	0.67	0.67	0.10	1.57	0.82	0.82	0.12	2.59	
		19	-	-	-	-	0.32	0.32	0.05	0.70	0.51	0.51	0.07	1.11	0.67	0.67	0.10	1.57	0.82	0.82	0.12	2.61	
		20	-	-	-	-	0.34	0.31	0.05	0.73	0.52	0.50	0.07	1.12	0.67	0.67	0.10	1.58	0.83	0.83	0.12	2.61	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH1-V250-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	2.11	1.57	0.60	30.78	2.10	1.78	0.60	30.44	2.12	2.00	0.61	31.06	2.22	2.22	0.64	33.68	2.43	2.43	0.69	39.26	
		17	2.77	1.59	0.80	49.65	2.75	1.80	0.79	49.07	2.73	2.01	0.79	48.49	2.71	2.22	0.78	47.93	2.70	2.42	0.78	47.55	
		19	-	-	-	-	3.44	1.81	0.99	72.57	3.41	2.02	0.98	70.73	3.39	2.23	0.97	69.92	3.37	2.43	0.97	69.12	
		20	-	-	-	-	3.80	1.81	1.09	85.39	3.78	2.02	1.08	84.44	3.75	2.23	1.08	83.48	3.73	2.44	1.07	82.53	
	4	15	1.90	1.47	0.41	15.73	1.92	1.69	0.41	16.02	2.00	1.93	0.43	17.28	2.15	2.15	0.46	19.55	2.36	2.36	0.51	22.70	
		17	2.58	1.50	0.55	26.43	2.56	1.71	0.55	26.12	2.55	1.92	0.55	25.82	2.53	2.13	0.54	25.60	2.55	2.34	0.55	25.96	
		19	-	-	-	-	3.27	1.73	0.70	39.76	3.25	1.94	0.70	39.50	3.23	2.15	0.69	39.06	3.21	2.35	0.69	38.39	
		20	-	-	-	-	3.64	1.74	0.78	47.82	3.62	1.95	0.78	47.28	3.59	2.16	0.77	46.75	3.57	2.36	0.77	46.24	
	5	15	1.68	1.37	0.29	7.93	1.76	1.60	0.30	8.79	1.88	1.84	0.32	10.23	2.07	2.07	0.35	12.37	2.28	2.28	0.39	14.64	
		17	2.37	1.40	0.41	15.71	2.36	1.61	0.41	15.53	2.34	1.83	0.40	15.36	2.36	2.04	0.41	15.58	2.42	2.27	0.42	16.26	
		19	-	-	-	-	3.08	1.64	0.53	24.34	3.06	1.85	0.52	24.06	3.04	2.06	0.52	23.79	3.02	2.27	0.52	23.52	
		20	-	-	-	-	3.46	1.65	0.60	29.97	3.44	1.86	0.59	29.64	3.42	2.07	0.59	29.31	3.39	2.28	0.59	28.98	
	6	15	1.54	1.29	0.22	3.85	1.64	1.53	0.23	4.59	1.78	1.77	0.26	5.77	1.99	1.99	0.28	7.64	2.20	2.20	0.31	9.75	
		17	2.11	1.28	0.30	8.92	2.10	1.50	0.30	8.77	2.12	1.72	0.30	8.99	2.18	1.95	0.31	9.60	2.28	2.18	0.33	10.55	
		19	-	-	-	-	2.87	1.54	0.41	15.81	2.85	1.75	0.41	15.62	2.83	1.96	0.41	15.44	2.81	2.17	0.40	15.30	
		20	-	-	-	-	3.25	1.56	0.47	19.49	3.23	1.77	0.46	19.27	3.21	1.98	0.46	19.06	3.19	2.19	0.46	18.85	
	7	3	15	1.63	1.34	0.47	19.71	1.67	1.57	0.48	20.62	1.79	1.79	0.51	23.04	2.01	2.01	0.58	27.93	2.22	2.22	0.64	33.56
			17	2.29	1.36	0.66	35.36	2.27	1.57	0.66	34.92	2.25	1.78	0.65	34.54	2.25	2.00	0.65	34.39	2.29	2.21	0.66	35.51
			19	-	-	-	-	2.96	1.58	0.85	54.82	2.94	1.80	0.85	54.17	2.92	2.01	0.84	53.53	2.90	2.21	0.84	52.90
			20	-	-	-	-	3.33	1.59	0.96	67.70	3.31	1.80	0.96	66.91	3.29	2.01	0.95	66.12	3.27	2.22	0.94	65.13
		4	15	1.43	1.25	0.31	9.37	1.54	1.49	0.33	10.85	1.72	1.72	0.37	13.20	1.94	1.94	0.42	16.15	2.15	2.15	0.46	19.08
			17	2.08	1.26	0.45	18.00	2.06	1.48	0.44	17.77	2.06	1.69	0.44	17.72	2.10	1.92	0.45	18.32	2.19	2.14	0.47	19.68
			19	-	-	-	-	2.79	1.50	0.60	30.05	2.77	1.72	0.60	29.70	2.75	1.93	0.59	29.36	2.72	2.13	0.59	28.67
			20	-	-	-	-	3.15	1.51	0.68	36.90	3.13	1.72	0.67	36.47	3.11	1.93	0.67	36.06	3.09	2.14	0.67	35.64
5		15	1.29	1.17	0.22	4.05	1.43	1.41	0.25	5.38	1.63	1.63	0.28	7.58	1.85	1.85	0.32	10.04	2.07	2.07	0.36	12.23	
		17	1.81	1.15	0.31	9.65	1.81	1.37	0.31	9.60	1.86	1.60	0.32	10.12	1.95	1.84	0.34	11.06	2.09	2.07	0.36	12.40	
		19	-	-	-	-	2.57	1.41	0.44	17.59	2.55	1.62	0.44	17.38	2.55	1.84	0.44	23.20	2.53	2.04	0.44	17.21	
		20	-	-	-	-	2.95	1.42	0.51	22.36	2.93	1.64	0.50	22.10	2.91	1.85	0.50	21.85	2.89	2.05	0.50	21.60	
6	15	1.18	1.10	0.17	2.21	1.36	1.35	0.20	2.92	1.56	1.56	0.22	4.24	1.77	1.77	0.25	5.90	1.99	1.99	0.28	7.86		
	17	1.57	1.05	0.23	4.33	1.61	1.28	0.23	4.60	1.70	1.52	0.24	5.32	1.83	1.76	0.26	6.39	1.99	1.99	0.29	7.92		
	19	-	-	-	-	2.30	1.30	0.33	10.69	2.29	1.51	0.33	10.54	2.28	1.73	0.33	10.52	2.32	1.95	0.33	10.85		
	20	-	-	-	-	2.72	1.32	0.39	14.13	2.70	1.54	0.39	14.03	2.68	1.75	0.39	13.91	2.66	1.96	0.38	13.78		
9	3	15	1.18	1.12	0.34	11.12	1.36	1.35	0.39	14.11	1.58	1.58	0.45	18.20	1.79	1.79	0.51	22.63	2.00	2.00	0.58	27.76	
		17	1.76	1.13	0.50	21.92	1.74	1.34	0.50	21.61	1.76	1.56	0.51	21.98	1.83	1.79	0.53	23.57	2.01	2.01	0.58	27.85	
		19	-	-	-	-	2.46	1.36	0.71	38.97	2.44	1.57	0.70	38.50	2.42	1.78	0.70	38.03	2.40	1.99	0.69	37.57	
		20	-	-	-	-	2.83	1.37	0.82	50.48	2.81	1.58	0.81	49.88	2.79	1.79	0.81	49.28	2.77	2.00	0.80	48.69	
	4	15	1.07	1.05	0.23	4.59	1.27	1.27	0.27	7.29	1.50	1.50	0.32	10.18	1.72	1.72	0.37	12.85	1.93	1.93	0.42	15.71	
		17	1.50	1.02	0.32	10.21	1.52	1.25	0.33	10.49	1.60	1.48	0.35	11.45	1.73	1.72	0.37	13.06	1.93	1.93	0.42	15.76	
		19	-	-	-	-	2.25	1.27	0.49	20.39	2.23	1.49	0.48	20.14	2.22	1.70	0.48	19.90	2.23	1.91	0.48	20.12	
		20	-	-	-	-	2.63	1.28	0.57	26.87	2.61	1.50	0.57	26.55	2.60	1.71	0.56	26.23	2.58	1.92	0.56	25.91	
	5	15	0.99	0.98	0.17	2.17	1.20	1.20	0.21	3.49	1.42	1.42	0.24	5.44	1.63	1.63	0.28	7.77	1.85	1.85	0.32	9.98	
		17	1.25	0.92	0.22	3.94	1.34	1.16	0.23	4.72	1.47	1.40	0.25	5.99	1.64	1.64	0.28	7.82	1.86	1.86	0.32	10.01	
		19	-	-	-	-	1.99	1.16	0.34	11.21	1.97	1.38	0.34	11.05	1.99	1.60	0.34	11.27	2.06	1.83	0.35	11.90	
		20	-	-	-	-	2.39	1.19	0.41	15.37	2.38	1.40	0.41	15.26	2.36	1.61	0.41	15.07	2.35	1.83	0.41	15.01	
6	15	0.90	0.90	0.13	1.54	1.13	1.13	0.16	2.01	1.35	1.35	0.19	2.94	1.56	1.56	0.22	4.36	1.77	1.77	0.25	6.12		
	17	1.08	0.84	0.15	1.86	1.22	1.09	0.17	2.31	1.38	1.34	0.20	3.10	1.56	1.56	0.22	4.37	1.77	1.77	0.25	6.15		
	19	-	-	-	-	1.68	1.04	0.24	5.36	1.71	1.27	0.24	5.61	1.79	1.51	0.26	6.27	1.90	1.75	0.27	7.24		
	20	-	-	-	-	2.10	1.07	0.30	8.95	2.08	1.28	0.30	8.81	2.08	1.50	0.30	8.81	2.13	1.73	0.31	9.18		

Continued:

		MDKH1-V250-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
11	3	15	0.91	0.91	0.26	6.46	1.14	1.14	0.32	10.14	1.36	1.36	0.39	13.73	1.57	1.57	0.45	17.68	1.79	1.79	0.51	21.97	
		17	1.17	0.88	0.33	10.67	1.24	1.12	0.35	11.75	1.37	1.36	0.39	14.08	1.58	1.58	0.45	17.74	1.79	1.79	0.51	22.04	
		19	-	-	-	-	1.90	1.13	0.54	24.43	1.89	1.34	0.54	24.10	1.88	1.56	0.54	24.02	1.92	1.78	0.55	24.91	
		20	-	-	-	-	2.28	1.14	0.65	33.37	2.26	1.35	0.65	32.95	2.25	1.57	0.64	32.53	2.23	1.78	0.64	32.12	
	4	15	0.84	0.84	0.18	2.45	1.05	1.05	0.23	4.55	1.27	1.27	0.27	7.36	1.50	1.50	0.32	9.96	1.72	1.72	0.37	12.53	
		17	0.96	0.79	0.21	3.56	1.09	1.04	0.23	5.04	1.28	1.27	0.27	7.38	1.50	1.50	0.32	9.99	1.72	1.72	0.37	12.57	
		19	-	-	-	-	1.64	1.03	0.35	11.59	1.64	1.25	0.35	11.61	1.70	1.48	0.36	12.28	1.79	1.71	0.38	13.50	
		20	-	-	-	-	2.05	1.05	0.44	16.87	2.03	1.26	0.43	16.65	2.01	1.48	0.43	16.44	2.03	1.69	0.44	16.72	
	5	15	0.76	0.76	0.13	1.49	0.99	0.99	0.17	2.18	1.20	1.20	0.21	3.64	1.42	1.42	0.24	5.66	1.64	1.64	0.28	7.88	
		17	0.82	0.72	0.14	1.62	1.00	0.98	0.17	2.27	1.20	1.20	0.21	3.65	1.42	1.42	0.24	5.68	1.64	1.64	0.28	7.90	
		19	-	-	-	-	1.34	0.91	0.23	4.91	1.41	1.15	0.24	5.64	1.53	1.39	0.26	6.79	1.67	1.63	0.29	8.23	
		20	-	-	-	-	1.75	0.93	0.30	8.91	1.74	1.15	0.30	8.78	1.77	1.38	0.31	9.09	1.85	1.61	0.32	9.78	
	6	15	0.67	0.67	0.10	1.07	0.91	0.91	0.13	1.47	1.13	1.13	0.16	1.99	1.35	1.35	0.19	3.06	1.56	1.56	0.22	4.54	
		17	0.69	0.65	0.10	1.11	0.91	0.90	0.13	1.48	1.14	1.14	0.16	2.00	1.35	1.35	0.19	3.07	1.56	1.56	0.22	4.56	
		19	-	-	-	-	1.14	0.83	0.16	2.02	1.27	1.08	0.18	2.60	1.41	1.32	0.20	3.46	1.57	1.56	0.23	4.67	
		20	-	-	-	-	1.42	0.81	0.20	3.60	1.47	1.05	0.21	3.89	1.56	1.29	0.22	4.58	1.68	1.53	0.24	5.48	
	13	3	15	0.69	0.69	0.20	3.25	0.91	0.91	0.26	6.74	1.14	1.14	0.33	10.11	1.35	1.35	0.39	13.47	1.57	1.57	0.45	17.58
			17	0.71	0.68	0.20	3.52	0.91	0.91	0.26	6.75	1.14	1.14	0.33	10.14	1.36	1.36	0.39	13.52	1.57	1.57	0.45	17.63
			19	-	-	-	-	1.27	0.89	0.37	12.27	1.31	1.12	0.37	12.74	1.41	1.35	0.40	14.39	1.58	1.57	0.45	17.65
			20	-	-	-	-	1.68	0.91	0.48	19.60	1.66	1.12	0.48	19.30	1.66	1.34	0.48	19.33	1.71	1.56	0.49	20.34
		4	15	0.61	0.61	0.13	1.44	0.84	0.84	0.18	2.57	1.05	1.05	0.23	4.81	1.28	1.28	0.27	7.41	1.50	1.50	0.32	9.79
			17	0.61	0.61	0.13	1.45	0.84	0.84	0.18	2.58	1.06	1.06	0.23	4.83	1.28	1.28	0.27	7.44	1.50	1.50	0.32	9.82
			19	-	-	-	-	1.01	0.79	0.22	4.33	1.13	1.03	0.24	5.70	1.29	1.28	0.28	7.61	1.50	1.50	0.32	9.85
			20	-	-	-	-	1.36	0.79	0.29	8.30	1.38	1.02	0.29	8.47	1.46	1.25	0.31	9.33	1.57	1.49	0.34	10.62
5		15	0.51	0.51	0.09	0.95	0.76	0.76	0.13	1.41	0.98	0.98	0.17	2.19	1.20	1.20	0.21	3.72	1.42	1.42	0.24	5.74	
		17	0.51	0.51	0.09	0.95	0.76	0.76	0.13	1.41	0.99	0.99	0.17	2.20	1.20	1.20	0.21	3.74	1.42	1.42	0.24	5.76	
		19	-	-	-	-	0.85	0.72	0.15	1.63	1.02	0.97	0.18	2.42	1.20	1.20	0.21	3.77	1.42	1.42	0.24	5.79	
		20	-	-	-	-	1.05	0.68	0.18	2.65	1.15	0.93	0.20	3.38	1.29	1.17	0.22	4.53	1.45	1.41	0.25	6.05	
6	15	0.41	0.41	0.06	0.62	0.67	0.67	0.10	1.02	0.91	0.91	0.13	1.39	1.13	1.13	0.16	1.99	1.34	1.34	0.19	3.13		
	17	0.41	0.41	0.06	0.62	0.67	0.67	0.10	1.02	0.91	0.91	0.13	1.39	1.13	1.13	0.16	2.00	1.35	1.35	0.19	3.15		
	19	-	-	-	-	0.71	0.64	0.10	1.07	0.92	0.90	0.13	1.42	1.13	1.13	0.16	2.01	1.35	1.35	0.19	3.16		
	20	-	-	-	-	0.83	0.60	0.12	1.25	1.01	0.86	0.14	1.59	1.18	1.11	0.17	2.22	1.36	1.35	0.19	3.22		
15	3	15	0.46	0.46	0.13	1.38	0.68	0.68	0.19	3.28	0.91	0.91	0.26	6.67	1.13	1.13	0.32	9.80	1.35	1.35	0.39	13.23	
		17	0.46	0.46	0.13	1.38	0.68	0.68	0.20	3.29	0.91	0.91	0.26	6.70	1.14	1.14	0.32	9.83	1.35	1.35	0.39	13.28	
		19	-	-	-	-	0.72	0.67	0.21	3.82	0.91	0.91	0.26	6.70	1.14	1.14	0.32	9.87	1.36	1.36	0.39	13.32	
		20	-	-	-	-	0.95	0.65	0.27	7.30	1.04	0.89	0.30	8.45	1.17	1.13	0.33	10.35	1.36	1.35	0.39	13.31	
	4	15	0.36	0.36	0.08	0.81	0.61	0.61	0.13	1.37	0.83	0.83	0.18	2.61	1.05	1.05	0.23	4.88	1.28	1.28	0.27	7.36	
		17	0.36	0.36	0.08	0.81	0.61	0.61	0.13	1.37	0.83	0.83	0.18	2.62	1.05	1.05	0.23	4.90	1.28	1.28	0.27	7.38	
		19	-	-	-	-	0.62	0.60	0.13	1.40	0.83	0.83	0.18	2.62	1.06	1.06	0.23	4.92	1.28	1.28	0.27	7.40	
		20	-	-	-	-	0.73	0.56	0.16	1.85	0.88	0.81	0.19	3.06	1.06	1.05	0.23	4.99	1.28	1.28	0.27	7.42	
	5	15	0.24	0.24	0.04	0.43	0.52	0.52	0.09	0.92	0.76	0.76	0.13	1.36	0.98	0.98	0.17	2.29	1.20	1.20	0.21	3.91	
		17	0.25	0.25	0.04	0.43	0.52	0.52	0.09	0.92	0.76	0.76	0.13	1.36	0.99	0.99	0.17	2.30	1.20	1.20	0.21	3.93	
		19	-	-	-	-	0.52	0.52	0.09	0.92	0.76	0.76	0.13	1.37	0.99	0.99	0.17	2.31	1.20	1.20	0.21	3.95	
		20	-	-	-	-	0.56	0.49	0.10	0.99	0.78	0.75	0.13	1.41	0.99	0.99	0.17	2.31	1.20	1.20	0.21	3.96	
6	15	-	-	-	-	0.41	0.41	0.06	0.60	0.67	0.67	0.10	0.98	0.91	0.91	0.13	1.35	1.13	1.13	0.16	2.06		
	17	-	-	-	-	0.41	0.41	0.06	0.60	0.67	0.67	0.10	0.98	0.91	0.91	0.13	1.35	1.13	1.13	0.16	2.07		
	19	-	-	-	-	0.41	0.41	0.06	0.60	0.67	0.67	0.10	0.98	0.91	0.91	0.13	1.35	1.14	1.14	0.16	2.08		
	20	-	-	-	-	0.42	0.40	0.06	0.61	0.68	0.67	0.10	0.99	0.91	0.91	0.13	1.35	1.14	1.14	0.16	2.09		

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH1-V350-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
5	3	15	3.14	2.34	0.90	36.92	3.12	2.66	0.89	36.53	3.16	2.99	0.90	37.31	3.32	3.32	0.95	40.89	3.63	3.63	1.05	48.06	
		17	4.12	2.36	1.18	58.93	4.09	2.68	1.17	58.27	4.06	3.00	1.16	57.61	4.04	3.31	1.16	56.95	4.02	3.62	1.15	56.53	
		19	-	-	-	-	5.13	2.70	1.47	86.42	5.09	3.01	1.46	85.45	5.06	3.33	1.45	84.52	5.03	3.64	1.44	83.59	
		20	-	-	-	-	5.68	2.71	1.65	104.84	5.64	3.02	1.63	103.64	5.61	3.34	1.62	101.74	5.57	3.65	1.61	100.87	
	4	15	2.84	2.20	0.61	19.08	2.87	2.53	0.62	19.42	2.98	2.88	0.64	20.73	3.21	3.21	0.69	23.31	3.53	3.53	0.76	27.37	
		17	3.85	2.23	0.82	31.73	3.82	2.55	0.82	31.37	3.80	2.87	0.81	31.01	3.78	3.18	0.81	30.74	3.81	3.51	0.82	31.20	
		19	-	-	-	-	4.88	2.58	1.05	47.79	4.84	2.90	1.04	47.26	4.81	3.21	1.03	46.74	4.78	3.52	1.03	46.23	
		20	-	-	-	-	5.43	2.59	1.17	58.17	5.40	2.91	1.17	57.54	5.36	3.22	1.16	56.91	5.33	3.53	1.15	55.98	
	5	15	2.50	2.04	0.43	10.11	2.61	2.39	0.45	11.08	2.80	2.75	0.48	12.61	3.09	3.09	0.53	15.03	3.41	3.41	0.59	17.77	
		17	3.53	2.09	0.61	18.81	3.51	2.41	0.60	18.59	3.49	2.73	0.60	18.40	3.52	3.06	0.61	18.66	3.61	3.39	0.62	19.50	
		19	-	-	-	-	4.60	2.45	0.79	29.48	4.57	2.77	0.79	29.17	4.54	3.08	0.78	28.84	4.50	3.39	0.77	28.25	
		20	-	-	-	-	5.16	2.46	0.89	35.98	5.13	2.78	0.88	35.60	5.10	3.10	0.88	35.21	5.06	3.41	0.87	34.83	
6	15	2.25	1.91	0.32	4.94	2.42	2.27	0.35	5.98	2.65	2.63	0.38	7.57	2.96	2.96	0.42	9.87	3.29	3.29	0.47	12.16		
	17	3.14	1.91	0.45	11.15	3.12	2.23	0.45	11.00	3.15	2.57	0.45	11.22	3.26	2.92	0.47	11.94	3.41	3.27	0.49	12.94		
	19	-	-	-	-	4.26	2.30	0.61	18.77	4.23	2.62	0.61	18.56	4.21	2.93	0.60	18.35	4.18	3.24	0.60	18.18		
	20	-	-	-	-	4.84	2.32	0.69	23.35	4.81	2.64	0.69	23.09	4.78	2.96	0.68	22.84	4.75	3.27	0.68	22.59		
7	3	15	2.41	2.00	0.69	23.19	2.48	2.34	0.71	24.35	2.68	2.68	0.77	27.76	3.00	3.00	0.87	34.17	3.31	3.31	0.96	40.55	
		17	3.40	2.02	0.98	41.82	3.38	2.35	0.97	41.32	3.35	2.66	0.96	40.85	3.35	2.98	0.96	40.84	3.42	3.31	0.98	42.19	
		19	-	-	-	-	4.43	2.37	1.28	66.58	4.40	2.68	1.27	65.75	4.37	3.00	1.26	64.73	4.34	3.31	1.25	63.86	
		20	-	-	-	-	4.98	2.37	1.44	82.31	4.94	2.69	1.42	80.20	4.91	3.01	1.41	79.29	4.88	3.32	1.40	78.39	
	4	15	2.13	1.86	0.46	11.56	2.30	2.22	0.50	13.13	2.57	2.57	0.55	15.87	2.89	2.89	0.62	19.23	3.21	3.21	0.69	22.99	
		17	3.09	1.89	0.66	21.54	3.07	2.21	0.66	21.28	3.06	2.53	0.66	21.22	3.12	2.87	0.67	21.97	3.26	3.20	0.70	23.66	
		19	-	-	-	-	4.14	2.24	0.89	35.62	4.12	2.56	0.89	35.54	4.09	2.88	0.89	35.23	4.07	3.19	0.88	34.82	
		20	-	-	-	-	4.71	2.25	1.02	44.86	4.68	2.57	1.01	44.36	4.65	2.89	1.01	43.86	4.62	3.20	1.00	43.36	
	5	15	1.89	1.73	0.33	5.24	2.12	2.09	0.36	7.04	2.43	2.43	0.42	9.68	2.77	2.77	0.48	12.19	3.09	3.09	0.53	14.73	
		17	2.71	1.72	0.47	11.72	2.70	2.05	0.46	11.66	2.77	2.39	0.48	12.21	2.91	2.74	0.50	13.28	3.12	3.09	0.54	14.93	
		19	-	-	-	-	3.82	2.10	0.66	21.06	3.80	2.42	0.65	20.82	3.80	2.83	0.65	36.50	3.76	3.05	0.65	20.51	
		20	-	-	-	-	4.40	2.12	0.76	27.06	4.38	2.44	0.76	26.76	4.34	2.76	0.75	26.27	4.31	3.07	0.74	25.89	
6	15	1.74	1.64	0.25	2.65	2.00	1.99	0.29	3.77	2.31	2.31	0.33	5.53	2.64	2.64	0.38	7.72	2.96	2.96	0.42	9.94		
	17	2.29	1.54	0.33	5.42	2.36	1.89	0.34	5.91	2.51	2.26	0.36	6.88	2.71	2.62	0.39	8.26	2.97	2.97	0.43	9.99		
	19	-	-	-	-	3.44	1.94	0.49	12.83	3.41	2.26	0.49	12.67	3.41	2.58	0.49	12.64	3.46	2.91	0.50	13.01		
	20	-	-	-	-	4.05	1.97	0.58	16.96	4.02	2.29	0.58	16.76	3.99	2.61	0.57	16.56	3.97	2.92	0.57	16.37		
9	3	15	1.76	1.68	0.50	13.32	2.03	2.02	0.58	17.07	2.35	2.35	0.68	21.91	2.68	2.68	0.77	27.67	2.99	2.99	0.86	33.07	
		17	2.62	1.68	0.76	26.46	2.60	2.00	0.75	25.87	2.63	2.34	0.76	26.76	2.74	2.67	0.79	28.76	3.00	3.00	0.86	33.18	
		19	-	-	-	-	3.67	2.03	1.06	47.58	3.64	2.35	1.05	47.01	3.62	2.67	1.05	46.45	3.59	2.98	1.04	45.90	
		20	-	-	-	-	4.22	2.04	1.21	59.94	4.19	2.36	1.21	59.22	4.16	2.67	1.20	58.51	4.13	2.99	1.19	57.83	
	4	15	1.58	1.55	0.34	6.01	1.90	1.90	0.41	9.22	2.24	2.24	0.48	12.24	2.56	2.56	0.55	15.46	2.89	2.89	0.62	18.99	
		17	2.24	1.52	0.48	12.23	2.27	1.86	0.49	12.54	2.40	2.22	0.52	13.88	2.59	2.56	0.56	15.70	2.89	2.89	0.62	19.05	
		19	-	-	-	-	3.35	1.90	0.72	24.57	3.32	2.22	0.72	24.27	3.30	2.54	0.71	23.98	3.32	2.86	0.72	24.25	
		20	-	-	-	-	3.91	1.91	0.84	31.83	3.89	2.23	0.84	31.45	3.86	2.55	0.83	31.09	3.83	2.86	0.83	30.71	
	5	15	1.46	1.45	0.25	2.69	1.78	1.78	0.31	4.59	2.10	2.10	0.36	7.12	2.44	2.44	0.42	9.67	2.77	2.77	0.48	12.01	
		17	1.83	1.35	0.32	5.02	1.97	1.72	0.34	6.10	2.18	2.09	0.37	7.72	2.44	2.44	0.42	9.71	2.77	2.77	0.48	12.04	
		19	-	-	-	-	2.96	1.74	0.51	13.40	2.94	2.06	0.51	13.22	2.97	2.39	0.51	13.48	3.07	2.74	0.53	14.34	
		20	-	-	-	-	3.56	1.77	0.61	18.38	3.54	2.09	0.61	18.16	3.51	2.41	0.60	17.93	3.50	2.73	0.60	17.87	
6	15	1.33	1.33	0.19	1.69	1.67	1.67	0.24	2.44	1.99	1.99	0.29	3.86	2.31	2.31	0.33	5.75	2.64	2.64	0.38	7.90		
	17	1.58	1.24	0.23	2.16	1.79	1.62	0.26	2.89	2.02	1.98	0.29	4.04	2.32	2.31	0.33	5.77	2.64	2.64	0.38	7.92		
	19	-	-	-	-	2.47	1.55	0.35	6.84	2.52	1.89	0.36	7.16	2.65	2.25	0.38	7.96	2.82	2.61	0.41	9.03		
	20	-	-	-	-	3.13	1.60	0.45	10.79	3.11	1.92	0.45	10.64	3.10	2.25	0.45	10.63	3.17	2.58	0.46	11.04		

Continued:

		MDKH1-V350-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.35	1.35	0.39	8.23	1.69	1.69	0.48	12.18	2.03	2.03	0.58	16.51	2.35	2.35	0.67	21.30	2.67	2.67	0.76	26.52	
		17	1.74	1.32	0.50	12.75	1.85	1.68	0.53	14.22	2.04	2.03	0.58	16.70	2.36	2.36	0.67	21.37	2.68	2.68	0.76	26.61	
		19	-	-	-	-	2.83	1.68	0.81	29.23	2.81	2.01	0.80	28.84	2.80	2.33	0.80	28.74	2.86	2.66	0.82	29.88	
		20	-	-	-	-	3.40	1.70	0.98	40.69	3.38	2.02	0.97	40.19	3.35	2.34	0.96	39.69	3.33	2.66	0.96	39.18	
	4	15	1.23	1.23	0.26	3.18	1.56	1.56	0.33	5.99	1.90	1.90	0.41	9.09	2.24	2.24	0.48	11.97	2.56	2.56	0.55	15.08	
		17	1.41	1.17	0.30	4.56	1.62	1.55	0.35	6.53	1.91	1.90	0.41	9.11	2.24	2.24	0.48	12.00	2.57	2.57	0.55	15.12	
		19	-	-	-	-	2.44	1.53	0.52	13.86	2.44	1.86	0.52	13.87	2.53	2.21	0.54	14.69	2.67	2.55	0.57	16.18	
		20	-	-	-	-	3.04	1.56	0.65	20.17	3.02	1.88	0.65	19.91	3.00	2.20	0.64	19.65	3.03	2.53	0.65	20.01	
	5	15	1.12	1.12	0.19	1.65	1.46	1.46	0.25	2.79	1.78	1.78	0.31	4.80	2.11	2.11	0.36	7.29	2.45	2.45	0.42	9.58	
		17	1.21	1.07	0.21	1.84	1.48	1.45	0.25	2.90	1.78	1.78	0.31	4.81	2.11	2.11	0.36	7.32	2.45	2.45	0.42	9.61	
		19	-	-	-	-	1.97	1.35	0.34	6.25	2.09	1.71	0.36	7.16	2.27	2.08	0.39	8.44	2.50	2.44	0.43	9.93	
		20	-	-	-	-	2.61	1.40	0.45	10.67	2.59	1.72	0.45	10.51	2.64	2.06	0.45	10.87	2.75	2.41	0.47	11.70	
	6	15	0.98	0.98	0.14	1.18	1.34	1.34	0.19	1.63	1.67	1.67	0.24	2.51	1.99	1.99	0.29	4.03	2.32	2.32	0.33	5.89	
		17	1.01	0.96	0.15	1.21	1.35	1.34	0.19	1.64	1.68	1.68	0.24	2.52	2.00	2.00	0.29	4.04	2.32	2.32	0.33	5.92	
		19	-	-	-	-	1.66	1.23	0.24	2.48	1.85	1.60	0.27	3.31	2.07	1.96	0.30	4.49	2.33	2.32	0.33	6.02	
		20	-	-	-	-	2.08	1.20	0.30	4.54	2.15	1.55	0.31	4.96	2.29	1.91	0.33	5.80	2.49	2.28	0.36	6.99	
	13	3	15	1.01	1.01	0.29	4.27	1.36	1.36	0.39	8.32	1.70	1.70	0.49	12.15	2.03	2.03	0.58	16.45	2.35	2.35	0.67	21.18
			17	1.04	1.00	0.30	4.59	1.36	1.36	0.39	8.33	1.70	1.70	0.49	12.19	2.03	2.03	0.58	16.50	2.35	2.35	0.68	21.25
			19	-	-	-	-	1.88	1.32	0.54	14.34	1.96	1.67	0.56	15.48	2.10	2.02	0.60	17.52	2.35	2.35	0.68	21.27
			20	-	-	-	-	2.49	1.35	0.72	23.42	2.47	1.67	0.71	23.07	2.47	2.00	0.71	23.11	2.55	2.34	0.73	24.39
		4	15	0.90	0.90	0.19	1.62	1.23	1.23	0.27	3.37	1.56	1.56	0.34	6.15	1.91	1.91	0.41	8.97	2.24	2.24	0.48	11.77
			17	0.91	0.90	0.20	1.63	1.24	1.24	0.27	3.38	1.57	1.57	0.34	6.18	1.91	1.91	0.41	9.00	2.24	2.24	0.48	11.81
			19	-	-	-	-	1.48	1.17	0.32	5.40	1.68	1.54	0.36	7.19	1.93	1.91	0.41	9.17	2.24	2.24	0.48	11.84
			20	-	-	-	-	2.03	1.18	0.43	9.93	2.05	1.52	0.44	10.12	2.17	1.87	0.46	11.16	2.34	2.23	0.50	12.72
5		15	0.76	0.76	0.13	1.05	1.12	1.12	0.19	1.58	1.45	1.45	0.25	2.85	1.78	1.78	0.30	4.90	2.11	2.11	0.36	7.26	
		17	0.76	0.76	0.13	1.04	1.12	1.12	0.19	1.59	1.45	1.45	0.25	2.86	1.78	1.78	0.31	4.92	2.12	2.12	0.36	7.28	
		19	-	-	-	-	1.25	1.06	0.21	1.94	1.50	1.43	0.26	3.12	1.78	1.78	0.31	4.95	2.12	2.12	0.36	7.31	
		20	-	-	-	-	1.53	1.00	0.26	3.31	1.69	1.37	0.29	4.33	1.90	1.74	0.33	5.83	2.16	2.11	0.37	7.55	
6	15	0.60	0.60	0.09	0.67	0.99	0.99	0.14	1.12	1.34	1.34	0.19	1.57	1.67	1.67	0.24	2.57	1.99	1.99	0.28	4.13		
	17	0.60	0.60	0.09	0.67	0.99	0.99	0.14	1.12	1.34	1.34	0.19	1.58	1.67	1.67	0.24	2.58	1.99	1.99	0.29	4.15		
	19	-	-	-	-	1.04	0.95	0.15	1.17	1.36	1.33	0.19	1.61	1.67	1.67	0.24	2.59	2.00	2.00	0.29	4.17		
	20	-	-	-	-	1.21	0.88	0.17	1.37	1.48	1.27	0.21	1.90	1.73	1.64	0.25	2.85	2.01	1.99	0.29	4.23		
15	3	15	0.68	0.68	0.19	1.57	1.01	1.01	0.29	4.32	1.36	1.36	0.39	8.09	1.69	1.69	0.48	11.78	2.02	2.02	0.58	16.16	
		17	0.68	0.68	0.19	1.58	1.01	1.01	0.29	4.34	1.36	1.36	0.39	8.11	1.70	1.70	0.48	11.82	2.03	2.03	0.58	16.21	
		19	-	-	-	-	1.07	0.99	0.30	4.95	1.36	1.35	0.39	8.12	1.70	1.70	0.48	11.86	2.03	2.03	0.58	16.26	
		20	-	-	-	-	1.42	0.97	0.41	8.72	1.55	1.33	0.44	10.09	1.74	1.69	0.50	12.40	2.03	2.02	0.58	16.24	
	4	15	0.53	0.53	0.11	0.88	0.90	0.90	0.19	1.57	1.23	1.23	0.26	3.43	1.57	1.57	0.34	6.25	1.91	1.91	0.41	8.84	
		17	0.54	0.54	0.11	0.89	0.90	0.90	0.19	1.57	1.23	1.23	0.26	3.44	1.57	1.57	0.34	6.27	1.91	1.91	0.41	8.87	
		19	-	-	-	-	0.92	0.90	0.20	1.61	1.23	1.23	0.26	3.45	1.57	1.57	0.34	6.29	1.91	1.91	0.41	8.89	
		20	-	-	-	-	1.06	0.83	0.23	2.30	1.30	1.21	0.28	3.96	1.58	1.57	0.34	6.36	1.91	1.91	0.41	8.91	
	5	15	0.36	0.36	0.06	0.47	0.77	0.77	0.13	1.01	1.13	1.13	0.19	1.58	1.45	1.45	0.25	3.00	1.78	1.78	0.31	5.12	
		17	0.36	0.36	0.06	0.47	0.77	0.77	0.13	1.01	1.13	1.13	0.19	1.59	1.45	1.45	0.25	3.01	1.78	1.78	0.31	5.14	
		19	-	-	-	-	0.77	0.77	0.13	1.01	1.13	1.13	0.19	1.59	1.46	1.46	0.25	3.02	1.79	1.79	0.31	5.16	
		20	-	-	-	-	0.83	0.72	0.14	1.09	1.15	1.11	0.20	1.66	1.46	1.45	0.25	3.02	1.79	1.79	0.31	5.17	
6	15	-	-	-	-	0.61	0.61	0.09	0.65	0.99	0.99	0.14	1.08	1.35	1.35	0.19	1.57	1.67	1.67	0.24	2.70		
	17	-	-	-	-	0.61	0.61	0.09	0.65	0.99	0.99	0.14	1.08	1.35	1.35	0.19	1.58	1.67	1.67	0.24	2.71		
	19	-	-	-	-	0.61	0.61	0.09	0.65	1.00	1.00	0.14	1.08	1.35	1.35	0.19	1.58	1.68	1.68	0.24	2.72		
	20	-	-	-	-	0.62	0.59	0.09	0.66	1.00	0.99	0.14	1.08	1.35	1.35	0.19	1.58	1.68	1.68	0.24	2.73		

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH1-V500-R4																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
5	3	15	3.92	2.94	1.12	53.97	3.89	3.35	1.11	53.40	3.95	3.76	1.13	54.85	4.18	4.18	1.20	60.50	4.58	4.58	1.31	70.92
		17	5.15	2.96	1.48	86.98	5.12	3.37	1.47	86.04	5.08	3.77	1.46	85.10	5.05	4.17	1.45	84.22	5.03	4.56	1.45	83.67
		19	-	-	-	-	6.43	3.38	1.85	128.79	6.39	3.79	1.85	128.48	6.36	4.19	1.85	127.97	6.32	4.59	1.83	126.61
		20	-	-	-	-	7.12	3.39	2.05	154.35	7.08	3.79	2.04	152.76	7.04	4.20	2.03	151.16	7.00	4.59	2.02	149.68
	4	15	3.52	2.75	0.75	27.23	3.56	3.18	0.76	27.79	3.72	3.61	0.80	29.96	4.03	4.03	0.87	34.47	4.44	4.44	0.95	40.60
		17	4.79	2.79	1.03	46.28	4.76	3.20	1.02	45.79	4.73	3.60	1.02	45.31	4.71	4.00	1.01	44.92	4.76	4.41	1.02	45.75
		19	-	-	-	-	6.09	3.22	1.31	70.19	6.05	3.63	1.30	69.47	6.02	4.03	1.29	68.75	5.98	4.42	1.29	68.02
		20	-	-	-	-	6.79	3.23	1.46	84.89	6.75	3.64	1.45	84.04	6.71	4.04	1.44	83.18	6.67	4.44	1.43	82.32
	5	15	3.11	2.55	0.54	15.09	3.26	3.01	0.56	16.38	3.51	3.46	0.60	18.58	3.88	3.88	0.67	21.89	4.28	4.28	0.74	25.97
		17	4.38	2.60	0.75	26.87	4.35	3.01	0.75	26.57	4.32	3.41	0.74	26.30	4.36	3.83	0.75	26.77	4.50	4.26	0.78	28.44
		19	-	-	-	-	5.71	3.05	0.98	42.51	5.68	3.46	0.98	42.08	5.64	3.86	0.97	41.65	5.61	4.25	0.96	41.23
		20	-	-	-	-	6.42	3.06	1.10	52.09	6.39	3.47	1.10	51.81	6.35	3.88	1.09	51.34	6.32	4.28	1.09	51.01
6	15	2.71	2.35	0.39	8.07	2.96	2.82	0.42	9.89	3.30	3.28	0.47	12.20	3.71	3.71	0.53	14.95	4.12	4.12	0.59	17.76	
	17	3.91	2.39	0.56	16.27	3.88	2.80	0.56	16.07	3.92	3.23	0.56	16.35	4.04	3.66	0.58	17.16	4.25	4.10	0.61	18.71	
	19	-	-	-	-	5.29	2.86	0.76	27.12	5.26	3.27	0.75	26.84	5.23	3.67	0.75	26.56	5.20	4.07	0.74	26.31	
	20	-	-	-	-	6.03	2.89	0.87	34.16	5.99	3.30	0.86	33.80	5.96	3.70	0.86	33.46	5.92	4.10	0.85	33.12	
7	3	15	3.00	2.51	0.87	34.12	3.10	2.94	0.90	36.08	3.37	3.36	0.97	41.13	3.77	3.77	1.08	50.13	4.17	4.17	1.20	59.75
		17	4.24	2.53	1.22	61.31	4.21	2.94	1.21	60.61	4.18	3.35	1.20	59.91	4.18	3.75	1.20	59.86	4.29	4.17	1.24	62.92
		19	-	-	-	-	5.54	2.97	1.61	99.30	5.50	3.37	1.60	98.22	5.47	3.77	1.59	97.18	5.43	4.17	1.57	94.71
		20	-	-	-	-	6.24	2.97	1.82	122.48	6.20	3.38	1.80	121.19	6.16	3.78	1.79	119.90	6.12	4.18	1.78	118.61
	4	15	2.64	2.33	0.57	16.59	2.86	2.78	0.61	18.86	3.22	3.22	0.69	23.08	3.63	3.63	0.78	28.37	4.03	4.03	0.87	34.37
		17	3.84	2.36	0.83	31.56	3.82	2.77	0.83	31.21	3.81	3.18	0.82	31.11	3.90	3.60	0.84	32.35	4.09	4.03	0.88	35.17
		19	-	-	-	-	5.17	2.80	1.12	52.66	5.13	3.21	1.11	52.10	5.10	3.61	1.10	51.54	5.07	4.01	1.10	50.97
		20	-	-	-	-	5.86	2.81	1.26	65.04	5.83	3.22	1.26	64.35	5.80	3.62	1.25	64.06	5.76	4.02	1.25	63.57
	5	15	2.30	2.14	0.40	8.62	2.63	2.61	0.45	11.19	3.05	3.05	0.52	14.37	3.47	3.47	0.60	17.88	3.88	3.88	0.67	21.64
		17	3.36	2.15	0.58	16.95	3.35	2.57	0.58	16.85	3.44	3.00	0.59	17.60	3.63	3.44	0.62	19.27	3.90	3.88	0.67	21.84
		19	-	-	-	-	4.75	2.62	0.82	30.77	4.72	3.03	0.82	30.44	4.73	3.54	0.81	53.00	4.68	3.84	0.81	30.01
		20	-	-	-	-	5.46	2.64	0.94	38.87	5.43	3.05	0.93	38.48	5.40	3.45	0.93	38.07	5.36	3.85	0.92	37.67
6	15	2.08	1.99	0.30	4.23	2.44	2.44	0.35	6.37	2.87	2.87	0.41	9.30	3.30	3.30	0.47	11.98	3.72	3.72	0.53	14.69	
	17	2.76	1.90	0.40	8.60	2.88	2.35	0.41	9.39	3.10	2.82	0.44	10.76	3.38	3.28	0.48	12.48	3.72	3.72	0.53	14.74	
	19	-	-	-	-	4.26	2.41	0.61	18.55	4.23	2.82	0.61	18.33	4.22	3.24	0.61	18.27	4.30	3.66	0.62	18.85	
	20	-	-	-	-	5.02	2.45	0.72	24.61	4.99	2.86	0.72	24.34	4.96	3.26	0.71	24.08	4.92	3.67	0.71	23.82	
9	3	15	2.19	2.10	0.63	19.28	2.54	2.54	0.73	24.94	2.96	2.96	0.85	32.38	3.36	3.36	0.97	40.50	3.77	3.77	1.09	49.95
		17	3.25	2.10	0.93	38.04	3.22	2.51	0.93	37.53	3.26	2.93	0.94	38.35	3.43	3.36	0.99	42.36	3.78	3.78	1.09	50.09
		19	-	-	-	-	4.56	2.54	1.31	68.80	4.53	2.95	1.31	68.03	4.50	3.35	1.30	67.25	4.47	3.75	1.29	66.48
		20	-	-	-	-	5.27	2.55	1.53	89.82	5.24	2.96	1.52	88.82	5.20	3.36	1.51	87.47	5.17	3.76	1.50	86.87
	4	15	1.95	1.93	0.42	9.70	2.38	2.38	0.51	13.73	2.80	2.80	0.60	18.04	3.22	3.22	0.69	22.86	3.62	3.62	0.78	27.91
		17	2.77	1.90	0.60	17.63	2.81	2.33	0.61	18.11	2.97	2.78	0.64	19.96	3.24	3.22	0.70	23.23	3.63	3.63	0.78	27.99
		19	-	-	-	-	4.15	2.36	0.89	35.13	4.12	2.77	0.89	34.73	4.09	3.18	0.88	34.32	4.12	3.59	0.89	34.84
		20	-	-	-	-	4.87	2.38	1.05	46.78	4.84	2.79	1.05	46.39	4.81	3.20	1.04	45.88	4.78	3.60	1.04	45.37
	5	15	1.76	1.76	0.30	4.51	2.19	2.19	0.38	7.82	2.63	2.63	0.45	10.99	3.06	3.06	0.53	14.28	3.47	3.47	0.60	17.63
		17	2.21	1.67	0.38	7.99	2.43	2.14	0.42	9.56	2.71	2.61	0.47	11.55	3.06	3.06	0.53	14.31	3.48	3.48	0.60	17.68
		19	-	-	-	-	3.66	2.17	0.63	19.23	3.63	2.58	0.63	18.98	3.67	3.00	0.63	19.37	3.80	3.43	0.66	20.59
		20	-	-	-	-	4.41	2.19	0.76	26.47	4.38	2.61	0.75	26.17	4.35	3.01	0.75	25.86	4.34	3.42	0.75	25.77
6	15	1.62	1.62	0.23	2.27	2.03	2.03	0.29	4.06	2.44	2.44	0.35	6.64	2.88	2.88	0.41	9.36	3.31	3.31	0.47	11.86	
	17	1.85	1.51	0.27	3.21	2.13	1.98	0.31	4.67	2.47	2.44	0.35	6.81	2.88	2.88	0.41	9.38	3.31	3.31	0.48	11.90	
	19	-	-	-	-	3.05	1.93	0.44	10.32	3.11	2.37	0.45	10.67	3.28	2.82	0.47	11.69	3.51	3.27	0.50	13.12	
	20	-	-	-	-	3.87	1.98	0.56	15.45	3.84	2.40	0.55	15.26	3.84	2.81	0.55	15.22	3.93	3.24	0.56	15.86	

Continued:

		MDKH1-V500-R4																				
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
11	3	15	1.69	1.69	0.48	12.11	2.12	2.12	0.61	17.84	2.54	2.54	0.73	24.33	2.95	2.95	0.84	31.49	3.36	3.36	0.97	39.90
		17	2.15	1.65	0.61	18.23	2.29	2.10	0.65	20.28	2.55	2.54	0.73	24.51	2.96	2.96	0.84	31.58	3.37	3.37	0.97	40.01
		19	-	-	-	-	3.52	2.11	1.01	42.86	3.49	2.52	1.01	42.61	3.49	2.93	1.00	42.47	3.57	3.35	1.02	43.78
		20	-	-	-	-	4.22	2.12	1.21	58.55	4.19	2.53	1.20	57.85	4.17	2.94	1.19	57.17	4.14	3.34	1.18	56.49
	4	15	1.50	1.50	0.32	5.44	1.95	1.95	0.42	9.45	2.38	2.38	0.51	13.30	2.80	2.80	0.60	17.56	3.22	3.22	0.69	22.22
		17	1.70	1.45	0.36	7.32	2.01	1.93	0.43	9.95	2.38	2.38	0.51	13.32	2.81	2.81	0.60	17.61	3.22	3.22	0.69	22.28
		19	-	-	-	-	3.02	1.91	0.65	19.84	3.02	2.33	0.65	19.85	3.13	2.77	0.67	21.18	3.33	3.21	0.71	23.59
		20	-	-	-	-	3.77	1.94	0.81	29.13	3.74	2.35	0.80	28.77	3.71	2.76	0.80	28.40	3.75	3.18	0.81	28.98
	5	15	1.36	1.36	0.23	2.33	1.77	1.77	0.30	4.75	2.21	2.21	0.38	7.97	2.64	2.64	0.46	10.91	3.06	3.06	0.53	13.92
		17	1.44	1.31	0.25	2.71	1.78	1.77	0.31	4.85	2.21	2.21	0.38	8.00	2.65	2.65	0.46	10.94	3.07	3.07	0.53	13.96
		19	-	-	-	-	2.42	1.69	0.42	9.39	2.59	2.15	0.45	10.50	2.83	2.61	0.49	12.21	3.11	3.06	0.53	14.32
		20	-	-	-	-	3.22	1.74	0.56	15.27	3.20	2.15	0.55	15.03	3.26	2.58	0.56	15.56	3.41	3.02	0.59	16.86
6	15	1.19	1.19	0.17	1.42	1.63	1.63	0.23	2.34	2.03	2.03	0.29	4.27	2.46	2.46	0.35	6.78	2.89	2.89	0.41	9.25	
	17	1.21	1.16	0.17	1.45	1.63	1.63	0.23	2.35	2.04	2.04	0.29	4.28	2.46	2.46	0.35	6.80	2.90	2.90	0.41	9.27	
	19	-	-	-	-	1.94	1.49	0.28	3.78	2.21	1.96	0.32	5.26	2.54	2.44	0.36	7.27	2.91	2.90	0.42	9.34	
	20	-	-	-	-	2.48	1.47	0.35	6.95	2.60	1.92	0.37	7.62	2.82	2.39	0.40	8.86	3.09	2.86	0.44	10.35	
13	3	15	1.25	1.25	0.36	7.16	1.70	1.70	0.49	12.15	2.12	2.12	0.61	17.84	2.54	2.54	0.73	24.25	2.95	2.95	0.84	30.98
		17	1.28	1.25	0.37	7.47	1.70	1.70	0.49	12.17	2.13	2.13	0.61	17.88	2.55	2.55	0.73	24.32	2.95	2.95	0.84	31.07
		19	-	-	-	-	2.34	1.66	0.67	20.96	2.42	2.09	0.70	22.27	2.62	2.54	0.75	25.55	2.96	2.95	0.84	31.11
		20	-	-	-	-	3.07	1.68	0.88	33.23	3.05	2.09	0.87	32.73	3.05	2.51	0.87	32.86	3.17	2.94	0.91	35.05
	4	15	1.09	1.09	0.23	2.41	1.51	1.51	0.32	5.65	1.95	1.95	0.42	9.36	2.39	2.39	0.51	13.12	2.81	2.81	0.60	17.49
		17	1.09	1.09	0.24	2.42	1.51	1.51	0.32	5.67	1.96	1.96	0.42	9.38	2.39	2.39	0.51	13.16	2.81	2.81	0.61	17.54
		19	-	-	-	-	1.82	1.45	0.39	8.24	2.09	1.93	0.45	10.45	2.41	2.39	0.52	13.35	2.82	2.82	0.61	17.59
		20	-	-	-	-	2.50	1.47	0.54	14.17	2.53	1.90	0.55	14.64	2.69	2.35	0.58	16.23	2.92	2.80	0.63	18.69
	5	15	0.91	0.91	0.16	1.26	1.36	1.36	0.23	2.38	1.77	1.77	0.30	4.88	2.21	2.21	0.38	7.89	2.65	2.65	0.45	10.69
		17	0.91	0.91	0.16	1.26	1.36	1.36	0.23	2.38	1.77	1.77	0.30	4.90	2.22	2.22	0.38	7.91	2.65	2.65	0.45	10.72
		19	-	-	-	-	1.47	1.29	0.25	2.98	1.81	1.76	0.31	5.18	2.22	2.22	0.38	7.92	2.65	2.65	0.46	10.75
		20	-	-	-	-	1.80	1.22	0.31	5.10	2.05	1.70	0.35	6.85	2.36	2.18	0.40	8.79	2.69	2.65	0.46	11.00
6	15	0.71	0.71	0.10	0.80	1.19	1.19	0.17	1.35	1.62	1.62	0.23	2.39	2.04	2.04	0.29	4.40	2.47	2.47	0.35	6.89	
	17	0.71	0.71	0.10	0.80	1.19	1.19	0.17	1.35	1.63	1.63	0.23	2.40	2.04	2.04	0.29	4.41	2.47	2.47	0.35	6.91	
	19	-	-	-	-	1.24	1.16	0.18	1.41	1.64	1.62	0.23	2.44	2.04	2.04	0.29	4.43	2.48	2.48	0.35	6.93	
	20	-	-	-	-	1.43	1.08	0.20	1.75	1.75	1.55	0.25	2.94	2.09	2.02	0.30	4.72	2.48	2.48	0.36	6.96	
15	3	15	0.82	0.82	0.23	2.43	1.25	1.25	0.36	7.07	1.70	1.70	0.48	11.81	2.12	2.12	0.61	17.56	2.53	2.53	0.72	23.52
		17	0.82	0.82	0.23	2.44	1.26	1.26	0.36	7.09	1.70	1.70	0.48	11.84	2.13	2.13	0.61	17.61	2.54	2.54	0.73	23.58
		19	-	-	-	-	1.31	1.24	0.38	7.66	1.70	1.69	0.48	11.84	2.13	2.13	0.61	17.66	2.54	2.54	0.73	23.66
		20	-	-	-	-	1.74	1.21	0.50	12.38	1.92	1.67	0.55	14.73	2.18	2.12	0.63	18.30	2.54	2.54	0.73	23.65
	4	15	0.64	0.64	0.14	1.06	1.09	1.09	0.23	2.46	1.52	1.52	0.32	5.82	1.96	1.96	0.42	9.36	2.39	2.39	0.52	13.10
		17	0.64	0.64	0.14	1.06	1.09	1.09	0.23	2.47	1.52	1.52	0.33	5.84	1.97	1.97	0.42	9.38	2.39	2.39	0.52	13.13
		19	-	-	-	-	1.10	1.09	0.24	2.51	1.52	1.52	0.33	5.86	1.97	1.97	0.42	9.43	2.40	2.40	0.52	13.17
		20	-	-	-	-	1.24	1.02	0.27	3.54	1.59	1.50	0.34	6.40	1.98	1.97	0.43	9.48	2.40	2.40	0.52	13.19
	5	15	0.42	0.42	0.07	0.54	0.93	0.93	0.16	1.22	1.36	1.36	0.23	2.51	1.78	1.78	0.31	5.13	2.22	2.22	0.38	7.90
		17	0.42	0.42	0.07	0.55	0.93	0.93	0.16	1.22	1.36	1.36	0.23	2.52	1.78	1.78	0.31	5.15	2.23	2.23	0.38	7.92
		19	-	-	-	-	0.93	0.92	0.16	1.22	1.36	1.36	0.23	2.53	1.79	1.79	0.31	5.17	2.23	2.23	0.38	7.95
		20	-	-	-	-	0.98	0.88	0.17	1.29	1.38	1.35	0.24	2.61	1.79	1.78	0.31	5.16	2.23	2.23	0.38	7.96
6	15	-	-	-	-	0.72	0.72	0.10	0.77	1.20	1.20	0.17	1.31	1.63	1.63	0.23	2.52	2.04	2.04	0.29	4.62	
	17	-	-	-	-	0.72	0.72	0.10	0.77	1.20	1.20	0.17	1.31	1.63	1.63	0.23	2.53	2.05	2.05	0.29	4.64	
	19	-	-	-	-	0.72	0.72	0.10	0.77	1.20	1.20	0.17	1.31	1.63	1.63	0.23	2.54	2.05	2.05	0.29	4.66	
	20	-	-	-	-	0.73	0.71	0.10	0.78	1.21	1.21	0.17	1.32	1.63	1.63	0.23	2.54	2.05	2.05	0.29	4.67	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH1-V700-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	4.84	3.70	1.38	29.10	4.82	4.24	1.38	28.96	4.96	4.79	1.42	30.38	5.33	5.33	1.53	34.48	5.86	5.86	1.68	40.75	
		17	6.46	3.73	1.86	48.56	6.42	4.27	1.85	48.06	6.38	4.79	1.84	47.57	6.34	5.32	1.83	47.06	6.34	5.84	1.83	47.08	
		19	-	-	-	-	8.13	4.29	2.35	72.61	8.07	4.81	2.32	70.83	8.03	5.34	2.30	70.11	7.98	5.85	2.29	69.42	
		20	-	-	-	-	9.03	4.29	2.59	86.11	8.97	4.82	2.58	85.24	8.92	5.35	2.56	84.41	8.87	5.87	2.55	83.58	
	4	15	4.21	3.41	0.90	13.94	4.33	3.97	0.93	14.68	4.63	4.56	1.00	16.57	5.10	5.10	1.10	19.60	5.63	5.63	1.21	22.95	
		17	5.87	3.46	1.26	24.65	5.84	4.00	1.25	24.40	5.80	4.52	1.24	24.14	5.80	5.05	1.24	24.14	5.92	5.60	1.27	25.04	
		19	-	-	-	-	7.59	4.04	1.64	38.72	7.54	4.56	1.62	37.93	7.49	5.09	1.61	37.55	7.45	5.61	1.60	37.18	
		20	-	-	-	-	8.50	4.05	1.82	46.70	8.45	4.58	1.81	46.25	8.40	5.10	1.80	45.79	8.35	5.62	1.79	45.33	
	5	15	3.58	3.10	0.61	6.90	3.88	3.70	0.66	8.19	4.30	4.29	0.74	9.91	4.85	4.85	0.83	12.12	5.38	5.38	0.92	14.49	
		17	5.20	3.16	0.89	13.65	5.17	3.70	0.89	13.50	5.17	4.23	0.89	13.49	5.30	4.79	0.91	14.09	5.56	5.37	0.96	15.39	
		19	-	-	-	-	6.97	3.76	1.20	22.51	6.93	4.29	1.19	22.29	6.89	4.82	1.18	22.07	6.85	5.34	1.18	21.84	
		20	-	-	-	-	7.91	3.78	1.36	27.96	7.87	4.32	1.35	27.68	7.82	4.84	1.34	27.40	7.78	5.36	1.33	27.13	
	6	15	3.20	2.89	0.46	3.23	3.55	3.47	0.51	4.27	4.02	4.02	0.58	5.93	4.57	4.57	0.65	7.93	5.12	5.12	0.73	9.77	
		17	4.40	2.81	0.63	7.34	4.40	3.36	0.63	7.32	4.55	3.93	0.65	7.87	4.83	4.53	0.69	8.80	5.20	5.11	0.74	10.01	
		19	-	-	-	-	6.31	3.47	0.91	13.91	6.27	4.00	0.90	13.77	6.23	4.53	0.89	13.62	6.23	5.06	0.89	13.63	
		20	-	-	-	-	7.26	3.50	1.04	17.59	7.22	4.03	1.03	17.41	7.17	4.56	1.03	17.23	7.13	5.08	1.02	17.06	
	7	3	15	3.66	3.15	1.06	18.03	3.85	3.72	1.11	19.71	4.27	4.27	1.23	23.28	4.81	4.81	1.39	28.88	5.33	5.33	1.54	34.44
			17	5.26	3.18	1.52	33.68	5.23	3.72	1.51	33.32	5.19	4.25	1.50	32.93	5.23	4.78	1.51	33.33	5.42	5.33	1.57	35.51
			19	-	-	-	-	6.94	3.74	2.00	53.87	6.90	4.27	1.98	53.32	6.86	4.80	1.97	52.77	6.82	5.32	1.96	52.23
			20	-	-	-	-	7.86	3.75	2.27	67.33	7.81	4.29	2.26	66.65	7.77	4.81	2.24	65.96	7.72	5.33	2.22	65.04
4		15	3.12	2.87	0.67	8.34	3.51	3.47	0.76	10.17	4.04	4.04	0.87	12.98	4.58	4.58	0.99	16.08	5.10	5.10	1.10	19.20	
		17	4.62	2.90	1.00	16.31	4.59	3.44	0.99	16.11	4.63	3.99	1.00	16.35	4.80	4.55	1.03	17.28	5.13	5.11	1.10	19.37	
		19	-	-	-	-	6.36	3.48	1.37	27.93	6.32	4.02	1.36	27.64	6.28	4.54	1.35	27.35	6.24	5.06	1.34	27.06	
		20	-	-	-	-	7.28	3.50	1.57	35.54	7.25	4.04	1.57	35.37	7.20	4.57	1.56	35.01	7.16	5.09	1.55	34.66	
5		15	2.75	2.63	0.47	3.61	3.20	3.20	0.55	5.41	3.76	3.76	0.65	7.73	4.32	4.32	0.74	9.83	4.86	4.86	0.84	12.03	
		17	3.80	2.56	0.65	7.89	3.86	3.12	0.66	8.10	4.09	3.71	0.70	8.95	4.42	4.30	0.76	10.24	4.87	4.87	0.84	12.06	
		19	-	-	-	-	5.69	3.20	0.98	15.75	5.65	3.73	0.97	15.57	5.60	4.39	0.96	28.90	5.67	4.81	0.98	15.63	
		20	-	-	-	-	6.64	3.23	1.14	20.43	6.60	3.76	1.14	20.22	6.56	4.29	1.13	20.02	6.52	4.82	1.12	19.80	
6		15	2.51	2.46	0.36	1.84	2.99	2.99	0.43	2.84	3.51	3.51	0.50	4.36	4.04	4.04	0.58	6.16	4.60	4.60	0.66	7.98	
		17	3.13	2.28	0.45	3.22	3.33	2.86	0.48	3.82	3.65	3.45	0.52	4.80	4.07	4.04	0.58	6.26	4.60	4.60	0.66	8.00	
		19	-	-	-	-	4.88	2.87	0.70	8.82	4.84	3.40	0.69	8.71	4.92	3.96	0.70	8.93	5.11	4.54	0.73	9.56	
		20	-	-	-	-	5.90	2.93	0.85	12.18	5.86	3.46	0.84	12.05	5.83	3.99	0.83	11.92	5.82	4.53	0.83	11.90	
9		3	15	2.68	2.63	0.77	10.30	3.19	3.19	0.92	13.93	3.74	3.74	1.07	18.23	4.27	4.27	1.23	22.95	4.81	4.81	1.39	28.44
			17	3.94	2.61	1.13	19.94	3.92	3.15	1.12	19.72	4.03	3.71	1.16	20.71	4.31	4.28	1.24	23.28	4.81	4.81	1.39	28.52
			19	-	-	-	-	5.67	3.19	1.63	37.35	5.63	3.72	1.62	36.95	5.60	4.25	1.61	36.54	5.57	4.78	1.60	36.27
			20	-	-	-	-	6.60	3.21	1.91	49.23	6.56	3.74	1.90	48.70	6.52	4.27	1.89	48.20	6.48	4.79	1.88	47.69
	4	15	2.36	2.36	0.51	4.53	2.93	2.93	0.63	7.33	3.49	3.49	0.75	9.90	4.04	4.04	0.87	12.68	4.58	4.58	0.99	15.71	
		17	3.16	2.30	0.68	8.36	3.32	2.88	0.71	9.05	3.62	3.47	0.78	10.50	4.05	4.05	0.87	12.71	4.59	4.59	0.99	15.75	
		19	-	-	-	-	5.02	2.92	1.08	18.42	4.99	3.46	1.08	18.21	4.97	3.99	1.07	18.09	5.07	4.54	1.09	18.76	
		20	-	-	-	-	5.97	2.95	1.29	24.93	5.93	3.48	1.28	24.66	5.89	4.01	1.28	24.39	5.85	4.54	1.27	24.11	
	5	15	2.16	2.16	0.37	1.98	2.68	2.68	0.46	3.52	3.22	3.22	0.55	5.64	3.78	3.78	0.65	7.73	4.34	4.34	0.75	9.75	
		17	2.52	2.02	0.43	3.01	2.83	2.62	0.49	4.09	3.25	3.21	0.56	5.76	3.79	3.79	0.65	7.75	4.34	4.34	0.75	9.77	
		19	-	-	-	-	4.22	2.61	0.73	9.29	4.21	3.15	0.72	9.25	4.36	3.72	0.75	9.81	4.61	4.30	0.79	10.82	
		20	-	-	-	-	5.23	2.65	0.90	13.37	5.19	3.19	0.89	13.22	5.16	3.72	0.89	13.05	5.20	4.27	0.90	13.27	
	6	15	1.93	1.93	0.28	1.23	2.49	2.49	0.36	1.80	2.99	2.99	0.43	2.94	3.52	3.52	0.50	4.52	4.07	4.07	0.58	6.31	
		17	2.14	1.83	0.31	1.38	2.56	2.44	0.37	1.93	3.00	3.00	0.43	2.96	3.52	3.52	0.51	4.53	4.07	4.07	0.58	6.32	
		19	-	-	-	-	3.32	2.26	0.48	3.90	3.50	2.85	0.50	4.48	3.81	3.45	0.55	5.48	4.20	4.05	0.60	6.70	
		20	-	-	-	-	4.33	2.32	0.62	7.07	4.29	2.85	0.62	6.97	4.38	3.41	0.63	7.23	4.61	4.00	0.66	7.89	

Continued:

MDKH1-V700-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	2.08	2.08	0.59	6.49	2.65	2.65	0.75	9.85	3.20	3.20	0.91	13.61	3.74	3.74	1.07	17.78	4.28	4.28	1.22	22.36	
		17	2.51	2.03	0.72	8.99	2.78	2.63	0.79	10.67	3.20	3.20	0.91	13.62	3.75	3.75	1.07	17.83	4.28	4.28	1.22	22.42	
		19	-	-	-	-	4.28	2.63	1.22	22.40	4.25	3.16	1.21	22.09	4.28	3.71	1.22	22.41	4.47	4.27	1.28	24.11	
		20	-	-	-	-	5.21	2.64	1.49	31.44	5.18	3.18	1.48	31.09	5.14	3.71	1.47	30.73	5.12	4.24	1.46	30.47	
	4	15	1.84	1.84	0.39	2.37	2.37	2.37	0.51	4.68	2.95	2.95	0.63	7.24	3.51	3.51	0.75	9.72	4.05	4.05	0.87	12.43	
		17	1.98	1.77	0.42	2.89	2.40	2.37	0.51	4.78	2.95	2.95	0.63	7.25	3.51	3.51	0.75	9.74	4.06	4.06	0.87	12.46	
		19	-	-	-	-	3.49	2.32	0.75	9.61	3.56	2.89	0.76	9.94	3.79	3.47	0.81	11.07	4.13	4.05	0.88	12.83	
		20	-	-	-	-	4.49	2.37	0.96	14.80	4.46	2.91	0.96	14.62	4.45	3.45	0.95	14.55	4.57	4.00	0.98	15.25	
	5	15	1.63	1.63	0.28	1.20	2.17	2.17	0.37	2.07	2.69	2.69	0.46	3.71	3.24	3.24	0.56	5.79	3.81	3.81	0.66	7.69	
		17	1.69	1.60	0.29	1.25	2.17	2.17	0.37	2.08	2.69	2.69	0.46	3.72	3.25	3.25	0.56	5.81	3.81	3.81	0.66	7.71	
		19	-	-	-	-	2.67	2.01	0.46	3.65	2.96	2.61	0.51	4.73	3.36	3.22	0.58	6.19	3.83	3.82	0.66	7.77	
		20	-	-	-	-	3.60	2.04	0.62	6.99	3.60	2.59	0.62	6.99	3.80	3.18	0.65	7.64	4.09	3.77	0.70	8.68	
	6	15	1.38	1.38	0.20	0.83	1.95	1.95	0.28	1.19	2.49	2.49	0.36	1.87	3.00	3.00	0.43	3.09	3.54	3.54	0.51	4.71	
		17	1.39	1.37	0.20	0.84	1.96	1.95	0.28	1.19	2.50	2.50	0.36	1.87	3.01	3.01	0.43	3.10	3.54	3.54	0.51	4.72	
		19	-	-	-	-	2.25	1.83	0.32	1.47	2.62	2.42	0.38	2.14	3.04	3.00	0.44	3.20	3.55	3.54	0.51	4.73	
		20	-	-	-	-	2.73	1.73	0.39	2.40	2.93	2.32	0.42	2.92	3.25	2.92	0.47	3.84	3.65	3.51	0.52	5.02	
	13	3	15	1.52	1.52	0.44	3.25	2.09	2.09	0.60	6.59	2.66	2.66	0.76	9.89	3.20	3.20	0.91	13.42	3.75	3.75	1.08	17.77
			17	1.53	1.52	0.44	3.28	2.10	2.10	0.60	6.61	2.66	2.66	0.77	9.91	3.21	3.21	0.92	13.45	3.75	3.75	1.08	17.82
			19	-	-	-	-	2.73	2.05	0.78	10.34	2.92	2.63	0.84	11.61	3.25	3.21	0.93	13.76	3.76	3.76	1.08	17.87
			20	-	-	-	-	3.71	2.08	1.07	17.44	3.67	2.62	1.06	17.17	3.73	3.17	1.07	17.63	3.94	3.74	1.13	19.37
		4	15	1.32	1.32	0.28	1.17	1.85	1.85	0.40	2.53	2.39	2.39	0.52	4.91	2.96	2.96	0.63	7.18	3.51	3.51	0.75	9.61
			17	1.31	1.31	0.28	1.17	1.85	1.85	0.40	2.54	2.40	2.40	0.52	4.93	2.96	2.96	0.63	7.20	3.52	3.52	0.75	9.63
			19	-	-	-	-	2.06	1.77	0.44	3.42	2.46	2.37	0.53	5.17	2.97	2.96	0.64	7.21	3.52	3.52	0.76	9.66
			20	-	-	-	-	2.76	1.74	0.59	6.35	2.90	2.32	0.62	6.93	3.20	2.92	0.69	8.20	3.58	3.51	0.77	9.93
5		15	1.06	1.06	0.18	0.73	1.64	1.64	0.28	1.15	2.17	2.17	0.37	2.13	2.69	2.69	0.46	3.81	3.26	3.26	0.56	5.77	
		17	1.06	1.06	0.18	0.73	1.64	1.64	0.28	1.15	2.17	2.17	0.37	2.14	2.70	2.70	0.46	3.83	3.26	3.26	0.56	5.78	
		19	-	-	-	-	1.73	1.59	0.30	1.25	2.19	2.17	0.37	2.18	2.70	2.70	0.46	3.84	3.27	3.27	0.56	5.80	
		20	-	-	-	-	2.04	1.48	0.35	1.82	2.36	2.08	0.41	2.70	2.77	2.67	0.48	4.10	3.27	3.27	0.56	5.82	
6		15	0.78	0.78	0.11	0.44	1.39	1.39	0.20	0.79	1.96	1.96	0.28	1.15	2.49	2.49	0.36	1.92	3.01	3.01	0.43	3.19	
		17	0.78	0.78	0.11	0.44	1.39	1.39	0.20	0.79	1.97	1.97	0.28	1.15	2.50	2.50	0.36	1.92	3.01	3.01	0.43	3.20	
		19	-	-	-	-	1.41	1.38	0.20	0.80	1.97	1.97	0.28	1.15	2.50	2.50	0.36	1.93	3.02	3.02	0.43	3.22	
		20	-	-	-	-	1.57	1.28	0.22	0.89	2.06	1.91	0.30	1.23	2.52	2.49	0.36	1.98	3.02	3.02	0.43	3.22	
15		3	15	0.99	0.99	0.28	1.14	1.52	1.52	0.43	3.30	2.10	2.10	0.60	6.43	2.66	2.66	0.76	9.62	3.20	3.20	0.91	13.24
			17	0.99	0.99	0.28	1.14	1.52	1.52	0.43	3.31	2.10	2.10	0.60	6.45	2.66	2.66	0.76	9.65	3.21	3.21	0.92	13.27
			19	-	-	-	-	1.55	1.52	0.44	3.46	2.10	2.10	0.60	6.45	2.67	2.67	0.76	9.67	3.22	3.22	0.92	13.31
			20	-	-	-	-	1.94	1.46	0.55	5.64	2.27	2.07	0.65	7.33	2.69	2.67	0.77	9.79	3.22	3.22	0.92	13.33
		4	15	0.73	0.73	0.16	0.61	1.32	1.32	0.28	1.14	1.85	1.85	0.40	2.59	2.40	2.40	0.51	4.93	2.97	2.97	0.64	7.11
			17	0.73	0.73	0.16	0.61	1.32	1.32	0.28	1.14	1.85	1.85	0.40	2.60	2.40	2.40	0.52	4.94	2.97	2.97	0.64	7.13
			19	-	-	-	-	1.32	1.32	0.28	1.14	1.85	1.85	0.40	2.61	2.41	2.41	0.52	4.96	2.98	2.98	0.64	7.15
			20	-	-	-	-	1.45	1.25	0.31	1.38	1.88	1.84	0.40	2.72	2.41	2.40	0.52	4.95	2.98	2.98	0.64	7.16
	5	15	0.44	0.44	0.08	0.29	1.08	1.08	0.19	0.71	1.65	1.65	0.28	1.15	2.17	2.17	0.37	2.26	2.71	2.71	0.47	4.01	
		17	0.44	0.44	0.08	0.29	1.08	1.08	0.19	0.71	1.66	1.66	0.29	1.15	2.18	2.18	0.38	2.27	2.72	2.72	0.47	4.02	
		19	-	-	-	-	1.08	1.08	0.19	0.71	1.66	1.66	0.29	1.15	2.18	2.18	0.38	2.27	2.72	2.72	0.47	4.04	
		20	-	-	-	-	1.11	1.05	0.19	0.73	1.66	1.66	0.29	1.16	2.18	2.18	0.38	2.28	2.72	2.72	0.47	4.04	
	6	15	-	-	-	-	0.80	0.80	0.11	0.43	1.41	1.41	0.20	0.77	1.98	1.98	0.28	1.14	2.50	2.50	0.36	2.02	
		17	-	-	-	-	0.80	0.80	0.11	0.43	1.41	1.41	0.20	0.77	1.98	1.98	0.28	1.15	2.50	2.50	0.36	2.03	
		19	-	-	-	-	0.80	0.80	0.11	0.43	1.41	1.41	0.20	0.77	1.99	1.99	0.29	1.15	2.50	2.50	0.36	2.04	
		20	-	-	-	-	0.80	0.79	0.11	0.43	1.41	1.41	0.20	0.77	1.99	1.99	0.29	1.15	2.51	2.51	0.36	2.04	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH1-V800-R4																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	6.02	4.49	1.74	64.74	5.99	5.10	1.73	64.01	6.05	5.72	1.75	65.20	6.35	6.34	1.82	70.08	6.94	6.94	1.99	81.98
		17	7.88	4.52	2.28	103.57	7.82	5.13	2.26	101.59	7.77	5.73	2.24	100.38	7.72	6.33	2.22	98.63	7.68	6.92	2.21	97.80
		19	-	-	-	-	9.79	5.15	2.82	150.22	9.74	5.76	2.81	149.05	9.68	6.37	2.80	148.14	9.62	6.95	2.77	145.59
		20	-	-	-	-	10.83	5.16	3.13	179.19	10.77	5.77	3.11	177.31	10.70	6.37	3.09	175.42	10.64	6.96	3.07	173.62
	4	15	5.46	4.22	1.17	32.73	5.50	4.85	1.18	33.12	5.71	5.51	1.22	35.29	6.14	6.14	1.32	40.08	6.74	6.74	1.45	47.11
		17	7.37	4.28	1.59	55.10	7.32	4.89	1.58	54.50	7.28	5.50	1.57	53.90	7.23	6.10	1.56	53.36	7.29	6.71	1.57	54.03
		19	-	-	-	-	9.32	4.92	2.00	82.49	9.26	5.53	1.99	81.62	9.21	6.14	1.98	80.76	9.15	6.73	1.97	79.90
		20	-	-	-	-	10.38	4.95	2.25	100.60	10.32	5.56	2.23	99.55	10.26	6.16	2.22	98.52	10.18	6.75	2.19	96.37
	5	15	4.87	3.94	0.84	18.44	5.06	4.61	0.87	19.68	5.39	5.28	0.92	21.77	5.92	5.92	1.02	25.60	6.54	6.54	1.13	30.53
		17	6.80	4.01	1.17	32.64	6.76	4.63	1.17	32.29	6.72	5.24	1.16	31.92	6.75	5.86	1.16	32.23	6.91	6.50	1.19	33.59
		19	-	-	-	-	8.81	4.69	1.52	50.96	8.76	5.30	1.51	50.43	8.69	5.90	1.49	49.41	8.64	6.49	1.48	48.90
		20	-	-	-	-	9.87	4.71	1.70	61.63	9.81	5.32	1.69	60.90	9.75	5.92	1.68	60.27	9.69	6.52	1.67	59.64
6	15	4.27	3.64	0.61	10.32	4.63	4.35	0.66	12.23	5.09	5.05	0.73	14.54	5.69	5.69	0.81	17.46	6.31	6.31	0.90	20.82	
	17	6.13	3.71	0.88	19.78	6.09	4.32	0.87	19.53	6.12	4.96	0.87	19.70	6.28	5.61	0.90	20.62	6.55	6.27	0.94	22.19	
	19	-	-	-	-	8.22	4.42	1.18	32.89	8.17	5.04	1.17	32.54	8.12	5.64	1.17	32.20	8.07	6.24	1.16	31.85	
	20	-	-	-	-	9.32	4.46	1.34	40.78	9.26	5.07	1.33	40.35	9.19	5.67	1.32	39.59	9.14	6.27	1.31	39.17	
7	3	15	4.63	3.83	1.34	40.65	4.75	4.48	1.36	41.87	5.12	5.11	1.47	47.75	5.73	5.73	1.65	58.40	6.33	6.33	1.84	70.04
		17	6.51	3.87	1.88	72.96	6.47	4.49	1.88	72.59	6.43	5.10	1.86	71.76	6.41	5.71	1.86	71.41	6.53	6.32	1.89	73.35
		19	-	-	-	-	8.45	4.51	2.44	114.58	8.39	5.13	2.42	113.27	8.34	5.73	2.41	112.03	8.29	6.33	2.40	111.42
		20	-	-	-	-	9.49	4.53	2.75	141.05	9.44	5.14	2.75	140.98	9.38	5.74	2.71	137.83	9.32	6.34	2.70	136.35
	4	15	4.11	3.58	0.88	19.84	4.40	4.26	0.95	22.36	4.91	4.91	1.06	26.95	5.53	5.53	1.20	33.38	6.13	6.13	1.32	39.49
		17	5.93	3.61	1.28	37.27	5.89	4.23	1.27	36.84	5.87	4.85	1.26	36.61	5.98	5.48	1.29	37.78	6.24	6.13	1.35	41.11
		19	-	-	-	-	7.94	4.29	1.72	62.25	7.89	4.90	1.71	61.58	7.83	5.50	1.69	60.18	7.78	6.10	1.68	59.92
		20	-	-	-	-	8.99	4.30	1.94	76.69	8.93	4.92	1.93	75.89	8.89	5.52	1.92	75.62	8.83	6.12	1.91	74.78
	5	15	3.61	3.31	0.62	10.75	4.08	4.02	0.70	13.38	4.68	4.68	0.81	16.98	5.31	5.31	0.91	20.95	5.92	5.92	1.02	25.27
		17	5.27	3.33	0.91	20.66	5.24	3.95	0.90	20.45	5.35	4.60	0.92	21.22	5.59	5.26	0.96	22.91	5.97	5.92	1.03	25.63
		19	-	-	-	-	7.34	4.03	1.26	36.47	7.29	4.64	1.26	36.06	7.30	5.41	1.25	63.00	7.22	5.85	1.24	35.45
		20	-	-	-	-	8.44	4.06	1.46	46.73	8.39	4.68	1.45	46.23	8.33	5.28	1.44	45.73	8.28	5.88	1.43	45.25
6	15	3.26	3.08	0.47	5.32	3.78	3.77	0.54	7.85	4.42	4.42	0.63	11.13	5.07	5.07	0.73	14.15	5.70	5.70	0.82	17.30	
	17	4.43	2.98	0.64	11.18	4.57	3.65	0.65	11.81	4.86	4.35	0.70	13.25	5.23	5.03	0.75	14.93	5.72	5.70	0.82	17.40	
	19	-	-	-	-	6.68	3.75	0.96	22.63	6.63	4.36	0.95	22.38	6.60	4.97	0.95	22.20	6.69	5.61	0.96	22.71	
	20	-	-	-	-	7.80	3.79	1.12	29.44	7.75	4.40	1.11	29.11	7.70	5.01	1.10	28.80	7.65	5.61	1.10	28.46	
9	3	15	3.37	3.21	0.97	22.93	3.88	3.87	1.12	29.51	4.50	4.50	1.29	37.64	5.12	5.12	1.48	47.61	5.72	5.72	1.65	57.02
		17	5.02	3.22	1.46	46.10	4.99	3.84	1.44	45.50	5.02	4.47	1.45	46.07	5.23	5.11	1.52	49.48	5.72	5.72	1.65	57.19
		19	-	-	-	-	6.99	3.87	2.02	81.01	6.95	4.49	2.00	80.10	6.90	5.09	1.99	79.17	6.85	5.69	1.98	78.20
		20	-	-	-	-	8.06	3.89	2.34	104.94	8.01	4.51	2.33	104.21	7.96	5.11	2.32	103.04	7.90	5.72	2.30	101.86
	4	15	3.03	2.98	0.65	11.65	3.65	3.65	0.79	16.00	4.28	4.28	0.92	21.14	4.91	4.91	1.06	26.81	5.52	5.52	1.19	32.47
		17	4.34	2.93	0.94	21.60	4.38	3.57	0.95	21.92	4.60	4.24	1.00	23.93	4.96	4.91	1.07	27.25	5.53	5.53	1.19	32.56
		19	-	-	-	-	6.42	3.63	1.39	42.50	6.38	4.25	1.38	42.01	6.33	4.86	1.37	41.50	6.36	5.47	1.38	41.80
		20	-	-	-	-	7.50	3.66	1.63	55.65	7.45	4.27	1.62	55.02	7.40	4.88	1.61	54.40	7.36	5.49	1.59	53.78
	5	15	2.74	2.73	0.47	5.62	3.39	3.39	0.58	9.45	4.04	4.04	0.70	13.00	4.68	4.68	0.81	16.67	5.31	5.31	0.91	20.63
		17	3.54	2.60	0.61	10.30	3.82	3.31	0.66	11.77	4.21	4.01	0.73	14.00	4.70	4.69	0.81	16.75	5.31	5.31	0.92	20.69
		19	-	-	-	-	5.73	3.35	0.99	23.45	5.68	3.97	0.98	23.13	5.72	4.60	0.98	23.40	5.88	5.24	1.01	24.58
		20	-	-	-	-	6.85	3.39	1.18	31.88	6.80	4.01	1.17	31.51	6.76	4.62	1.16	31.15	6.73	5.23	1.16	30.92
6	15	2.52	2.52	0.36	2.80	3.15	3.15	0.45	5.04	3.78	3.78	0.54	8.09	4.44	4.44	0.64	11.12	5.08	5.08	0.73	13.98	
	17	2.95	2.34	0.42	4.26	3.35	3.05	0.48	6.01	3.85	3.76	0.55	8.41	4.44	4.44	0.64	11.14	5.09	5.09	0.73	14.02	
	19	-	-	-	-	4.89	3.02	0.70	13.07	4.94	3.66	0.71	13.29	5.15	4.34	0.74	14.28	5.45	5.02	0.78	15.77	
	20	-	-	-	-	6.10	3.09	0.88	19.05	6.06	3.71	0.87	18.81	6.03	4.33	0.87	18.66	6.13	4.97	0.88	19.23	

Continued:

		MDKH1-V800-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	2.60	2.60	0.74	14.43	3.24	3.24	0.93	20.90	3.88	3.88	1.11	28.53	4.49	4.49	1.29	36.83	5.10	5.10	1.46	45.61	
		17	3.36	2.54	0.96	22.21	3.54	3.20	1.01	24.23	3.90	3.88	1.11	28.67	4.50	4.50	1.29	36.94	5.11	5.11	1.46	45.74	
		19	-	-	-	-	5.43	3.22	1.56	51.33	5.39	3.84	1.55	50.68	5.35	4.45	1.53	49.53	5.48	5.09	1.58	52.20	
		20	-	-	-	-	6.50	3.25	1.87	70.34	6.45	3.86	1.86	69.50	6.41	4.48	1.85	68.65	6.36	5.08	1.84	67.78	
	4	15	2.33	2.33	0.50	6.71	3.00	3.00	0.64	11.21	3.65	3.65	0.78	15.64	4.29	4.29	0.92	20.55	4.90	4.90	1.05	25.89	
		17	2.70	2.25	0.58	9.31	3.13	2.97	0.67	12.01	3.66	3.65	0.78	15.67	4.29	4.29	0.92	20.60	4.91	4.91	1.05	25.96	
		19	-	-	-	-	4.72	2.95	1.01	24.22	4.71	3.58	1.01	24.08	4.85	4.23	1.04	25.34	5.12	4.89	1.10	27.85	
		20	-	-	-	-	5.86	2.99	1.26	35.41	5.82	3.61	1.25	34.98	5.77	4.23	1.24	34.51	5.81	4.85	1.25	34.90	
	5	15	2.12	2.12	0.36	2.91	2.75	2.75	0.47	5.88	3.41	3.41	0.59	9.54	4.05	4.05	0.70	12.75	4.69	4.69	0.81	16.48	
		17	2.27	2.03	0.39	3.53	2.78	2.73	0.48	6.08	3.41	3.41	0.59	9.56	4.06	4.06	0.70	12.79	4.70	4.70	0.81	16.53	
		19	-	-	-	-	3.88	2.63	0.67	11.86	4.06	3.31	0.70	12.77	4.39	4.00	0.75	14.57	4.80	4.68	0.83	17.15	
		20	-	-	-	-	5.09	2.70	0.88	18.85	5.04	3.32	0.87	18.58	5.10	3.96	0.88	18.96	5.30	4.62	0.91	20.25	
	6	15	1.87	1.87	0.27	1.69	2.53	2.53	0.36	2.91	3.15	3.15	0.45	5.22	3.80	3.80	0.54	8.19	4.45	4.45	0.64	10.94	
		17	1.94	1.82	0.28	1.75	2.54	2.53	0.36	2.94	3.15	3.15	0.45	5.23	3.80	3.80	0.54	8.22	4.46	4.46	0.64	10.97	
		19	-	-	-	-	3.10	2.32	0.44	5.09	3.49	3.03	0.50	6.80	3.97	3.76	0.57	8.94	4.50	4.45	0.64	11.13	
		20	-	-	-	-	4.06	2.32	0.58	9.30	4.17	2.99	0.60	9.76	4.46	3.69	0.64	10.96	4.83	4.38	0.69	12.53	
	13	3	15	1.94	1.94	0.56	8.63	2.60	2.60	0.74	14.09	3.24	3.24	0.93	20.85	3.87	3.87	1.10	27.84	4.48	4.48	1.28	35.97
			17	2.00	1.92	0.57	9.12	2.60	2.59	0.74	14.10	3.25	3.25	0.93	20.91	3.87	3.87	1.11	27.92	4.49	4.49	1.28	36.07
			19	-	-	-	-	3.65	2.54	1.05	25.47	3.74	3.20	1.07	26.52	4.01	3.86	1.15	29.66	4.49	4.48	1.28	36.10
			20	-	-	-	-	4.77	2.58	1.37	40.04	4.72	3.20	1.35	39.37	4.72	3.82	1.35	39.29	4.87	4.46	1.40	41.64
		4	15	1.70	1.70	0.37	3.02	2.34	2.34	0.50	6.92	3.01	3.01	0.64	11.07	3.66	3.66	0.79	15.58	4.28	4.28	0.92	20.43
			17	1.71	1.70	0.37	3.06	2.34	2.34	0.50	6.94	3.01	3.01	0.65	11.10	3.66	3.66	0.79	15.63	4.29	4.29	0.93	20.49
			19	-	-	-	-	2.89	2.25	0.62	10.30	3.26	2.96	0.70	12.66	3.71	3.66	0.80	15.99	4.30	4.30	0.93	20.54
			20	-	-	-	-	3.97	2.29	0.86	17.89	3.98	2.93	0.86	17.97	4.18	3.59	0.90	19.55	4.50	4.27	0.97	22.16
5		15	1.44	1.44	0.25	1.50	2.11	2.11	0.36	2.98	2.75	2.75	0.47	6.01	3.41	3.41	0.59	9.38	4.06	4.06	0.70	12.59	
		17	1.44	1.44	0.25	1.50	2.11	2.11	0.36	2.99	2.75	2.75	0.47	6.03	3.42	3.42	0.59	9.40	4.07	4.07	0.70	12.62	
		19	-	-	-	-	2.33	2.00	0.40	3.91	2.84	2.72	0.49	6.51	3.43	3.42	0.59	9.44	4.07	4.07	0.70	12.66	
		20	-	-	-	-	2.92	1.92	0.50	6.95	3.27	2.64	0.56	8.68	3.69	3.36	0.63	10.70	4.16	4.05	0.71	13.11	
6		15	1.14	1.14	0.16	0.97	1.87	1.87	0.27	1.62	2.53	2.53	0.36	2.99	3.16	3.16	0.45	5.43	3.81	3.81	0.55	8.25	
		17	1.14	1.14	0.16	0.97	1.88	1.88	0.27	1.62	2.53	2.53	0.36	3.00	3.16	3.16	0.45	5.45	3.82	3.82	0.55	8.27	
		19	-	-	-	-	1.98	1.80	0.28	1.73	2.56	2.51	0.37	3.10	3.16	3.16	0.45	5.46	3.82	3.82	0.55	8.30	
		20	-	-	-	-	2.30	1.68	0.33	2.35	2.77	2.40	0.40	3.84	3.28	3.11	0.47	5.97	3.85	3.82	0.55	8.39	
15		3	15	1.27	1.27	0.36	3.06	1.94	1.94	0.55	8.44	2.60	2.60	0.74	13.89	3.24	3.24	0.93	20.50	3.86	3.86	1.10	27.35
			17	1.28	1.28	0.36	3.07	1.94	1.94	0.55	8.46	2.60	2.60	0.74	13.93	3.25	3.25	0.93	20.56	3.87	3.87	1.10	27.43
			19	-	-	-	-	2.06	1.91	0.59	9.35	2.61	2.60	0.74	13.96	3.25	3.25	0.94	20.62	3.87	3.87	1.11	27.52
			20	-	-	-	-	2.78	1.88	0.80	15.78	2.99	2.55	0.86	17.81	3.34	3.23	0.95	21.30	3.87	3.86	1.11	27.49
		4	15	1.02	1.02	0.22	1.27	1.69	1.69	0.36	3.08	2.35	2.35	0.50	7.06	3.02	3.02	0.65	11.07	3.66	3.66	0.79	15.35
			17	1.02	1.02	0.22	1.27	1.70	1.70	0.36	3.09	2.35	2.35	0.50	7.08	3.02	3.02	0.65	11.10	3.66	3.66	0.79	15.40
			19	-	-	-	-	1.72	1.68	0.37	3.20	2.35	2.35	0.50	7.09	3.03	3.03	0.65	11.13	3.67	3.67	0.79	15.44
			20	-	-	-	-	1.98	1.58	0.43	4.75	2.49	2.31	0.53	7.92	3.05	3.02	0.66	11.26	3.67	3.67	0.79	15.47
	5	15	0.69	0.69	0.12	0.67	1.46	1.46	0.25	1.45	2.12	2.12	0.36	3.14	2.76	2.76	0.48	6.26	3.42	3.42	0.59	9.36	
		17	0.69	0.69	0.12	0.68	1.46	1.46	0.25	1.45	2.12	2.12	0.37	3.16	2.76	2.76	0.48	6.28	3.43	3.43	0.59	9.39	
		19	-	-	-	-	1.46	1.46	0.25	1.45	2.12	2.12	0.37	3.17	2.77	2.77	0.48	6.31	3.44	3.44	0.59	9.41	
		20	-	-	-	-	1.58	1.38	0.27	1.60	2.16	2.09	0.37	3.33	2.77	2.76	0.48	6.30	3.44	3.44	0.59	9.43	
	6	15	-	-	-	-	1.16	1.16	0.17	0.94	1.89	1.89	0.27	1.58	2.53	2.53	0.36	3.15	3.17	3.17	0.46	5.67	
		17	-	-	-	-	1.16	1.16	0.17	0.94	1.89	1.89	0.27	1.59	2.53	2.53	0.36	3.16	3.17	3.17	0.46	5.69	
		19	-	-	-	-	1.16	1.16	0.17	0.94	1.89	1.89	0.27	1.59	2.54	2.54	0.36	3.17	3.18	3.18	0.46	5.71	
		20	-	-	-	-	1.18	1.13	0.17	0.96	1.90	1.89	0.27	1.60	2.54	2.53	0.36	3.17	3.18	3.18	0.46	5.72	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH2-V150-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
5	3	15	1.58	1.16	0.45	37.40	1.57	1.31	0.45	36.94	1.57	1.46	0.45	37.18	1.62	1.62	0.46	39.13	1.76	1.76	0.51	45.51	
		17	2.04	1.17	0.59	58.38	2.03	1.32	0.58	57.66	2.01	1.47	0.58	56.94	2.00	1.61	0.57	56.25	1.99	1.76	0.57	55.68	
		19	-	-	-	-	2.52	1.32	0.72	84.22	2.50	1.47	0.72	83.22	2.49	1.62	0.71	82.20	2.47	1.77	0.71	81.21	
		20	-	-	-	-	2.78	1.33	0.80	100.96	2.76	1.48	0.79	98.87	2.74	1.63	0.79	97.69	2.72	1.77	0.78	96.52	
	4	15	1.47	1.10	0.32	20.24	1.47	1.26	0.32	20.30	1.50	1.42	0.32	21.06	1.58	1.58	0.34	22.75	1.73	1.73	0.37	26.50	
		17	1.94	1.12	0.42	32.46	1.93	1.27	0.41	32.06	1.92	1.42	0.41	31.68	1.90	1.57	0.41	31.33	1.91	1.71	0.41	31.42	
		19	-	-	-	-	2.43	1.28	0.52	47.73	2.41	1.43	0.52	47.16	2.40	1.58	0.51	46.61	2.38	1.72	0.51	46.07	
		20	-	-	-	-	2.70	1.29	0.58	57.62	2.68	1.44	0.58	56.94	2.66	1.58	0.57	55.97	2.64	1.73	0.57	55.32	
	5	15	1.33	1.04	0.23	11.50	1.36	1.20	0.23	12.04	1.43	1.37	0.24	13.04	1.53	1.53	0.26	14.90	1.69	1.69	0.29	17.47	
		17	1.83	1.06	0.31	20.00	1.81	1.21	0.31	19.76	1.80	1.36	0.31	19.52	1.80	1.52	0.31	19.55	1.83	1.67	0.31	19.98	
		19	-	-	-	-	2.33	1.23	0.40	30.28	2.31	1.38	0.40	29.92	2.30	1.53	0.40	29.58	2.28	1.68	0.39	29.23	
		20	-	-	-	-	2.60	1.24	0.45	36.53	2.58	1.39	0.44	36.10	2.56	1.54	0.44	35.69	2.54	1.68	0.44	35.27	
	6	15	1.21	0.98	0.17	5.98	1.27	1.15	0.18	6.81	1.35	1.32	0.19	8.05	1.49	1.49	0.21	9.98	1.64	1.64	0.24	12.16	
		17	1.68	0.99	0.24	12.68	1.67	1.15	0.24	12.51	1.67	1.30	0.24	12.52	1.69	1.46	0.24	12.86	1.74	1.62	0.25	13.49	
		19	-	-	-	-	2.20	1.17	0.32	19.97	2.19	1.32	0.31	19.74	2.17	1.47	0.31	19.50	2.16	1.62	0.31	19.28	
		20	-	-	-	-	2.48	1.19	0.35	24.40	2.46	1.34	0.35	24.12	2.45	1.48	0.35	23.84	2.43	1.63	0.35	23.57	
	7	3	15	1.23	0.99	0.35	24.19	1.25	1.15	0.36	24.78	1.31	1.31	0.38	26.99	1.46	1.46	0.42	32.84	1.61	1.61	0.47	38.73
			17	1.70	1.00	0.49	42.18	1.69	1.16	0.49	41.65	1.68	1.30	0.48	41.12	1.67	1.45	0.48	40.84	1.69	1.61	0.48	41.45
			19	-	-	-	-	2.19	1.17	0.63	65.48	2.17	1.32	0.63	64.44	2.16	1.46	0.62	63.55	2.14	1.61	0.62	63.22
			20	-	-	-	-	2.45	1.17	0.71	79.39	2.43	1.32	0.70	78.40	2.42	1.47	0.70	77.45	2.40	1.61	0.69	76.50
4		15	1.12	0.94	0.24	12.60	1.17	1.11	0.25	13.65	1.27	1.27	0.27	15.69	1.42	1.42	0.31	18.84	1.57	1.57	0.34	22.33	
		17	1.59	0.95	0.34	22.70	1.58	1.10	0.34	22.42	1.57	1.25	0.34	22.22	1.58	1.41	0.34	22.56	1.62	1.57	0.35	23.58	
		19	-	-	-	-	2.09	1.12	0.45	36.23	2.07	1.27	0.45	35.79	2.06	1.42	0.44	35.54	2.05	1.56	0.44	35.33	
		20	-	-	-	-	2.35	1.13	0.51	45.07	2.34	1.28	0.51	44.53	2.32	1.43	0.50	44.00	2.31	1.57	0.50	43.48	
5		15	1.00	0.88	0.17	6.14	1.09	1.06	0.19	7.61	1.22	1.22	0.21	9.80	1.38	1.38	0.24	12.18	1.53	1.53	0.26	14.55	
		17	1.44	0.89	0.25	13.12	1.43	1.04	0.25	12.98	1.45	1.20	0.25	13.24	1.49	1.36	0.26	13.91	1.56	1.53	0.27	15.07	
		19	-	-	-	-	1.97	1.07	0.34	22.23	1.95	1.22	0.34	21.96	1.95	1.42	0.33	21.70	1.93	1.51	0.33	21.51	
		20	-	-	-	-	2.24	1.08	0.39	28.04	2.23	1.23	0.38	27.70	2.21	1.38	0.38	27.38	2.20	1.52	0.38	27.05	
6		15	0.93	0.84	0.13	3.08	1.03	1.01	0.15	4.13	1.17	1.17	0.17	5.77	1.33	1.33	0.19	7.90	1.48	1.48	0.21	10.00	
		17	1.26	0.81	0.18	6.99	1.28	0.97	0.18	7.26	1.33	1.14	0.19	7.95	1.40	1.31	0.20	8.94	1.50	1.48	0.22	10.21	
		19	-	-	-	-	1.82	1.00	0.26	14.23	1.81	1.15	0.26	14.11	1.80	1.30	0.26	13.99	1.81	1.46	0.26	14.12	
		20	-	-	-	-	2.11	1.02	0.30	18.31	2.09	1.17	0.30	18.09	2.08	1.32	0.30	17.86	2.06	1.46	0.30	17.64	
9		3	15	0.90	0.83	0.26	13.94	1.00	1.00	0.29	16.79	1.16	1.16	0.33	21.34	1.31	1.31	0.38	26.52	1.46	1.46	0.42	32.13
			17	1.34	0.84	0.39	27.74	1.33	0.99	0.38	27.36	1.33	1.15	0.38	27.42	1.36	1.30	0.39	28.57	1.46	1.46	0.42	32.20
			19	-	-	-	-	1.83	1.00	0.53	47.75	1.82	1.16	0.53	47.14	1.81	1.30	0.52	46.55	1.79	1.45	0.52	45.94
			20	-	-	-	-	2.10	1.01	0.61	60.44	2.08	1.16	0.60	58.73	2.06	1.31	0.59	58.00	2.05	1.46	0.59	57.28
	4	15	0.82	0.78	0.18	6.61	0.95	0.95	0.21	9.35	1.11	1.11	0.24	12.21	1.27	1.27	0.27	15.23	1.42	1.42	0.31	18.53	
		17	1.19	0.78	0.26	13.84	1.20	0.94	0.26	13.89	1.23	1.10	0.26	14.44	1.30	1.27	0.28	15.83	1.42	1.42	0.31	18.60	
		19	-	-	-	-	1.71	0.95	0.37	25.69	1.70	1.11	0.37	25.37	1.69	1.25	0.37	25.04	1.69	1.41	0.37	25.04	
		20	-	-	-	-	1.98	0.96	0.43	32.71	1.97	1.11	0.42	32.30	1.95	1.26	0.42	31.90	1.94	1.41	0.42	31.50	
	5	15	0.76	0.74	0.13	2.99	0.91	0.91	0.16	4.85	1.06	1.06	0.18	7.33	1.22	1.22	0.21	9.75	1.38	1.38	0.24	11.94	
		17	1.01	0.70	0.17	6.48	1.06	0.87	0.18	7.27	1.13	1.05	0.20	8.45	1.23	1.22	0.21	9.93	1.38	1.38	0.24	11.98	
		19	-	-	-	-	1.57	0.89	0.27	14.89	1.55	1.04	0.27	14.69	1.56	1.20	0.27	14.73	1.58	1.36	0.27	15.15	
		20	-	-	-	-	1.85	0.91	0.32	19.70	1.84	1.06	0.32	19.46	1.82	1.21	0.31	19.21	1.81	1.36	0.31	19.03	
	6	15	0.70	0.70	0.10	1.81	0.86	0.86	0.12	2.63	1.02	1.02	0.15	4.09	1.17	1.17	0.17	5.97	1.33	1.33	0.19	8.02	
		17	0.87	0.64	0.13	2.73	0.96	0.82	0.14	3.48	1.06	1.00	0.15	4.54	1.18	1.17	0.17	6.04	1.33	1.33	0.19	8.06	
		19	-	-	-	-	1.38	0.81	0.20	8.61	1.38	0.97	0.20	8.67	1.42	1.14	0.20	9.13	1.48	1.31	0.21	9.81	
		20	-	-	-	-	1.69	0.84	0.24	12.27	1.67	0.99	0.24	12.11	1.66	1.14	0.24	12.00	1.68	1.30	0.24	12.18	

Continued:

MDKH2-V150-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	0.68	0.68	0.19	8.42	0.84	0.84	0.24	12.14	1.00	1.00	0.29	16.22	1.15	1.15	0.33	20.69	1.30	1.30	0.37	25.53	
		17	0.93	0.67	0.27	14.30	0.95	0.83	0.27	15.01	1.02	1.00	0.29	16.74	1.16	1.16	0.33	20.77	1.31	1.31	0.37	25.62	
		19	-	-	-	-	1.44	0.84	0.41	30.26	1.43	0.99	0.41	29.85	1.42	1.14	0.41	29.60	1.44	1.30	0.41	30.12	
		20	-	-	-	-	1.71	0.85	0.49	41.32	1.70	1.00	0.49	40.78	1.69	1.15	0.49	40.24	1.67	1.30	0.48	39.70	
	4	15	0.63	0.63	0.14	3.43	0.79	0.79	0.17	6.24	0.96	0.96	0.20	9.19	1.11	1.11	0.24	11.89	1.27	1.27	0.27	14.81	
		17	0.76	0.60	0.16	5.71	0.85	0.78	0.18	7.32	0.96	0.96	0.21	9.28	1.11	1.11	0.24	11.93	1.27	1.27	0.27	14.86	
		19	-	-	-	-	1.29	0.78	0.28	15.32	1.29	0.93	0.28	15.19	1.31	1.09	0.28	15.63	1.35	1.26	0.29	16.61	
		20	-	-	-	-	1.58	0.79	0.34	21.52	1.56	0.95	0.34	21.24	1.55	1.10	0.33	20.94	1.55	1.25	0.33	21.01	
	5	15	0.59	0.59	0.10	1.76	0.75	0.75	0.13	3.01	0.91	0.91	0.16	5.05	1.07	1.07	0.18	7.45	1.22	1.22	0.21	9.61	
		17	0.66	0.55	0.11	2.19	0.77	0.74	0.13	3.31	0.91	0.91	0.16	5.07	1.07	1.07	0.18	7.48	1.22	1.22	0.21	9.65	
		19	-	-	-	-	1.10	0.71	0.19	7.92	1.13	0.87	0.20	8.41	1.20	1.04	0.21	9.25	1.28	1.21	0.22	10.34	
		20	-	-	-	-	1.41	0.73	0.24	12.20	1.40	0.88	0.24	12.01	1.40	1.04	0.24	12.13	1.44	1.20	0.25	12.63	
	6	15	0.53	0.53	0.08	1.27	0.70	0.70	0.10	1.74	0.86	0.86	0.12	2.71	1.02	1.02	0.15	4.26	1.17	1.17	0.17	6.09	
		17	0.56	0.50	0.08	1.35	0.71	0.69	0.10	1.78	0.86	0.86	0.12	2.72	1.02	1.02	0.15	4.28	1.17	1.17	0.17	6.11	
		19	-	-	-	-	0.92	0.64	0.13	3.30	1.00	0.81	0.14	4.10	1.09	0.99	0.16	5.12	1.20	1.17	0.17	6.46	
		20	-	-	-	-	1.17	0.64	0.17	6.16	1.19	0.80	0.17	6.36	1.25	0.97	0.18	7.02	1.32	1.14	0.19	7.86	
	13	3	15	0.52	0.52	0.15	4.55	0.68	0.68	0.20	8.44	0.84	0.84	0.24	12.06	1.00	1.00	0.29	16.09	1.15	1.15	0.33	20.51
			17	0.55	0.51	0.16	5.28	0.68	0.68	0.20	8.43	0.84	0.84	0.24	12.10	1.00	1.00	0.29	16.15	1.15	1.15	0.33	20.58
			19	-	-	-	-	1.00	0.67	0.29	16.15	1.02	0.83	0.29	16.55	1.06	0.99	0.31	17.89	1.15	1.15	0.33	20.62
			20	-	-	-	-	1.28	0.68	0.37	24.76	1.27	0.83	0.37	24.40	1.27	0.99	0.36	24.24	1.29	1.14	0.37	24.91
		4	15	0.47	0.47	0.10	1.74	0.63	0.63	0.14	3.61	0.79	0.79	0.17	6.36	0.95	0.95	0.20	9.02	1.11	1.11	0.24	11.66
			17	0.48	0.47	0.10	1.80	0.63	0.63	0.14	3.62	0.79	0.79	0.17	6.39	0.96	0.96	0.20	9.05	1.11	1.11	0.24	11.70
			19	-	-	-	-	0.82	0.60	0.17	6.79	0.89	0.77	0.19	8.03	0.99	0.95	0.21	9.53	1.11	1.11	0.24	11.71
			20	-	-	-	-	1.10	0.61	0.24	11.51	1.10	0.77	0.24	11.50	1.14	0.93	0.24	12.15	1.20	1.10	0.26	13.25
5		15	0.41	0.41	0.07	1.13	0.59	0.59	0.10	1.71	0.75	0.75	0.13	3.07	0.90	0.90	0.16	5.13	1.06	1.06	0.18	7.37	
		17	0.41	0.41	0.07	1.14	0.59	0.59	0.10	1.71	0.75	0.75	0.13	3.09	0.91	0.91	0.16	5.16	1.07	1.07	0.18	7.40	
		19	-	-	-	-	0.68	0.54	0.12	2.45	0.79	0.73	0.14	3.65	0.92	0.90	0.16	5.31	1.07	1.07	0.18	7.43	
		20	-	-	-	-	0.86	0.53	0.15	4.62	0.93	0.70	0.16	5.51	1.01	0.88	0.17	6.72	1.11	1.06	0.19	8.01	
6		15	0.34	0.34	0.05	0.76	0.53	0.53	0.08	1.20	0.70	0.70	0.10	1.69	0.86	0.86	0.12	2.77	1.01	1.01	0.15	4.35	
		17	0.34	0.34	0.05	0.76	0.53	0.53	0.08	1.21	0.70	0.70	0.10	1.70	0.86	0.86	0.12	2.79	1.02	1.02	0.15	4.37	
		19	-	-	-	-	0.58	0.49	0.08	1.31	0.73	0.69	0.10	1.82	0.86	0.86	0.12	2.82	1.02	1.02	0.15	4.40	
		20	-	-	-	-	0.70	0.47	0.10	1.68	0.81	0.65	0.12	2.38	0.92	0.83	0.13	3.36	1.04	1.01	0.15	4.64	
15		3	15	0.35	0.35	0.10	1.71	0.52	0.52	0.15	4.59	0.68	0.68	0.19	8.17	0.84	0.84	0.24	11.66	0.99	0.99	0.29	15.76
			17	0.35	0.35	0.10	1.71	0.52	0.52	0.15	4.61	0.68	0.68	0.19	8.20	0.84	0.84	0.24	11.70	1.00	1.00	0.29	15.82
			19	-	-	-	-	0.57	0.50	0.16	5.80	0.69	0.68	0.20	8.32	0.84	0.84	0.24	11.75	1.00	1.00	0.29	15.88
			20	-	-	-	-	0.78	0.50	0.22	10.25	0.82	0.66	0.23	11.11	0.89	0.84	0.25	12.81	1.00	0.99	0.29	15.86
		4	15	0.29	0.29	0.06	0.97	0.47	0.47	0.10	1.70	0.63	0.63	0.14	3.67	0.79	0.79	0.17	6.41	0.95	0.95	0.20	8.86
			17	0.29	0.29	0.06	0.97	0.47	0.47	0.10	1.71	0.63	0.63	0.14	3.69	0.79	0.79	0.17	6.44	0.95	0.95	0.20	8.89
			19	-	-	-	-	0.49	0.46	0.10	1.85	0.63	0.63	0.14	3.69	0.80	0.80	0.17	6.47	0.96	0.96	0.20	8.92
			20	-	-	-	-	0.59	0.43	0.13	3.05	0.69	0.61	0.15	4.71	0.81	0.79	0.17	6.73	0.96	0.95	0.20	8.91
	5	15	0.21	0.21	0.04	0.55	0.41	0.41	0.07	1.09	0.59	0.59	0.10	1.72	0.75	0.75	0.13	3.22	0.90	0.90	0.16	5.31	
		17	0.21	0.21	0.04	0.55	0.41	0.41	0.07	1.09	0.59	0.59	0.10	1.73	0.75	0.75	0.13	3.24	0.91	0.91	0.16	5.34	
		19	-	-	-	-	0.42	0.41	0.07	1.10	0.59	0.59	0.10	1.73	0.75	0.75	0.13	3.25	0.91	0.91	0.16	5.37	
		20	-	-	-	-	0.47	0.38	0.08	1.23	0.62	0.57	0.11	1.93	0.75	0.75	0.13	3.30	0.91	0.91	0.16	5.38	
	6	15	-	-	-	-	0.34	0.34	0.05	0.73	0.53	0.53	0.08	1.15	0.70	0.70	0.10	1.71	0.86	0.86	0.12	2.90	
		17	-	-	-	-	0.34	0.34	0.05	0.73	0.53	0.53	0.08	1.16	0.70	0.70	0.10	1.72	0.86	0.86	0.12	2.91	
		19	-	-	-	-	0.34	0.34	0.05	0.73	0.53	0.53	0.08	1.16	0.70	0.70	0.10	1.72	0.86	0.86	0.12	2.93	
		20	-	-	-	-	0.35	0.32	0.05	0.76	0.54	0.52	0.08	1.18	0.70	0.70	0.10	1.73	0.86	0.86	0.12	2.94	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH2-V250-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	2.35	1.75	0.67	37.00	2.33	1.98	0.67	36.59	2.36	2.23	0.67	37.29	2.47	2.47	0.71	40.67	2.70	2.70	0.78	47.76	
		17	3.07	1.76	0.88	58.87	3.05	2.00	0.87	58.20	3.03	2.23	0.87	57.54	3.01	2.46	0.86	56.87	3.00	2.69	0.86	56.43	
		19	-	-	-	-	3.82	2.01	1.10	86.13	3.80	2.24	1.09	85.18	3.77	2.48	1.08	84.23	3.75	2.70	1.08	83.28	
		20	-	-	-	-	4.23	2.02	1.22	104.40	4.20	2.25	1.22	103.20	4.17	2.48	1.20	101.30	4.15	2.71	1.20	100.65	
	4	15	2.13	1.64	0.46	19.24	2.15	1.89	0.46	19.53	2.23	2.14	0.48	20.77	2.39	2.39	0.51	23.23	2.62	2.62	0.56	27.26	
		17	2.88	1.67	0.62	31.84	2.86	1.90	0.61	31.47	2.84	2.14	0.61	31.11	2.82	2.37	0.61	30.82	2.84	2.61	0.61	31.23	
		19	-	-	-	-	3.64	1.92	0.78	47.80	3.62	2.16	0.78	47.26	3.59	2.39	0.77	46.73	3.57	2.62	0.77	46.22	
		20	-	-	-	-	4.05	1.93	0.88	58.11	4.03	2.17	0.87	57.47	4.00	2.40	0.86	56.84	3.97	2.63	0.86	55.90	
	5	15	1.88	1.52	0.32	10.28	1.96	1.79	0.34	11.19	2.10	2.05	0.36	12.66	2.31	2.31	0.40	15.02	2.54	2.54	0.44	17.73	
		17	2.65	1.56	0.46	18.97	2.63	1.80	0.45	18.75	2.62	2.04	0.45	18.55	2.63	2.28	0.45	18.78	2.70	2.53	0.46	19.56	
		19	-	-	-	-	3.44	1.83	0.59	29.60	3.42	2.07	0.59	29.27	3.39	2.30	0.58	28.95	3.37	2.53	0.58	28.35	
		20	-	-	-	-	3.86	1.84	0.66	36.08	3.83	2.08	0.66	35.68	3.81	2.31	0.66	35.27	3.78	2.54	0.65	34.90	
6	15	1.69	1.43	0.24	5.04	1.81	1.70	0.26	6.05	1.98	1.96	0.28	7.60	2.21	2.21	0.32	9.87	2.45	2.45	0.35	12.16		
	17	2.37	1.44	0.34	11.35	2.35	1.67	0.34	11.19	2.37	1.92	0.34	11.38	2.44	2.18	0.35	12.05	2.55	2.44	0.37	13.01		
	19	-	-	-	-	3.20	1.72	0.46	18.94	3.18	1.96	0.45	18.73	3.16	2.19	0.45	18.52	3.14	2.42	0.45	18.33		
	20	-	-	-	-	3.63	1.74	0.52	23.50	3.60	1.97	0.52	23.23	3.58	2.21	0.51	22.98	3.56	2.44	0.51	22.73		
7	3	15	1.81	1.49	0.52	23.33	1.86	1.74	0.53	24.41	1.99	1.99	0.57	27.65	2.23	2.23	0.65	34.00	2.46	2.46	0.71	40.31	
		17	2.54	1.51	0.73	41.88	2.52	1.75	0.72	41.38	2.50	1.98	0.72	40.87	2.50	2.22	0.72	40.84	2.55	2.46	0.73	42.08	
		19	-	-	-	-	3.30	1.76	0.95	66.46	3.28	2.00	0.95	65.58	3.25	2.23	0.94	64.58	3.23	2.46	0.93	63.72	
		20	-	-	-	-	3.71	1.77	1.07	80.90	3.68	2.00	1.06	79.97	3.66	2.24	1.05	79.05	3.63	2.47	1.05	78.15	
	4	15	1.60	1.39	0.35	11.69	1.72	1.66	0.37	13.19	1.91	1.91	0.41	15.84	2.15	2.15	0.46	19.18	2.39	2.39	0.51	22.90	
		17	2.32	1.41	0.50	21.71	2.30	1.65	0.49	21.44	2.29	1.89	0.49	21.35	2.34	2.13	0.50	22.05	2.43	2.38	0.52	23.64	
		19	-	-	-	-	3.10	1.67	0.67	35.71	3.08	1.91	0.66	35.54	3.06	2.14	0.66	35.32	3.04	2.37	0.66	34.90	
		20	-	-	-	-	3.51	1.68	0.76	44.89	3.49	1.92	0.76	44.38	3.47	2.15	0.75	43.89	3.45	2.38	0.75	43.39	
	5	15	1.42	1.29	0.24	5.32	1.59	1.56	0.27	7.08	1.82	1.82	0.31	9.69	2.06	2.06	0.36	12.19	2.31	2.31	0.40	14.71	
		17	2.04	1.29	0.35	11.92	2.03	1.53	0.35	11.84	2.08	1.79	0.36	12.35	2.18	2.05	0.37	13.35	2.33	2.30	0.40	14.94	
		19	-	-	-	-	2.86	1.57	0.49	21.22	2.85	1.81	0.49	20.98	2.85	2.06	0.49	26.01	2.82	2.28	0.48	20.65	
		20	-	-	-	-	3.30	1.59	0.57	27.20	3.28	1.82	0.57	26.89	3.25	2.06	0.56	26.46	3.23	2.29	0.56	26.02	
6	15	1.31	1.22	0.19	2.68	1.50	1.49	0.22	3.79	1.73	1.73	0.25	5.53	1.97	1.97	0.28	7.72	2.21	2.21	0.32	9.94		
	17	1.73	1.16	0.25	5.57	1.78	1.42	0.26	6.04	1.89	1.69	0.27	6.99	2.03	1.95	0.29	8.32	2.22	2.22	0.32	10.00		
	19	-	-	-	-	2.59	1.45	0.37	13.02	2.57	1.69	0.37	12.86	2.56	1.93	0.37	12.81	2.61	2.18	0.37	13.27		
	20	-	-	-	-	3.04	1.48	0.44	17.15	3.02	1.71	0.43	16.94	3.00	1.95	0.43	16.74	2.98	2.18	0.43	16.55		
9	3	15	1.32	1.25	0.38	13.39	1.51	1.51	0.44	17.03	1.75	1.75	0.50	21.84	1.99	1.99	0.58	27.54	2.22	2.22	0.64	32.89	
		17	1.96	1.26	0.57	26.84	1.94	1.49	0.56	26.02	1.96	1.74	0.57	26.85	2.04	1.99	0.59	28.72	2.23	2.23	0.64	33.00	
		19	-	-	-	-	2.74	1.51	0.79	47.62	2.72	1.75	0.79	47.04	2.70	1.99	0.78	46.47	2.68	2.22	0.78	45.91	
		20	-	-	-	-	3.14	1.52	0.91	59.89	3.12	1.76	0.90	59.16	3.10	1.99	0.89	58.46	3.08	2.22	0.89	57.77	
	4	15	1.18	1.16	0.25	6.05	1.42	1.42	0.31	9.23	1.67	1.67	0.36	12.24	1.91	1.91	0.41	15.43	2.15	2.15	0.46	18.93	
		17	1.68	1.14	0.36	12.42	1.71	1.39	0.37	12.69	1.79	1.65	0.39	13.93	1.93	1.91	0.42	15.71	2.15	2.15	0.46	18.99	
		19	-	-	-	-	2.51	1.42	0.54	24.73	2.49	1.66	0.54	24.43	2.47	1.89	0.54	24.13	2.49	2.13	0.54	24.36	
		20	-	-	-	-	2.93	1.43	0.63	31.95	2.91	1.67	0.63	31.58	2.89	1.90	0.62	31.20	2.87	2.13	0.62	30.83	
	5	15	1.09	1.09	0.19	2.71	1.33	1.33	0.23	4.60	1.57	1.57	0.27	7.13	1.82	1.82	0.31	9.68	2.07	2.07	0.36	12.00	
		17	1.38	1.01	0.24	5.17	1.49	1.28	0.26	6.21	1.63	1.56	0.28	7.79	1.83	1.82	0.31	9.73	2.07	2.07	0.36	12.04	
		19	-	-	-	-	2.23	1.30	0.38	13.59	2.21	1.54	0.38	13.41	2.23	1.79	0.38	13.63	2.30	2.04	0.40	14.43	
		20	-	-	-	-	2.67	1.32	0.46	18.56	2.65	1.56	0.46	18.34	2.63	1.80	0.45	18.11	2.63	2.03	0.45	18.03	
6	15	1.00	1.00	0.14	1.71	1.25	1.25	0.18	2.45	1.49	1.49	0.21	3.87	1.73	1.73	0.25	5.76	1.97	1.97	0.28	7.90		
	17	1.19	0.93	0.17	2.21	1.35	1.21	0.19	2.94	1.52	1.48	0.22	4.07	1.73	1.73	0.25	5.78	1.98	1.98	0.28	7.93		
	19	-	-	-	-	1.87	1.16	0.27	7.06	1.91	1.42	0.27	7.34	2.00	1.68	0.29	8.10	2.12	1.95	0.30	9.12		
	20	-	-	-	-	2.36	1.20	0.34	10.99	2.34	1.44	0.34	10.84	2.34	1.68	0.34	10.81	2.39	1.93	0.34	11.18		

Continued:

		MDKH2-V250-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.01	1.01	0.29	8.25	1.26	1.26	0.36	12.17	1.51	1.51	0.43	16.48	1.75	1.75	0.50	21.22	1.99	1.99	0.57	26.38	
		17	1.31	0.99	0.37	12.93	1.39	1.25	0.40	14.31	1.52	1.51	0.43	16.70	1.75	1.75	0.50	21.29	1.99	1.99	0.57	26.47	
		19	-	-	-	-	2.12	1.26	0.60	29.37	2.10	1.50	0.60	28.98	2.10	1.73	0.60	28.86	2.14	1.98	0.61	29.91	
		20	-	-	-	-	2.54	1.27	0.73	40.79	2.52	1.51	0.73	40.28	2.51	1.74	0.72	39.77	2.49	1.98	0.72	39.26	
	4	15	0.92	0.92	0.20	3.19	1.17	1.17	0.25	6.00	1.42	1.42	0.30	9.11	1.67	1.67	0.36	11.96	1.91	1.91	0.41	15.04	
		17	1.06	0.88	0.23	4.66	1.21	1.16	0.26	6.60	1.42	1.42	0.30	9.12	1.67	1.67	0.36	11.99	1.91	1.91	0.41	15.09	
		19	-	-	-	-	1.84	1.15	0.39	14.06	1.84	1.39	0.39	14.04	1.89	1.65	0.41	14.81	2.00	1.90	0.43	16.23	
		20	-	-	-	-	2.28	1.17	0.49	20.36	2.27	1.41	0.49	20.10	2.25	1.64	0.48	19.83	2.27	1.89	0.49	20.14	
	5	15	0.84	0.84	0.14	1.67	1.09	1.09	0.19	2.80	1.33	1.33	0.23	4.81	1.58	1.58	0.27	7.30	1.83	1.83	0.31	9.59	
		17	0.91	0.80	0.16	1.87	1.11	1.08	0.19	2.93	1.33	1.33	0.23	4.82	1.58	1.58	0.27	7.33	1.83	1.83	0.32	9.62	
		19	-	-	-	-	1.49	1.02	0.26	6.45	1.58	1.28	0.27	7.31	1.71	1.55	0.29	8.54	1.87	1.82	0.32	9.98	
		20	-	-	-	-	1.97	1.05	0.34	10.88	1.95	1.29	0.34	10.72	1.99	1.54	0.34	11.03	2.07	1.80	0.36	11.82	
	6	15	0.74	0.74	0.11	1.19	1.01	1.01	0.14	1.65	1.25	1.25	0.18	2.53	1.49	1.49	0.21	4.04	1.73	1.73	0.25	5.90	
		17	0.77	0.72	0.11	1.23	1.01	1.00	0.15	1.66	1.26	1.26	0.18	2.54	1.49	1.49	0.21	4.05	1.73	1.73	0.25	5.93	
		19	-	-	-	-	1.26	0.92	0.18	2.56	1.39	1.20	0.20	3.38	1.56	1.47	0.22	4.55	1.75	1.73	0.25	6.05	
		20	-	-	-	-	1.58	0.90	0.23	4.72	1.62	1.16	0.23	5.03	1.73	1.43	0.25	5.93	1.87	1.70	0.27	7.09	
	13	3	15	0.76	0.76	0.22	4.28	1.01	1.01	0.29	8.34	1.27	1.27	0.36	12.14	1.51	1.51	0.43	16.40	1.75	1.75	0.50	21.09
			17	0.78	0.75	0.22	4.64	1.01	1.01	0.29	8.34	1.27	1.27	0.36	12.17	1.51	1.51	0.43	16.45	1.75	1.75	0.50	21.16
			19	-	-	-	-	1.42	0.99	0.40	14.55	1.47	1.25	0.42	15.62	1.57	1.51	0.45	17.56	1.75	1.75	0.50	21.18
			20	-	-	-	-	1.87	1.01	0.54	23.61	1.85	1.25	0.53	23.25	1.85	1.49	0.53	23.26	1.91	1.74	0.55	24.45
		4	15	0.68	0.68	0.15	1.63	0.92	0.92	0.20	3.38	1.17	1.17	0.25	6.16	1.42	1.42	0.30	8.98	1.67	1.67	0.36	11.76
			17	0.68	0.68	0.15	1.64	0.93	0.93	0.20	3.39	1.17	1.17	0.25	6.19	1.43	1.43	0.31	9.00	1.67	1.67	0.36	11.79
			19	-	-	-	-	1.12	0.87	0.24	5.55	1.27	1.15	0.27	7.29	1.44	1.42	0.31	9.21	1.67	1.67	0.36	11.83
			20	-	-	-	-	1.53	0.89	0.33	10.15	1.54	1.14	0.33	10.30	1.63	1.40	0.35	11.28	1.75	1.66	0.38	12.79
5		15	0.57	0.57	0.10	1.06	0.84	0.84	0.14	1.60	1.09	1.09	0.19	2.86	1.33	1.33	0.23	4.91	1.58	1.58	0.27	7.27	
		17	0.57	0.57	0.10	1.06	0.84	0.84	0.14	1.60	1.09	1.09	0.19	2.87	1.33	1.33	0.23	4.93	1.58	1.58	0.27	7.29	
		19	-	-	-	-	0.94	0.79	0.16	1.98	1.13	1.07	0.19	3.16	1.34	1.33	0.23	4.97	1.58	1.58	0.27	7.32	
		20	-	-	-	-	1.16	0.75	0.20	3.43	1.28	1.03	0.22	4.44	1.43	1.30	0.25	5.92	1.62	1.58	0.28	7.60	
6		15	0.45	0.45	0.06	0.68	0.74	0.74	0.11	1.13	1.01	1.01	0.14	1.59	1.25	1.25	0.18	2.58	1.49	1.49	0.21	4.14	
		17	0.45	0.45	0.06	0.68	0.74	0.74	0.11	1.13	1.01	1.01	0.14	1.59	1.25	1.25	0.18	2.59	1.49	1.49	0.21	4.16	
		19	-	-	-	-	0.78	0.71	0.11	1.19	1.02	1.00	0.15	1.63	1.25	1.25	0.18	2.60	1.49	1.49	0.21	4.18	
		20	-	-	-	-	0.92	0.66	0.13	1.40	1.12	0.95	0.16	1.94	1.30	1.23	0.19	2.89	1.50	1.49	0.22	4.25	
15		3	15	0.51	0.51	0.14	1.59	0.76	0.76	0.22	4.34	1.01	1.01	0.29	8.10	1.26	1.26	0.36	11.77	1.51	1.51	0.43	16.10
			17	0.51	0.51	0.15	1.59	0.76	0.76	0.22	4.35	1.01	1.01	0.29	8.13	1.26	1.26	0.36	11.81	1.51	1.51	0.43	16.16
			19	-	-	-	-	0.80	0.74	0.23	5.03	1.02	1.01	0.29	8.14	1.27	1.27	0.36	11.85	1.51	1.51	0.43	16.21
			20	-	-	-	-	1.07	0.73	0.31	8.92	1.16	0.99	0.33	10.22	1.30	1.26	0.37	12.45	1.51	1.51	0.43	16.19
		4	15	0.40	0.40	0.09	0.90	0.68	0.68	0.14	1.58	0.92	0.92	0.20	3.44	1.17	1.17	0.25	6.26	1.42	1.42	0.30	8.84
			17	0.40	0.40	0.09	0.90	0.68	0.68	0.15	1.59	0.92	0.92	0.20	3.46	1.17	1.17	0.25	6.28	1.43	1.43	0.31	8.87
			19	-	-	-	-	0.69	0.67	0.15	1.63	0.92	0.92	0.20	3.46	1.18	1.18	0.25	6.31	1.43	1.43	0.31	8.90
			20	-	-	-	-	0.80	0.62	0.17	2.37	0.98	0.90	0.21	4.02	1.18	1.18	0.25	6.39	1.43	1.43	0.31	8.91
	5	15	0.27	0.27	0.05	0.48	0.58	0.58	0.10	1.02	0.84	0.84	0.15	1.59	1.09	1.09	0.19	3.01	1.33	1.33	0.23	5.13	
		17	0.27	0.27	0.05	0.48	0.58	0.58	0.10	1.02	0.85	0.85	0.15	1.60	1.09	1.09	0.19	3.02	1.33	1.33	0.23	5.15	
		19	-	-	-	-	0.58	0.58	0.10	1.02	0.85	0.85	0.15	1.60	1.09	1.09	0.19	3.04	1.34	1.34	0.23	5.17	
		20	-	-	-	-	0.63	0.54	0.11	1.10	0.87	0.83	0.15	1.68	1.09	1.09	0.19	3.04	1.34	1.34	0.23	5.18	
	6	15	-	-	-	-	0.46	0.46	0.07	0.66	0.75	0.75	0.11	1.09	1.01	1.01	0.14	1.58	1.25	1.25	0.18	2.71	
		17	-	-	-	-	0.46	0.46	0.07	0.66	0.75	0.75	0.11	1.09	1.01	1.01	0.15	1.59	1.25	1.25	0.18	2.72	
		19	-	-	-	-	0.46	0.46	0.07	0.66	0.75	0.75	0.11	1.09	1.01	1.01	0.15	1.59	1.25	1.25	0.18	2.73	
		20	-	-	-	-	0.47	0.45	0.07	0.68	0.75	0.75	0.11	1.10	1.01	1.01	0.15	1.59	1.26	1.26	0.18	2.74	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH2-V350-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	3.24	2.41	0.93	38.79	3.21	2.74	0.92	38.36	3.25	3.08	0.93	39.19	3.41	3.41	0.98	42.59	3.74	3.74	1.08	50.39	
		17	4.24	2.43	1.22	62.80	4.21	2.76	1.22	62.08	4.18	3.08	1.20	60.47	4.15	3.40	1.19	59.79	4.13	3.72	1.18	59.35	
		19	-	-	-	-	5.28	2.78	1.53	92.05	5.24	3.10	1.52	91.01	5.21	3.42	1.51	90.00	5.17	3.74	1.48	87.72	
		20	-	-	-	-	5.84	2.78	1.69	109.65	5.80	3.11	1.68	108.86	5.77	3.43	1.67	107.66	5.73	3.75	1.66	106.46	
	4	15	2.93	2.27	0.63	20.09	2.96	2.61	0.64	20.43	3.07	2.96	0.66	21.78	3.30	3.30	0.71	24.45	3.63	3.63	0.78	28.71	
		17	3.96	2.30	0.85	33.36	3.93	2.63	0.84	32.98	3.91	2.95	0.84	32.60	3.89	3.28	0.83	32.31	3.92	3.60	0.84	32.77	
		19	-	-	-	-	5.02	2.65	1.08	50.17	4.98	2.98	1.07	49.62	4.95	3.30	1.06	49.08	4.92	3.62	1.06	48.55	
		20	-	-	-	-	5.59	2.66	1.21	61.10	5.55	2.99	1.20	60.09	5.52	3.31	1.19	59.76	5.48	3.63	1.18	59.11	
	5	15	2.58	2.10	0.44	10.81	2.69	2.46	0.46	11.75	2.89	2.83	0.50	13.27	3.18	3.18	0.55	15.78	3.51	3.51	0.60	18.64	
		17	3.64	2.15	0.63	19.81	3.62	2.48	0.62	19.58	3.60	2.81	0.62	19.37	3.62	3.14	0.62	19.64	3.71	3.49	0.64	20.49	
		19	-	-	-	-	4.73	2.52	0.82	31.00	4.70	2.85	0.81	30.65	4.67	3.17	0.81	30.32	4.64	3.49	0.80	29.99	
		20	-	-	-	-	5.31	2.53	0.92	37.81	5.28	2.86	0.91	37.40	5.24	3.19	0.90	37.00	5.21	3.51	0.90	36.61	
6	15	2.31	1.96	0.33	5.35	2.49	2.34	0.36	6.46	2.72	2.70	0.39	8.14	3.05	3.05	0.44	10.49	3.38	3.38	0.49	12.79		
	17	3.26	1.98	0.47	11.93	3.23	2.31	0.46	11.77	3.26	2.65	0.47	11.96	3.36	3.00	0.48	12.61	3.51	3.36	0.50	13.62		
	19	-	-	-	-	4.40	2.37	0.63	19.78	4.37	2.69	0.62	19.56	4.34	3.02	0.62	19.34	4.31	3.34	0.62	19.15		
	20	-	-	-	-	4.99	2.39	0.71	24.57	4.96	2.72	0.71	24.30	4.93	3.04	0.70	24.04	4.89	3.36	0.70	23.77		
7	3	15	2.49	2.06	0.71	24.38	2.56	2.41	0.73	25.59	2.76	2.75	0.80	29.52	3.08	3.08	0.89	35.83	3.40	3.40	0.98	41.95	
		17	3.50	2.08	1.00	43.94	3.47	2.41	1.00	43.43	3.45	2.74	0.99	42.90	3.45	3.07	0.99	42.80	3.51	3.40	1.01	44.28	
		19	-	-	-	-	4.55	2.43	1.32	70.43	4.52	2.76	1.31	69.10	4.49	3.08	1.30	68.32	4.46	3.40	1.29	67.54	
		20	-	-	-	-	5.12	2.44	1.49	86.42	5.08	2.77	1.48	85.45	5.05	3.09	1.47	84.49	5.02	3.41	1.46	83.53	
	4	15	2.20	1.92	0.48	12.19	2.37	2.29	0.51	13.81	2.64	2.64	0.57	16.57	2.97	2.97	0.64	20.18	3.30	3.30	0.71	24.10	
		17	3.18	1.94	0.68	22.67	3.16	2.27	0.68	22.40	3.15	2.60	0.68	22.31	3.22	2.95	0.69	23.08	3.36	3.29	0.72	24.84	
		19	-	-	-	-	4.26	2.30	0.92	37.44	4.23	2.63	0.91	37.01	4.21	2.96	0.91	36.59	4.18	3.28	0.90	36.16	
		20	-	-	-	-	4.84	2.32	1.05	47.13	4.81	2.65	1.04	46.60	4.78	2.97	1.04	46.08	4.75	3.29	1.03	45.57	
	5	15	1.95	1.78	0.33	5.66	2.18	2.15	0.38	7.57	2.51	2.51	0.43	10.25	2.85	2.85	0.49	12.80	3.18	3.18	0.55	15.49	
		17	2.80	1.77	0.48	12.40	2.79	2.11	0.48	12.32	2.86	2.46	0.49	12.88	3.00	2.82	0.52	13.97	3.21	3.18	0.55	15.72	
		19	-	-	-	-	3.94	2.16	0.68	22.17	3.91	2.49	0.67	21.91	3.90	2.90	0.67	21.91	3.88	3.14	0.67	21.58	
		20	-	-	-	-	4.54	2.18	0.78	28.46	4.51	2.51	0.78	28.14	4.48	2.84	0.77	27.83	4.45	3.16	0.77	27.52	
6	15	1.79	1.68	0.26	2.83	2.06	2.05	0.30	4.06	2.38	2.38	0.34	5.96	2.71	2.71	0.39	8.26	3.05	3.05	0.44	10.49		
	17	2.36	1.59	0.34	5.87	2.44	1.95	0.35	6.39	2.59	2.32	0.37	7.41	2.79	2.69	0.40	8.82	3.06	3.06	0.44	10.54		
	19	-	-	-	-	3.56	2.00	0.51	13.70	3.53	2.33	0.51	13.53	3.52	2.66	0.51	13.47	3.58	3.00	0.51	13.84		
	20	-	-	-	-	4.17	2.03	0.60	17.90	4.15	2.36	0.60	17.69	4.12	2.69	0.59	17.48	4.09	3.01	0.59	17.28		
9	3	15	1.81	1.73	0.52	14.01	2.08	2.08	0.60	17.78	2.42	2.42	0.70	22.98	2.75	2.75	0.80	29.01	3.07	3.07	0.88	34.68	
		17	2.70	1.73	0.78	28.07	2.68	2.06	0.78	27.69	2.70	2.40	0.78	28.13	2.82	2.75	0.82	30.19	3.08	3.08	0.89	34.79	
		19	-	-	-	-	3.77	2.09	1.09	49.97	3.74	2.42	1.09	49.37	3.72	2.74	1.08	48.78	3.70	3.06	1.07	48.20	
		20	-	-	-	-	4.34	2.09	1.25	62.94	4.31	2.43	1.25	62.75	4.28	2.75	1.24	62.40	4.25	3.07	1.23	61.69	
	4	15	1.62	1.60	0.35	6.47	1.96	1.96	0.42	9.74	2.30	2.30	0.50	12.85	2.64	2.64	0.57	16.24	2.97	2.97	0.64	19.92	
		17	2.31	1.57	0.50	12.92	2.35	1.92	0.51	13.41	2.46	2.28	0.53	14.42	2.66	2.64	0.57	16.50	2.97	2.97	0.64	19.98	
		19	-	-	-	-	3.45	1.95	0.75	25.85	3.42	2.28	0.74	25.54	3.40	2.61	0.74	25.22	3.42	2.94	0.74	25.50	
		20	-	-	-	-	4.03	1.97	0.87	33.47	4.00	2.30	0.86	33.07	3.97	2.62	0.86	32.69	3.95	2.94	0.85	32.30	
	5	15	1.50	1.49	0.26	2.89	1.83	1.83	0.31	4.95	2.17	2.17	0.37	7.62	2.51	2.51	0.43	10.18	2.85	2.85	0.49	12.60	
		17	1.89	1.39	0.32	5.44	2.03	1.77	0.35	6.58	2.24	2.15	0.39	8.24	2.52	2.52	0.43	10.22	2.85	2.85	0.49	12.64	
		19	-	-	-	-	3.06	1.79	0.53	14.28	3.04	2.13	0.52	14.10	3.07	2.47	0.53	14.32	3.16	2.82	0.55	15.07	
		20	-	-	-	-	3.67	1.82	0.63	19.36	3.65	2.15	0.63	19.14	3.62	2.48	0.62	18.90	3.61	2.81	0.62	18.82	
6	15	1.37	1.37	0.20	1.75	1.72	1.72	0.25	2.61	2.05	2.05	0.29	4.16	2.38	2.38	0.34	6.19	2.72	2.72	0.39	8.39		
	17	1.63	1.28	0.23	2.30	1.84	1.66	0.26	3.12	2.08	2.03	0.30	4.35	2.38	2.38	0.34	6.21	2.72	2.72	0.39	8.42		
	19	-	-	-	-	2.56	1.60	0.37	7.41	2.61	1.95	0.37	7.70	2.74	2.32	0.39	8.50	2.91	2.69	0.42	9.55		
	20	-	-	-	-	3.24	1.65	0.46	11.42	3.21	1.98	0.46	11.27	3.21	2.31	0.46	11.24	3.28	2.66	0.47	11.65		

Continued:

		MDKH2-V350-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
11	3	15	1.39	1.39	0.40	8.70	1.74	1.74	0.50	12.78	2.08	2.08	0.59	17.32	2.42	2.42	0.69	22.34	2.75	2.75	0.79	27.96	
		17	1.80	1.36	0.51	13.45	1.90	1.72	0.54	14.90	2.10	2.09	0.60	17.53	2.42	2.42	0.69	22.41	2.75	2.75	0.79	28.05	
		19	-	-	-	-	2.91	1.73	0.83	30.72	2.89	2.06	0.83	30.32	2.88	2.39	0.82	30.20	2.95	2.73	0.84	31.39	
		20	-	-	-	-	3.50	1.75	1.01	42.76	3.48	2.08	1.00	42.23	3.45	2.41	0.99	41.71	3.42	2.73	0.99	41.18	
	4	15	1.27	1.27	0.27	3.43	1.61	1.61	0.34	6.43	1.96	1.96	0.42	9.56	2.30	2.30	0.49	12.56	2.64	2.64	0.56	15.82	
		17	1.45	1.21	0.31	4.93	1.67	1.59	0.36	7.01	1.96	1.96	0.42	9.57	2.31	2.31	0.49	12.60	2.64	2.64	0.57	15.86	
		19	-	-	-	-	2.52	1.58	0.54	14.63	2.52	1.92	0.54	14.62	2.60	2.27	0.56	15.46	2.75	2.63	0.59	17.00	
		20	-	-	-	-	3.14	1.61	0.67	21.25	3.11	1.94	0.67	20.98	3.09	2.27	0.66	20.70	3.12	2.60	0.67	21.05	
	5	15	1.15	1.15	0.20	1.71	1.50	1.50	0.26	3.00	1.83	1.83	0.32	5.17	2.17	2.17	0.37	7.75	2.52	2.52	0.43	10.06	
		17	1.25	1.11	0.22	1.94	1.52	1.49	0.26	3.12	1.83	1.83	0.32	5.19	2.18	2.18	0.38	7.78	2.52	2.52	0.43	10.09	
		19	-	-	-	-	2.04	1.40	0.35	6.76	2.16	1.77	0.37	7.67	2.35	2.14	0.40	8.92	2.57	2.51	0.44	10.45	
		20	-	-	-	-	2.70	1.44	0.47	11.30	2.68	1.77	0.46	11.13	2.73	2.12	0.47	11.48	2.84	2.48	0.49	12.33	
	6	15	1.01	1.01	0.15	1.21	1.38	1.38	0.20	1.69	1.72	1.72	0.25	2.70	2.05	2.05	0.29	4.34	2.38	2.38	0.34	6.32	
		17	1.05	0.98	0.15	1.25	1.39	1.38	0.20	1.70	1.72	1.72	0.25	2.71	2.05	2.05	0.29	4.36	2.39	2.39	0.34	6.34	
		19	-	-	-	-	1.71	1.26	0.25	2.68	1.90	1.64	0.27	3.57	2.13	2.02	0.31	4.85	2.40	2.39	0.34	6.45	
		20	-	-	-	-	2.14	1.24	0.31	4.94	2.21	1.59	0.32	5.28	2.37	1.97	0.34	6.25	2.57	2.34	0.37	7.46	
	13	3	15	1.04	1.04	0.30	4.61	1.40	1.40	0.40	8.75	1.74	1.74	0.50	12.57	2.08	2.08	0.60	17.25	2.41	2.41	0.69	22.21
			17	1.07	1.03	0.31	4.95	1.40	1.40	0.40	8.75	1.75	1.75	0.50	12.61	2.09	2.09	0.60	17.31	2.42	2.42	0.70	22.28
			19	-	-	-	-	1.95	1.37	0.56	15.45	2.02	1.72	0.58	16.30	2.16	2.08	0.62	18.41	2.42	2.41	0.70	22.30
			20	-	-	-	-	2.57	1.39	0.74	24.65	2.54	1.72	0.73	24.29	2.55	2.06	0.73	24.31	2.62	2.40	0.75	25.62
		4	15	0.93	0.93	0.20	1.69	1.27	1.27	0.27	3.63	1.61	1.61	0.35	6.57	1.96	1.96	0.42	9.42	2.30	2.30	0.49	12.35
			17	0.93	0.93	0.20	1.70	1.27	1.27	0.27	3.64	1.61	1.61	0.35	6.60	1.96	1.96	0.42	9.45	2.30	2.30	0.49	12.39
			19	-	-	-	-	1.53	1.20	0.33	5.84	1.74	1.59	0.37	7.64	1.99	1.96	0.43	9.64	2.31	2.31	0.49	12.43
			20	-	-	-	-	2.10	1.22	0.45	10.52	2.12	1.56	0.45	10.69	2.24	1.93	0.48	11.76	2.41	2.29	0.52	13.38
5		15	0.78	0.78	0.13	1.08	1.15	1.15	0.20	1.66	1.49	1.49	0.26	3.07	1.83	1.83	0.31	5.27	2.17	2.17	0.37	7.66	
		17	0.78	0.78	0.13	1.08	1.16	1.16	0.20	1.66	1.49	1.49	0.26	3.08	1.83	1.83	0.31	5.29	2.18	2.18	0.37	7.69	
		19	-	-	-	-	1.29	1.09	0.22	2.08	1.54	1.47	0.26	3.36	1.84	1.84	0.31	5.32	2.18	2.18	0.37	7.71	
		20	-	-	-	-	1.57	1.03	0.27	3.58	1.74	1.41	0.30	4.69	1.96	1.79	0.34	6.26	2.22	2.17	0.38	7.97	
6	15	0.62	0.62	0.09	0.69	1.02	1.02	0.15	1.15	1.38	1.38	0.20	1.65	1.72	1.72	0.25	2.77	2.05	2.05	0.29	4.45		
	17	0.62	0.62	0.09	0.69	1.02	1.02	0.15	1.15	1.38	1.38	0.20	1.65	1.72	1.72	0.25	2.78	2.05	2.05	0.29	4.47		
	19	-	-	-	-	1.07	0.98	0.15	1.21	1.40	1.37	0.20	1.70	1.72	1.72	0.25	2.79	2.05	2.05	0.29	4.49		
	20	-	-	-	-	1.25	0.91	0.18	1.42	1.53	1.31	0.22	2.04	1.78	1.69	0.26	3.08	2.07	2.05	0.30	4.56		
15	3	15	0.70	0.70	0.20	1.65	1.04	1.04	0.30	4.66	1.40	1.40	0.40	8.50	1.74	1.74	0.50	12.36	2.08	2.08	0.60	16.94	
		17	0.70	0.70	0.20	1.66	1.04	1.04	0.30	4.67	1.40	1.40	0.40	8.52	1.74	1.74	0.50	12.40	2.08	2.08	0.60	17.00	
		19	-	-	-	-	1.10	1.02	0.31	5.34	1.40	1.40	0.40	8.53	1.75	1.75	0.50	12.44	2.09	2.09	0.60	17.05	
		20	-	-	-	-	1.47	1.00	0.42	9.24	1.60	1.37	0.46	10.64	1.80	1.74	0.51	13.03	2.09	2.08	0.60	17.04	
	4	15	0.55	0.55	0.12	0.91	0.93	0.93	0.20	1.65	1.27	1.27	0.27	3.70	1.61	1.61	0.35	6.63	1.96	1.96	0.42	9.38	
		17	0.55	0.55	0.12	0.91	0.93	0.93	0.20	1.66	1.27	1.27	0.27	3.71	1.62	1.62	0.35	6.65	1.97	1.97	0.42	9.41	
		19	-	-	-	-	0.94	0.92	0.20	1.71	1.27	1.27	0.27	3.72	1.62	1.62	0.35	6.67	1.97	1.97	0.42	9.44	
		20	-	-	-	-	1.09	0.86	0.23	2.48	1.34	1.24	0.29	4.28	1.63	1.62	0.35	6.74	1.97	1.97	0.43	9.46	
	5	15	0.37	0.37	0.06	0.48	0.79	0.79	0.14	1.04	1.16	1.16	0.20	1.67	1.49	1.49	0.26	3.23	1.83	1.83	0.32	5.48	
		17	0.37	0.37	0.06	0.48	0.79	0.79	0.14	1.04	1.16	1.16	0.20	1.68	1.50	1.50	0.26	3.25	1.84	1.84	0.32	5.50	
		19	-	-	-	-	0.79	0.79	0.14	1.04	1.16	1.16	0.20	1.68	1.50	1.50	0.26	3.26	1.84	1.84	0.32	5.52	
		20	-	-	-	-	0.85	0.75	0.15	1.12	1.19	1.15	0.20	1.76	1.50	1.49	0.26	3.26	1.84	1.84	0.32	5.53	
6	15	-	-	-	-	0.63	0.63	0.09	0.67	1.02	1.02	0.15	1.11	1.39	1.39	0.20	1.67	1.72	1.72	0.25	2.91		
	17	-	-	-	-	0.63	0.63	0.09	0.67	1.02	1.02	0.15	1.11	1.39	1.39	0.20	1.67	1.72	1.72	0.25	2.92		
	19	-	-	-	-	0.63	0.63	0.09	0.67	1.03	1.03	0.15	1.11	1.39	1.39	0.20	1.68	1.72	1.72	0.25	2.93		
	20	-	-	-	-	0.64	0.61	0.09	0.68	1.03	1.02	0.15	1.11	1.39	1.39	0.20	1.68	1.72	1.72	0.25	2.94		

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH2-V500-R4																							
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
			kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	
5	3	15	4.03	3.02	1.15	56.64	4.00	3.44	1.15	56.04	4.06	3.87	1.16	57.50	4.30	4.29	1.24	64.25	4.70	4.70	1.36	75.27	
		17	5.30	3.04	1.53	92.61	5.26	3.46	1.52	91.63	5.23	3.88	1.51	90.68	5.19	4.28	1.49	88.11	5.18	4.69	1.50	88.76	
		19	-	-	-	-	6.60	3.47	1.90	135.01	6.56	3.89	1.89	133.65	6.53	4.30	1.88	132.29	6.49	4.71	1.87	130.91	
		20	-	-	-	-	7.32	3.48	2.11	161.70	7.27	3.90	2.10	160.00	7.23	4.31	2.09	158.36	7.19	4.72	2.07	156.77	
	4	15	3.63	2.83	0.78	28.65	3.67	3.26	0.79	29.20	3.82	3.71	0.82	31.43	4.14	4.14	0.89	36.10	4.56	4.56	0.98	42.53	
		17	4.92	2.87	1.06	48.57	4.89	3.29	1.05	48.06	4.86	3.70	1.04	47.55	4.84	4.11	1.04	47.14	4.89	4.53	1.05	47.98	
		19	-	-	-	-	6.26	3.31	1.35	74.47	6.23	3.73	1.35	73.70	6.19	4.14	1.34	72.95	6.15	4.54	1.32	71.38	
		20	-	-	-	-	6.98	3.32	1.51	90.03	6.94	3.74	1.50	89.12	6.90	4.15	1.49	88.20	6.86	4.56	1.48	87.32	
	5	15	3.21	2.63	0.55	15.91	3.36	3.09	0.58	17.22	3.61	3.55	0.62	19.50	3.98	3.98	0.68	22.94	4.40	4.40	0.76	27.21	
		17	4.51	2.67	0.77	28.27	4.48	3.09	0.77	27.96	4.45	3.51	0.76	27.66	4.49	3.94	0.77	28.13	4.63	4.38	0.80	29.83	
		19	-	-	-	-	5.88	3.14	1.01	44.65	5.84	3.55	1.00	44.18	5.81	3.96	1.00	43.73	5.77	4.37	0.99	43.28	
		20	-	-	-	-	6.61	3.15	1.14	54.67	6.57	3.57	1.13	54.13	6.53	3.98	1.12	53.56	6.49	4.39	1.12	53.03	
6	15	2.79	2.42	0.40	8.69	3.05	2.90	0.44	10.53	3.39	3.38	0.49	12.83	3.82	3.82	0.55	15.68	4.24	4.24	0.61	18.62		
	17	4.02	2.46	0.58	16.99	4.00	2.88	0.57	16.78	4.03	3.31	0.58	17.06	4.17	3.76	0.60	18.05	4.38	4.22	0.63	19.64		
	19	-	-	-	-	5.46	2.95	0.78	28.79	5.42	3.36	0.77	28.23	5.38	3.77	0.77	27.93	5.35	4.18	0.77	27.66		
	20	-	-	-	-	6.20	2.97	0.89	35.58	6.17	3.39	0.89	35.52	6.13	3.80	0.88	35.17	6.10	4.21	0.88	34.82		
7	3	15	3.09	2.58	0.89	35.85	3.19	3.02	0.92	37.83	3.46	3.45	0.99	43.07	3.87	3.87	1.11	52.50	4.29	4.29	1.24	62.98	
		17	4.36	2.60	1.25	64.42	4.33	3.02	1.25	63.60	4.30	3.44	1.24	63.37	4.30	3.86	1.24	63.27	4.40	4.28	1.27	65.95	
		19	-	-	-	-	5.68	3.04	1.64	102.56	5.65	3.46	1.64	102.37	5.62	3.88	1.63	101.91	5.59	4.28	1.62	100.79	
		20	-	-	-	-	6.40	3.05	1.86	127.52	6.36	3.47	1.84	125.10	6.32	3.88	1.83	123.80	6.29	4.29	1.83	123.84	
	4	15	2.72	2.40	0.58	17.27	2.94	2.86	0.63	19.79	3.30	3.30	0.71	24.18	3.73	3.73	0.81	30.03	4.14	4.14	0.89	35.62	
		17	3.95	2.42	0.86	33.16	3.93	2.85	0.85	32.79	3.92	3.27	0.85	32.66	4.01	3.70	0.87	33.94	4.20	4.14	0.90	36.45	
		19	-	-	-	-	5.31	2.88	1.15	55.28	5.28	3.30	1.14	54.69	5.25	3.71	1.14	54.09	5.21	4.12	1.13	53.50	
		20	-	-	-	-	6.03	2.89	1.30	68.68	5.99	3.31	1.29	67.54	5.95	3.72	1.28	66.82	5.92	4.13	1.28	66.11	
	5	15	2.38	2.20	0.41	9.21	2.71	2.69	0.47	11.77	3.14	3.14	0.54	15.10	3.57	3.57	0.61	18.74	3.99	3.99	0.69	22.68	
		17	3.46	2.21	0.60	17.77	3.45	2.64	0.59	17.65	3.54	3.08	0.61	18.51	3.73	3.54	0.64	20.23	4.01	3.99	0.69	22.90	
		19	-	-	-	-	4.88	2.69	0.84	32.16	4.86	3.11	0.84	32.00	4.85	3.63	0.83	54.33	4.82	3.94	0.83	31.54	
		20	-	-	-	-	5.62	2.71	0.97	40.84	5.59	3.13	0.96	40.40	5.55	3.55	0.96	39.97	5.52	3.96	0.95	39.56	
6	15	2.14	2.05	0.31	4.49	2.51	2.51	0.36	6.84	2.95	2.95	0.42	9.84	3.39	3.39	0.49	12.58	3.82	3.82	0.55	15.42		
	17	2.86	1.96	0.41	9.25	2.98	2.42	0.43	10.01	3.20	2.90	0.46	11.36	3.48	3.38	0.50	13.23	3.83	3.83	0.55	15.46		
	19	-	-	-	-	4.40	2.49	0.63	19.55	4.37	2.91	0.63	19.33	4.36	3.33	0.63	19.24	4.43	3.76	0.64	19.83		
	20	-	-	-	-	5.17	2.52	0.74	25.90	5.14	2.94	0.74	25.62	5.11	3.36	0.73	25.34	5.07	3.77	0.73	25.06		
9	3	15	2.25	2.16	0.65	20.25	2.61	2.61	0.75	26.19	3.04	3.04	0.87	33.91	3.46	3.46	1.00	43.00	3.87	3.87	1.11	51.58	
		17	3.34	2.16	0.96	39.97	3.31	2.58	0.95	39.43	3.35	3.01	0.96	40.25	3.52	3.45	1.02	44.38	3.87	3.87	1.11	51.73	
		19	-	-	-	-	4.70	2.61	1.36	73.31	4.66	3.03	1.34	71.38	4.63	3.44	1.34	71.19	4.60	3.85	1.33	69.75	
		20	-	-	-	-	5.42	2.62	1.58	94.23	5.38	3.04	1.57	93.20	5.35	3.46	1.56	92.19	5.32	3.87	1.55	91.16	
	4	15	2.01	1.99	0.43	10.21	2.44	2.44	0.53	14.23	2.88	2.88	0.62	18.92	3.31	3.31	0.72	24.08	3.72	3.72	0.80	29.24	
		17	2.86	1.96	0.62	18.63	2.90	2.40	0.63	19.06	3.06	2.85	0.66	20.96	3.33	3.31	0.72	24.36	3.73	3.73	0.80	29.32	
		19	-	-	-	-	4.27	2.43	0.92	36.91	4.24	2.85	0.91	36.49	4.21	3.27	0.91	36.06	4.24	3.69	0.91	36.57	
		20	-	-	-	-	5.00	2.45	1.08	48.64	4.97	2.87	1.07	48.11	4.94	3.28	1.06	47.58	4.91	3.70	1.06	47.05	
	5	15	1.81	1.81	0.31	4.86	2.26	2.26	0.39	8.33	2.71	2.71	0.47	11.54	3.14	3.14	0.54	14.95	3.57	3.57	0.61	18.48	
		17	2.29	1.72	0.39	8.58	2.50	2.21	0.43	10.11	2.79	2.69	0.48	12.15	3.15	3.15	0.54	14.99	3.57	3.57	0.62	18.53	
		19	-	-	-	-	3.77	2.23	0.65	20.27	3.74	2.65	0.64	20.00	3.78	3.08	0.65	20.38	3.92	3.53	0.67	21.64	
		20	-	-	-	-	4.54	2.26	0.78	27.96	4.51	2.68	0.78	27.62	4.48	3.10	0.77	27.27	4.47	3.52	0.77	27.14	
6	15	1.66	1.66	0.24	2.41	2.08	2.08	0.30	4.37	2.52	2.52	0.36	7.10	2.97	2.97	0.43	9.85	3.40	3.40	0.49	12.45		
	17	1.91	1.55	0.27	3.46	2.19	2.03	0.31	5.04	2.54	2.51	0.36	7.29	2.97	2.97	0.43	9.87	3.41	3.41	0.49	12.48		
	19	-	-	-	-	3.16	1.99	0.45	10.96	3.22	2.44	0.46	11.29	3.39	2.90	0.49	12.33	3.62	3.37	0.52	13.80		
	20	-	-	-	-	4.00	2.05	0.57	16.31	3.97	2.47	0.57	16.11	3.96	2.89	0.57	16.05	4.05	3.33	0.58	16.70		

Continued:

		MDKH2-V500-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
11	3	15	1.74	1.74	0.50	12.71	2.18	2.18	0.62	18.70	2.61	2.61	0.75	25.48	3.03	3.03	0.87	32.98	3.45	3.45	0.99	41.78	
		17	2.22	1.70	0.63	19.21	2.35	2.16	0.67	21.31	2.62	2.61	0.75	25.68	3.04	3.04	0.87	33.07	3.46	3.46	1.00	41.91	
		19	-	-	-	-	3.61	2.16	1.03	44.55	3.58	2.58	1.02	44.00	3.58	3.01	1.02	43.87	3.67	3.44	1.05	45.91	
		20	-	-	-	-	4.34	2.18	1.24	61.46	4.31	2.60	1.23	60.73	4.28	3.02	1.23	60.00	4.25	3.43	1.22	59.27	
	4	15	1.55	1.55	0.33	5.85	2.00	2.00	0.43	9.92	2.45	2.45	0.52	13.95	2.88	2.88	0.62	18.40	3.31	3.31	0.71	23.28	
		17	1.76	1.49	0.38	7.84	2.07	1.99	0.44	10.47	2.45	2.45	0.53	13.96	2.89	2.89	0.62	18.45	3.31	3.31	0.71	23.34	
		19	-	-	-	-	3.11	1.97	0.67	20.91	3.11	2.40	0.67	20.91	3.22	2.85	0.69	22.25	3.43	3.30	0.73	24.74	
		20	-	-	-	-	3.88	2.00	0.83	30.73	3.85	2.42	0.83	30.33	3.82	2.84	0.82	29.92	3.86	3.27	0.83	30.51	
	5	15	1.40	1.40	0.24	2.50	1.82	1.82	0.31	5.12	2.27	2.27	0.39	8.42	2.72	2.72	0.47	11.45	3.15	3.15	0.54	14.59	
		17	1.48	1.34	0.25	2.92	1.83	1.82	0.32	5.22	2.28	2.27	0.39	8.44	2.72	2.72	0.47	11.48	3.16	3.16	0.54	14.76	
		19	-	-	-	-	2.51	1.74	0.43	9.95	2.67	2.21	0.46	11.08	2.91	2.68	0.50	12.71	3.21	3.15	0.55	15.18	
		20	-	-	-	-	3.33	1.79	0.57	16.12	3.30	2.21	0.57	15.87	3.36	2.65	0.58	16.39	3.52	3.11	0.61	17.72	
	6	15	1.22	1.22	0.18	1.46	1.67	1.67	0.24	2.50	2.09	2.09	0.30	4.59	2.53	2.53	0.36	7.22	2.98	2.98	0.43	9.71	
		17	1.25	1.20	0.18	1.50	1.67	1.67	0.24	2.51	2.09	2.09	0.30	4.61	2.53	2.53	0.36	7.24	2.98	2.98	0.43	9.73	
		19	-	-	-	-	2.00	1.53	0.29	4.09	2.27	2.02	0.33	5.68	2.62	2.51	0.37	7.73	3.00	2.98	0.43	9.82	
		20	-	-	-	-	2.58	1.52	0.37	7.51	2.69	1.98	0.39	8.14	2.92	2.46	0.42	9.36	3.19	2.94	0.46	10.90	
	13	3	15	1.29	1.29	0.37	7.59	1.74	1.74	0.50	12.55	2.18	2.18	0.63	18.69	2.61	2.61	0.75	25.41	3.03	3.03	0.87	32.45
			17	1.32	1.28	0.38	7.91	1.74	1.74	0.50	12.56	2.19	2.19	0.63	18.74	2.61	2.61	0.75	25.48	3.03	3.03	0.87	32.54
			19	-	-	-	-	2.41	1.70	0.69	22.07	2.49	2.15	0.72	23.39	2.69	2.61	0.77	26.61	3.04	3.03	0.87	32.59
			20	-	-	-	-	3.16	1.72	0.90	34.91	3.14	2.15	0.90	34.43	3.14	2.58	0.90	34.51	3.26	3.02	0.93	36.78
4		15	1.12	1.12	0.24	2.59	1.55	1.55	0.33	6.06	2.01	2.01	0.43	9.82	2.45	2.45	0.53	13.76	2.88	2.88	0.62	18.32	
		17	1.12	1.12	0.24	2.60	1.56	1.56	0.33	6.08	2.01	2.01	0.43	9.85	2.46	2.46	0.53	13.80	2.89	2.89	0.62	18.37	
		19	-	-	-	-	1.88	1.50	0.40	8.71	2.15	1.98	0.46	11.00	2.48	2.46	0.53	14.01	2.89	2.89	0.62	18.43	
		20	-	-	-	-	2.59	1.52	0.56	15.24	2.61	1.96	0.56	15.44	2.77	2.42	0.60	17.06	3.00	2.87	0.65	19.62	
5		15	0.94	0.94	0.16	1.30	1.39	1.39	0.24	2.55	1.82	1.82	0.31	5.25	2.28	2.28	0.39	8.29	2.72	2.72	0.47	11.21	
		17	0.94	0.94	0.16	1.30	1.40	1.40	0.24	2.56	1.83	1.83	0.31	5.26	2.28	2.28	0.39	8.31	2.72	2.72	0.47	11.24	
		19	-	-	-	-	1.51	1.33	0.26	3.21	1.87	1.81	0.32	5.57	2.28	2.28	0.39	8.33	2.73	2.73	0.47	11.27	
		20	-	-	-	-	1.86	1.26	0.32	5.53	2.12	1.75	0.36	7.31	2.43	2.25	0.42	9.27	2.77	2.72	0.48	11.56	
6	15	0.73	0.73	0.10	0.82	1.23	1.23	0.18	1.39	1.67	1.67	0.24	2.57	2.09	2.09	0.30	4.73	2.54	2.54	0.36	7.28		
	17	0.73	0.73	0.10	0.82	1.23	1.23	0.18	1.40	1.67	1.67	0.24	2.58	2.10	2.10	0.30	4.75	2.55	2.55	0.36	7.30		
	19	-	-	-	-	1.28	1.19	0.18	1.46	1.68	1.66	0.24	2.63	2.10	2.10	0.30	4.76	2.55	2.55	0.36	7.32		
	20	-	-	-	-	1.47	1.11	0.21	1.87	1.80	1.59	0.26	3.16	2.15	2.07	0.31	5.08	2.56	2.55	0.37	7.36		
15	3	15	0.84	0.84	0.24	2.62	1.29	1.29	0.37	7.44	1.74	1.74	0.50	12.39	2.18	2.18	0.63	18.40	2.60	2.60	0.74	24.63	
		17	0.84	0.84	0.24	2.63	1.29	1.29	0.37	7.46	1.75	1.75	0.50	12.42	2.18	2.18	0.63	18.45	2.61	2.61	0.74	24.70	
		19	-	-	-	-	1.36	1.28	0.39	8.08	1.75	1.74	0.50	12.42	2.19	2.19	0.63	18.50	2.61	2.61	0.75	24.78	
		20	-	-	-	-	1.80	1.25	0.51	13.07	1.97	1.72	0.57	15.49	2.24	2.18	0.64	19.20	2.61	2.61	0.75	24.77	
	4	15	0.66	0.66	0.14	1.09	1.12	1.12	0.24	2.64	1.56	1.56	0.33	6.20	2.02	2.02	0.44	9.84	2.46	2.46	0.53	13.73	
		17	0.66	0.66	0.14	1.09	1.12	1.12	0.24	2.65	1.56	1.56	0.33	6.22	2.02	2.02	0.44	9.86	2.46	2.46	0.53	13.77	
		19	-	-	-	-	1.13	1.12	0.24	2.70	1.56	1.56	0.34	6.23	2.03	2.03	0.44	9.89	2.47	2.47	0.53	13.81	
		20	-	-	-	-	1.28	1.04	0.27	3.83	1.64	1.54	0.35	6.80	2.03	2.03	0.44	9.95	2.47	2.47	0.53	13.83	
	5	15	0.43	0.43	0.07	0.56	0.95	0.95	0.16	1.25	1.40	1.40	0.24	2.71	1.83	1.83	0.32	5.49	2.29	2.29	0.39	8.30	
		17	0.43	0.43	0.07	0.56	0.95	0.95	0.16	1.25	1.40	1.40	0.24	2.71	1.84	1.84	0.32	5.51	2.29	2.29	0.40	8.32	
		19	-	-	-	-	0.95	0.95	0.16	1.25	1.40	1.40	0.24	2.72	1.84	1.84	0.32	5.53	2.30	2.30	0.40	8.34	
		20	-	-	-	-	1.02	0.91	0.17	1.34	1.42	1.39	0.24	2.81	1.84	1.83	0.32	5.52	2.30	2.30	0.40	8.36	
6	15	-	-	-	-	0.74	0.74	0.11	0.80	1.24	1.24	0.18	1.36	1.67	1.67	0.24	2.71	2.10	2.10	0.30	4.96		
	17	-	-	-	-	0.74	0.74	0.11	0.80	1.24	1.24	0.18	1.36	1.67	1.67	0.24	2.72	2.11	2.11	0.30	4.97		
	19	-	-	-	-	0.74	0.74	0.11	0.80	1.24	1.24	0.18	1.37	1.68	1.68	0.24	2.73	2.11	2.11	0.30	4.99		
	20	-	-	-	-	0.75	0.73	0.11	0.81	1.24	1.24	0.18	1.37	1.68	1.68	0.24	2.73	2.11	2.11	0.30	5.00		

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH2)-V700-R4																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	5.45	4.16	1.56	35.76	5.43	4.76	1.55	35.54	5.57	5.38	1.59	37.16	5.99	5.98	1.71	42.06	6.58	6.58	1.90	50.13
		17	7.25	4.19	2.08	58.62	7.21	4.79	2.06	58.03	7.16	5.38	2.05	57.45	7.12	5.96	2.04	56.85	7.12	6.55	2.04	56.83
		19	-	-	-	-	9.12	4.81	2.62	87.69	9.08	5.41	2.63	88.13	9.02	5.99	2.59	85.97	8.97	6.57	2.57	85.12
		20	-	-	-	-	10.14	4.83	2.94	107.23	10.09	5.42	2.92	106.17	10.03	6.01	2.91	105.17	9.98	6.59	2.89	104.12
	4	15	4.79	3.85	1.03	17.53	4.91	4.48	1.06	18.31	5.21	5.13	1.12	20.30	5.73	5.73	1.23	23.69	6.32	6.32	1.36	28.04
		17	6.62	3.90	1.42	30.33	6.58	4.50	1.41	30.03	6.54	5.09	1.40	29.72	6.54	5.68	1.40	29.65	6.67	6.29	1.43	30.69
		19	-	-	-	-	8.53	4.53	1.83	47.02	8.48	5.13	1.82	46.57	8.44	5.72	1.81	46.12	8.39	6.30	1.80	45.67
		20	-	-	-	-	9.56	4.55	2.07	57.87	9.51	5.15	2.05	57.31	9.46	5.74	2.04	56.76	9.40	6.32	2.02	55.89
	5	15	4.08	3.51	0.70	9.03	4.41	4.18	0.76	10.30	4.86	4.84	0.83	12.18	5.47	5.47	0.94	14.98	6.07	6.07	1.05	17.89
		17	5.93	3.58	1.02	17.17	5.89	4.18	1.02	16.99	5.88	4.79	1.01	16.91	6.00	5.41	1.03	17.55	6.26	6.04	1.08	18.89
		19	-	-	-	-	7.88	4.24	1.35	27.74	7.83	4.83	1.34	27.46	7.79	5.42	1.34	27.19	7.74	6.01	1.33	26.92
		20	-	-	-	-	8.93	4.27	1.54	34.71	8.88	4.87	1.53	34.38	8.83	5.46	1.52	34.05	8.78	6.04	1.51	33.72
6	15	3.57	3.22	0.51	4.35	3.98	3.89	0.57	5.80	4.54	4.54	0.65	7.81	5.17	5.17	0.74	9.92	5.79	5.79	0.83	12.05	
	17	5.07	3.21	0.73	9.58	5.05	3.82	0.72	9.51	5.20	4.46	0.75	10.01	5.49	5.12	0.79	10.97	5.88	5.77	0.84	12.38	
	19	-	-	-	-	7.15	3.92	1.02	17.11	7.10	4.52	1.02	16.94	7.06	5.11	1.01	16.76	7.05	5.70	1.01	16.73	
	20	-	-	-	-	8.22	3.95	1.18	21.74	8.17	4.55	1.17	21.53	8.13	5.15	1.16	21.32	8.08	5.73	1.16	21.12	
7	3	15	4.12	3.54	1.18	21.79	4.33	4.18	1.24	23.76	4.81	4.80	1.39	28.82	5.40	5.40	1.56	35.27	5.98	5.98	1.72	41.60
		17	5.91	3.57	1.70	40.85	5.89	4.18	1.70	40.87	5.85	4.77	1.69	40.44	5.88	5.37	1.70	40.84	6.08	5.98	1.75	42.80
		19	-	-	-	-	7.81	4.20	2.26	66.59	7.76	4.80	2.24	65.91	7.71	5.39	2.22	64.95	7.67	5.97	2.21	64.13
		20	-	-	-	-	8.83	4.22	2.56	83.20	8.77	4.81	2.53	81.12	8.72	5.40	2.51	80.30	8.67	5.98	2.50	79.50
	4	15	3.55	3.25	0.77	10.38	3.96	3.92	0.86	12.58	4.54	4.54	0.98	15.87	5.14	5.14	1.11	19.44	5.74	5.74	1.23	23.45
		17	5.22	3.27	1.12	19.89	5.18	3.87	1.11	19.65	5.22	4.48	1.12	19.88	5.41	5.11	1.16	21.20	5.77	5.74	1.24	23.69
		19	-	-	-	-	7.17	3.92	1.55	34.74	7.13	4.52	1.54	34.39	7.09	5.11	1.53	34.04	7.05	5.70	1.52	33.68
		20	-	-	-	-	8.20	3.94	1.78	43.84	8.16	4.54	1.77	43.40	8.11	5.13	1.76	42.97	8.06	5.72	1.75	42.54
	5	15	3.07	2.95	0.53	4.89	3.61	3.61	0.62	7.15	4.25	4.25	0.73	9.57	4.87	4.87	0.84	12.06	5.48	5.48	0.94	14.75
		17	4.38	2.91	0.75	10.04	4.42	3.54	0.76	10.19	4.64	4.19	0.80	11.11	5.00	4.85	0.86	12.60	5.49	5.49	0.94	14.79
		19	-	-	-	-	6.44	3.61	1.11	19.38	6.40	4.21	1.10	19.18	6.35	4.98	1.09	32.77	6.40	5.41	1.10	19.17
		20	-	-	-	-	7.50	3.64	1.29	25.19	7.46	4.24	1.28	24.94	7.41	4.84	1.28	24.69	7.37	5.42	1.27	24.43
6	15	2.80	2.75	0.40	2.38	3.34	3.34	0.48	3.83	3.94	3.94	0.56	5.80	4.57	4.57	0.66	7.89	5.20	5.20	0.74	9.83	
	17	3.50	2.55	0.50	4.36	3.73	3.21	0.54	5.11	4.12	3.89	0.59	6.44	4.61	4.57	0.66	8.03	5.20	5.20	0.75	9.86	
	19	-	-	-	-	5.60	3.27	0.80	11.13	5.56	3.86	0.80	10.99	5.61	4.48	0.80	11.17	5.81	5.12	0.83	11.86	
	20	-	-	-	-	6.71	3.32	0.96	15.18	6.67	3.92	0.96	15.02	6.63	4.52	0.95	14.86	6.61	5.11	0.95	14.78	
9	3	15	3.02	2.96	0.87	12.66	3.60	3.60	1.04	17.15	4.20	4.20	1.21	22.27	4.81	4.81	1.39	28.42	5.39	5.39	1.55	34.25
		17	4.45	2.94	1.28	24.58	4.42	3.55	1.27	24.29	4.54	4.17	1.30	25.39	4.85	4.81	1.40	28.88	5.40	5.40	1.55	34.35
		19	-	-	-	-	6.39	3.59	1.85	46.59	6.35	4.19	1.84	46.09	6.31	4.78	1.83	45.60	6.28	5.37	1.82	45.20
		20	-	-	-	-	7.40	3.60	2.13	59.46	7.36	4.20	2.12	58.81	7.31	4.79	2.11	58.20	7.27	5.38	2.09	57.59
	4	15	2.66	2.66	0.57	6.06	3.31	3.31	0.71	9.03	3.94	3.94	0.85	12.12	4.55	4.55	0.98	15.52	5.15	5.15	1.11	19.28
		17	3.63	2.60	0.78	10.52	3.77	3.25	0.81	11.24	4.09	3.91	0.88	12.92	4.55	4.55	0.98	15.57	5.16	5.16	1.11	19.33
		19	-	-	-	-	5.67	3.29	1.22	22.72	5.63	3.89	1.22	22.47	5.61	4.49	1.21	22.29	5.72	5.11	1.24	23.18
		20	-	-	-	-	6.71	3.31	1.45	30.27	6.67	3.92	1.44	29.95	6.63	4.51	1.43	29.63	6.59	5.10	1.42	29.29
	5	15	2.41	2.41	0.41	2.64	3.00	3.00	0.52	4.77	3.64	3.64	0.63	7.23	4.27	4.27	0.74	9.50	4.89	4.89	0.84	11.94
		17	2.82	2.26	0.48	4.07	3.19	2.94	0.55	5.53	3.68	3.63	0.63	7.39	4.28	4.28	0.74	9.52	4.89	4.89	0.84	11.97
		19	-	-	-	-	4.83	2.96	0.83	11.66	4.80	3.56	0.83	11.57	4.95	4.20	0.85	12.16	5.22	4.84	0.90	13.33
		20	-	-	-	-	5.93	3.00	1.02	16.59	5.90	3.61	1.02	16.41	5.85	4.20	1.01	16.21	5.89	4.81	1.01	16.41
6	15	2.18	2.18	0.31	1.41	2.77	2.77	0.40	2.38	3.35	3.35	0.48	3.98	3.97	3.97	0.57	5.99	4.60	4.60	0.66	7.88	
	17	2.41	2.06	0.35	1.69	2.85	2.72	0.41	2.57	3.36	3.35	0.48	4.00	3.97	3.97	0.57	6.01	4.61	4.61	0.66	7.90	
	19	-	-	-	-	3.77	2.55	0.54	5.36	3.98	3.22	0.57	6.05	4.34	3.90	0.62	7.12	4.77	4.58	0.68	8.37	
	20	-	-	-	-	5.00	2.64	0.72	9.04	4.96	3.25	0.71	8.91	5.03	3.87	0.72	9.13	5.25	4.52	0.75	9.84	

Continued:

		MDKH2-V700-R4																					
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																				
			21				23				25				27				29				
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	
°C	°C	°C	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	
11	3	15	2.35	2.35	0.67	8.02	2.98	2.98	0.85	12.05	3.60	3.60	1.03	16.63	4.20	4.20	1.20	21.72	4.80	4.80	1.37	27.40	
		17	2.86	2.29	0.81	11.20	3.14	2.96	0.89	13.14	3.60	3.60	1.03	16.65	4.21	4.21	1.20	21.78	4.81	4.81	1.38	27.48	
		19	-	-	-	-	4.84	2.96	1.38	27.75	4.80	3.56	1.37	27.32	4.83	4.17	1.38	27.66	5.02	4.79	1.43	29.47	
		20	-	-	-	-	5.89	2.98	1.69	39.30	5.85	3.58	1.68	38.85	5.81	4.18	1.67	38.41	5.77	4.77	1.65	37.72	
	4	15	2.05	2.05	0.44	3.20	2.68	2.68	0.57	6.13	3.33	3.33	0.71	8.89	3.95	3.95	0.85	11.90	4.55	4.55	0.98	15.19	
		17	2.21	1.99	0.47	3.92	2.71	2.68	0.58	6.26	3.33	3.33	0.71	8.91	3.95	3.95	0.85	11.93	4.56	4.56	0.98	15.23	
		19	-	-	-	-	3.98	2.63	0.85	12.04	4.04	3.26	0.87	12.35	4.28	3.91	0.92	13.65	4.65	4.55	1.00	15.72	
		20	-	-	-	-	5.09	2.67	1.09	18.32	5.05	3.28	1.08	18.11	5.03	3.88	1.08	17.97	5.16	4.50	1.10	18.76	
	5	15	1.83	1.83	0.32	1.41	2.42	2.42	0.42	2.79	3.03	3.03	0.52	4.98	3.67	3.67	0.63	7.23	4.29	4.29	0.74	9.44	
		17	1.90	1.79	0.33	1.50	2.42	2.42	0.42	2.80	3.03	3.03	0.52	5.00	3.67	3.67	0.63	7.24	4.30	4.30	0.74	9.46	
		19	-	-	-	-	3.02	2.27	0.52	4.99	3.38	2.96	0.58	6.25	3.82	3.64	0.66	7.72	4.32	4.30	0.74	9.55	
		20	-	-	-	-	4.15	2.33	0.72	8.90	4.14	2.94	0.71	8.84	4.33	3.59	0.75	9.54	4.64	4.25	0.80	10.74	
	6	15	1.55	1.55	0.22	0.94	2.20	2.20	0.32	1.41	2.78	2.78	0.40	2.50	3.37	3.37	0.48	4.18	3.99	3.99	0.57	6.03	
		17	1.56	1.55	0.22	0.94	2.20	2.20	0.32	1.41	2.78	2.78	0.40	2.51	3.37	3.37	0.48	4.20	4.00	4.00	0.57	6.05	
		19	-	-	-	-	2.51	2.04	0.36	1.91	2.92	2.71	0.42	2.87	3.41	3.36	0.49	4.32	4.00	4.00	0.57	6.06	
		20	-	-	-	-	3.05	1.94	0.44	3.24	3.29	2.60	0.47	3.96	3.67	3.28	0.53	5.09	4.15	3.97	0.59	6.46	
	13	3	15	1.71	1.71	0.49	4.39	2.36	2.36	0.68	8.09	2.99	2.99	0.86	12.09	3.61	3.61	1.04	16.64	4.21	4.21	1.21	21.69
			17	1.72	1.71	0.49	4.44	2.37	2.37	0.68	8.11	3.00	3.00	0.86	12.12	3.61	3.61	1.04	16.68	4.21	4.21	1.21	21.75
			19	-	-	-	-	3.09	2.30	0.88	12.58	3.29	2.95	0.94	14.04	3.67	3.61	1.05	17.11	4.22	4.22	1.21	21.81
			20	-	-	-	-	4.19	2.34	1.21	21.53	4.15	2.94	1.19	21.20	4.21	3.56	1.21	21.68	4.43	4.20	1.27	23.73
		4	15	1.48	1.48	0.32	1.42	2.07	2.07	0.44	3.43	2.70	2.70	0.58	6.15	3.34	3.34	0.72	8.80	3.95	3.95	0.85	11.75
			17	1.48	1.47	0.32	1.42	2.07	2.07	0.45	3.44	2.71	2.71	0.58	6.16	3.34	3.34	0.72	8.83	3.96	3.96	0.85	11.78
			19	-	-	-	-	2.33	1.99	0.50	4.65	2.80	2.68	0.60	6.54	3.35	3.35	0.72	8.85	3.97	3.97	0.85	11.82
			20	-	-	-	-	3.19	1.98	0.68	8.12	3.31	2.63	0.71	8.68	3.63	3.30	0.78	10.14	4.04	3.95	0.87	12.20
5		15	1.19	1.19	0.20	0.82	1.84	1.84	0.32	1.40	2.42	2.42	0.42	2.88	3.04	3.04	0.52	5.05	3.68	3.68	0.63	7.11	
		17	1.19	1.19	0.20	0.83	1.84	1.84	0.32	1.40	2.42	2.42	0.42	2.89	3.04	3.04	0.52	5.07	3.69	3.69	0.63	7.13	
		19	-	-	-	-	1.94	1.78	0.33	1.58	2.44	2.42	0.42	2.93	3.05	3.05	0.52	5.08	3.69	3.69	0.63	7.15	
		20	-	-	-	-	2.26	1.65	0.39	2.41	2.65	2.33	0.45	3.66	3.14	3.02	0.54	5.40	3.71	3.69	0.64	7.18	
6		15	0.88	0.88	0.13	0.50	1.57	1.57	0.22	0.89	2.20	2.20	0.32	1.41	2.78	2.78	0.40	2.58	3.38	3.38	0.48	4.29	
		17	0.88	0.88	0.13	0.50	1.57	1.57	0.22	0.89	2.21	2.21	0.32	1.41	2.78	2.78	0.40	2.59	3.39	3.39	0.48	4.31	
		19	-	-	-	-	1.59	1.55	0.23	0.91	2.21	2.21	0.32	1.41	2.79	2.79	0.40	2.60	3.39	3.39	0.49	4.32	
		20	-	-	-	-	1.78	1.44	0.25	1.01	2.31	2.14	0.33	1.57	2.81	2.77	0.40	2.66	3.39	3.39	0.49	4.32	
15		3	15	1.11	1.11	0.32	1.41	1.71	1.71	0.49	4.43	2.37	2.37	0.68	7.89	2.99	2.99	0.85	11.77	3.61	3.61	1.04	16.40
			17	1.11	1.11	0.32	1.42	1.72	1.72	0.49	4.44	2.37	2.37	0.68	7.91	3.00	3.00	0.86	11.80	3.61	3.61	1.04	16.45
			19	-	-	-	-	1.75	1.71	0.50	4.63	2.37	2.36	0.68	7.91	3.00	3.00	0.86	11.83	3.62	3.62	1.04	16.49
			20	-	-	-	-	2.24	1.66	0.64	7.16	2.57	2.34	0.73	9.08	3.03	3.00	0.86	12.00	3.62	3.62	1.04	16.52
		4	15	0.83	0.83	0.18	0.69	1.48	1.48	0.32	1.43	2.07	2.07	0.44	3.51	2.72	2.72	0.58	6.12	3.35	3.35	0.72	8.72
			17	0.83	0.83	0.18	0.69	1.48	1.48	0.32	1.43	2.07	2.07	0.44	3.53	2.72	2.72	0.58	6.13	3.35	3.35	0.72	8.74
			19	-	-	-	-	1.48	1.48	0.32	1.43	2.08	2.08	0.44	3.54	2.73	2.73	0.58	6.15	3.36	3.36	0.72	8.77
			20	-	-	-	-	1.62	1.40	0.35	1.81	2.11	2.06	0.45	3.68	2.72	2.72	0.58	6.14	3.36	3.36	0.72	8.78
	5	15	0.50	0.50	0.09	0.33	1.21	1.21	0.21	0.80	1.85	1.85	0.32	1.46	2.43	2.43	0.42	3.06	3.07	3.07	0.53	5.17	
		17	0.50	0.50	0.09	0.33	1.21	1.21	0.21	0.80	1.85	1.85	0.32	1.46	2.44	2.44	0.42	3.07	3.07	3.07	0.53	5.18	
		19	-	-	-	-	1.21	1.21	0.21	0.80	1.85	1.85	0.32	1.47	2.44	2.44	0.42	3.08	3.08	3.08	0.53	5.19	
		20	-	-	-	-	1.25	1.18	0.22	0.82	1.86	1.85	0.32	1.48	2.44	2.44	0.42	3.09	3.08	3.08	0.53	5.20	
	6	15	-	-	-	-	0.90	0.90	0.13	0.49	1.59	1.59	0.23	0.86	2.21	2.21	0.32	1.47	2.79	2.79	0.40	2.74	
		17	-	-	-	-	0.90	0.90	0.13	0.49	1.59	1.59	0.23	0.86	2.22	2.22	0.32	1.47	2.79	2.79	0.40	2.75	
		19	-	-	-	-	0.90	0.90	0.13	0.49	1.59	1.59	0.23	0.87	2.22	2.22	0.32	1.47	2.80	2.80	0.40	2.76	
		20	-	-	-	-	0.90	0.90	0.13	0.49	1.59	1.59	0.23	0.86	2.22	2.22	0.32	1.47	2.80	2.80	0.40	2.76	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDKH2-V800-R4																						
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
°C	°C	°C	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
			kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa	kW	kW	m³/h	kPa
5	3	15	6.77	5.04	1.94	78.41	6.73	5.73	1.93	77.73	6.80	6.43	1.95	78.92	7.13	7.13	2.05	85.96	7.81	7.81	2.25	101.32
		17	8.86	5.08	2.57	127.47	8.81	5.77	2.55	126.07	8.75	6.45	2.54	124.68	8.70	7.12	2.52	123.33	8.65	7.78	2.50	121.36
		19	-	-	-	-	11.01	5.79	3.18	184.25	10.94	6.47	3.16	182.30	10.88	7.14	3.14	180.38	10.81	7.81	3.12	178.48
		20	-	-	-	-	12.18	5.80	3.51	219.88	12.11	6.48	3.49	217.57	12.03	7.16	3.47	215.29	11.96	7.83	3.45	213.08
	4	15	6.18	4.76	1.33	40.42	6.21	5.47	1.33	40.78	6.43	6.20	1.38	43.32	6.91	6.90	1.48	49.11	7.59	7.59	1.64	58.31
		17	8.30	4.81	1.78	67.35	8.25	5.50	1.77	66.63	8.20	6.18	1.76	65.93	8.15	6.86	1.75	65.25	8.20	7.55	1.76	66.01
		19	-	-	-	-	10.50	5.55	2.27	102.63	10.44	6.23	2.26	101.52	10.38	6.91	2.25	100.46	10.31	7.58	2.23	99.42
		20	-	-	-	-	11.68	5.56	2.53	123.39	11.61	6.25	2.52	122.55	11.53	6.92	2.49	119.89	11.46	7.59	2.47	118.64
	5	15	5.51	4.44	0.95	22.58	5.71	5.19	0.98	24.03	6.08	5.95	1.04	26.76	6.68	6.68	1.15	31.66	7.36	7.36	1.27	37.42
		17	7.69	4.53	1.33	40.30	7.64	5.22	1.32	39.86	7.59	5.90	1.31	39.41	7.62	6.60	1.31	39.70	7.79	7.31	1.34	40.92
		19	-	-	-	-	9.93	5.28	1.71	62.39	9.86	5.96	1.70	61.47	9.80	6.64	1.68	60.80	9.74	7.31	1.67	60.18
		20	-	-	-	-	11.11	5.30	1.91	75.67	11.05	5.99	1.90	74.90	10.98	6.67	1.89	74.13	10.92	7.34	1.88	73.63
6	15	4.88	4.13	0.70	13.48	5.26	4.92	0.75	15.34	5.75	5.69	0.82	17.78	6.42	6.42	0.92	21.43	7.11	7.11	1.02	25.53	
	17	6.97	4.20	1.00	24.57	6.92	4.89	0.99	24.29	6.94	5.60	0.99	24.39	7.10	6.33	1.02	25.44	7.40	7.07	1.06	27.30	
	19	-	-	-	-	9.30	4.99	1.34	40.59	9.24	5.68	1.33	40.16	9.17	6.35	1.31	39.40	9.11	7.02	1.30	38.96	
	20	-	-	-	-	10.52	5.03	1.51	50.23	10.46	5.72	1.50	49.72	10.39	6.40	1.49	49.21	10.33	7.07	1.48	48.71	
7	3	15	5.21	4.31	1.50	49.25	5.35	5.04	1.54	51.81	5.76	5.75	1.66	58.68	6.45	6.45	1.87	72.23	7.12	7.12	2.07	85.96
		17	7.32	4.35	2.11	88.96	7.27	5.04	2.10	87.90	7.23	5.73	2.09	87.65	7.21	6.41	2.09	87.69	7.34	7.11	2.12	89.52
		19	-	-	-	-	9.50	5.08	2.75	141.17	9.45	5.77	2.75	140.98	9.38	6.44	2.71	137.96	9.32	7.11	2.70	136.48
		20	-	-	-	-	10.69	5.09	3.12	175.73	10.62	5.78	3.10	173.85	10.56	6.46	3.08	172.10	10.49	7.13	3.06	170.20
	4	15	4.65	4.03	1.00	24.50	4.97	4.79	1.07	27.47	5.53	5.53	1.20	33.37	6.22	6.22	1.35	40.87	6.90	6.90	1.49	48.91
		17	6.71	4.08	1.45	46.53	6.67	4.77	1.44	46.00	6.64	5.47	1.44	45.63	6.75	6.17	1.46	46.97	7.03	6.90	1.52	50.44
		19	-	-	-	-	8.93	4.82	1.93	75.88	8.88	5.51	1.92	75.54	8.83	6.19	1.91	74.71	8.77	6.86	1.90	73.87
		20	-	-	-	-	10.13	4.85	2.20	95.39	10.07	5.54	2.19	94.37	10.01	6.22	2.17	93.37	9.95	6.89	2.16	92.38
	5	15	4.11	3.74	0.71	13.57	4.62	4.54	0.80	16.57	5.28	5.28	0.91	20.74	5.98	5.98	1.03	25.68	6.67	6.67	1.15	31.23
		17	5.98	3.76	1.03	25.63	5.94	4.46	1.02	25.35	6.06	5.19	1.05	26.43	6.33	5.93	1.09	28.46	6.73	6.67	1.16	31.73
		19	-	-	-	-	8.30	4.55	1.44	45.42	8.25	5.24	1.43	44.92	8.25	6.12	1.43	71.43	8.16	6.60	1.41	44.10
		20	-	-	-	-	9.50	4.57	1.64	56.97	9.45	5.26	1.63	56.37	9.39	5.95	1.62	55.77	9.33	6.62	1.61	55.17
6	15	3.65	3.46	0.52	7.24	4.27	4.25	0.61	10.39	5.01	5.01	0.72	13.92	5.72	5.72	0.82	17.43	6.43	6.43	0.92	21.26	
	17	5.10	3.39	0.73	14.22	5.22	4.13	0.75	14.82	5.52	4.91	0.79	16.32	5.93	5.68	0.85	18.50	6.45	6.43	0.93	21.40	
	19	-	-	-	-	7.56	4.23	1.08	27.91	7.53	4.93	1.08	27.88	7.49	5.62	1.08	27.63	7.56	6.32	1.08	27.92	
	20	-	-	-	-	8.82	4.28	1.26	36.36	8.76	4.97	1.26	35.97	8.71	5.66	1.25	35.58	8.65	6.33	1.24	35.19	
9	3	15	3.81	3.63	1.10	28.66	4.36	4.35	1.25	35.62	5.06	5.06	1.47	46.77	5.75	5.75	1.65	57.56	6.43	6.43	1.87	70.91
		17	5.65	3.62	1.63	55.83	5.61	4.31	1.61	55.10	5.64	5.02	1.63	55.75	5.89	5.75	1.71	60.77	6.44	6.44	1.87	71.10
		19	-	-	-	-	7.88	4.36	2.29	101.32	7.83	5.05	2.28	100.12	7.77	5.73	2.24	97.46	7.71	6.40	2.23	96.32
		20	-	-	-	-	9.06	4.38	2.64	129.15	9.01	5.07	2.63	128.45	8.95	5.75	2.61	127.01	8.90	6.43	2.59	125.54
	4	15	3.43	3.36	0.74	14.38	4.11	4.11	0.89	19.71	4.83	4.83	1.05	26.04	5.52	5.52	1.19	32.50	6.21	6.21	1.34	39.78
		17	4.94	3.32	1.07	26.99	4.96	4.03	1.07	27.26	5.18	4.77	1.12	29.06	5.58	5.52	1.20	33.06	6.22	6.22	1.34	39.89
		19	-	-	-	-	7.24	4.09	1.57	52.35	7.19	4.78	1.56	51.74	7.14	5.47	1.55	51.12	7.17	6.16	1.55	51.42
		20	-	-	-	-	8.44	4.11	1.82	67.63	8.38	4.81	1.81	66.87	8.33	5.49	1.80	66.13	8.27	6.17	1.79	65.40
	5	15	3.08	3.08	0.53	7.63	3.83	3.83	0.66	11.86	4.57	4.57	0.79	15.96	5.28	5.28	0.91	20.45	5.98	5.98	1.03	25.29
		17	4.06	2.96	0.70	13.04	4.35	3.74	0.75	14.72	4.76	4.52	0.82	17.12	5.30	5.29	0.91	20.57	5.99	5.99	1.03	25.36
		19	-	-	-	-	6.49	3.78	1.12	29.01	6.44	4.48	1.11	28.64	6.47	5.18	1.11	28.87	6.64	5.91	1.14	30.27
		20	-	-	-	-	7.76	3.83	1.34	39.78	7.70	4.53	1.33	39.33	7.65	5.22	1.32	38.89	7.62	5.90	1.32	38.56
6	15	2.82	2.82	0.40	3.75	3.53	3.53	0.51	6.87	4.28	4.28	0.61	10.43	5.02	5.02	0.72	13.69	5.73	5.73	0.82	17.16	
	17	3.30	2.62	0.47	5.79	3.79	3.44	0.54	8.13	4.36	4.26	0.63	10.79	5.02	5.02	0.72	13.72	5.74	5.74	0.82	17.21	
	19	-	-	-	-	5.59	3.43	0.80	16.40	5.63	4.15	0.81	16.59	5.85	4.90	0.84	17.71	6.17	5.66	0.89	19.47	
	20	-	-	-	-	6.93	3.51	0.99	23.68	6.88	4.20	0.99	23.40	6.84	4.89	0.98	23.18	6.95	5.61	1.00	23.78	

Continued:

		MDKH2-V800-R4																				
EWT	ΔT	Indoor temp (W.B.)	Indoor temperature (D.B.)																			
			21				23				25				27				29			
			TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD	TC	SC	WF	WPD
°C	°C	°C	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa	kW	kW	m ³ /h	kPa
11	3	15	2.93	2.93	0.84	17.54	3.65	3.65	1.04	25.61	4.36	4.36	1.25	34.94	5.05	5.05	1.44	44.82	5.74	5.74	1.64	55.90
		17	3.81	2.86	1.09	27.63	3.99	3.61	1.14	29.76	4.39	4.36	1.26	35.41	5.06	5.06	1.45	44.95	5.75	5.75	1.64	56.07
		19	-	-	-	-	6.10	3.62	1.75	62.19	6.06	4.32	1.73	61.42	6.03	5.01	1.73	60.97	6.17	5.72	1.78	64.16
		20	-	-	-	-	7.32	3.65	2.11	86.59	7.27	4.35	2.10	85.55	7.22	5.03	2.08	84.57	7.17	5.71	2.07	83.50
	4	15	2.63	2.63	0.56	8.88	3.39	3.39	0.73	13.78	4.12	4.12	0.88	19.18	4.83	4.83	1.03	25.18	5.52	5.52	1.19	31.88
		17	3.09	2.55	0.66	11.73	3.54	3.36	0.76	14.84	4.12	4.12	0.88	19.23	4.83	4.83	1.04	25.25	5.53	5.53	1.19	31.97
		19	-	-	-	-	5.35	3.33	1.15	30.11	5.33	4.03	1.14	29.86	5.48	4.76	1.18	31.39	5.77	5.50	1.24	34.57
		20	-	-	-	-	6.59	3.37	1.41	43.05	6.55	4.07	1.40	42.53	6.50	4.75	1.39	41.98	6.54	5.45	1.40	42.42
	5	15	2.37	2.37	0.41	3.94	3.10	3.10	0.53	7.88	3.85	3.85	0.66	11.78	4.58	4.58	0.79	15.81	5.29	5.29	0.91	20.21
		17	2.54	2.27	0.44	4.79	3.14	3.08	0.54	8.14	3.86	3.85	0.66	11.80	4.59	4.59	0.79	15.86	5.30	5.30	0.91	20.26
		19	-	-	-	-	4.43	2.99	0.76	14.89	4.64	3.74	0.80	16.09	4.98	4.51	0.86	18.20	5.42	5.28	0.93	21.08
		20	-	-	-	-	5.78	3.06	1.00	23.42	5.73	3.75	0.99	23.08	5.78	4.47	1.00	23.47	5.99	5.21	1.03	24.97
6	15	2.11	2.11	0.30	1.96	2.83	2.83	0.41	3.95	3.55	3.55	0.51	7.05	4.30	4.30	0.61	10.31	5.03	5.03	0.72	13.45	
	17	2.18	2.05	0.31	2.08	2.84	2.83	0.41	3.98	3.55	3.55	0.51	7.08	4.31	4.31	0.62	10.34	5.04	5.04	0.72	13.49	
	19	-	-	-	-	3.49	2.61	0.50	6.83	3.97	3.44	0.57	8.96	4.51	4.25	0.65	11.17	5.09	5.03	0.73	13.72	
	20	-	-	-	-	4.69	2.66	0.67	11.90	4.78	3.40	0.68	12.30	5.08	4.17	0.73	13.67	5.48	4.95	0.79	15.66	
13	3	15	2.19	2.19	0.63	10.68	2.94	2.94	0.84	17.56	3.65	3.65	1.05	25.54	4.35	4.35	1.24	34.14	5.05	5.05	1.45	44.66
		17	2.27	2.17	0.65	11.31	2.94	2.93	0.84	17.56	3.66	3.66	1.05	25.61	4.36	4.36	1.25	34.24	5.05	5.05	1.46	44.79
		19	-	-	-	-	4.11	2.86	1.18	30.92	4.22	3.59	1.21	32.31	4.52	4.34	1.29	36.45	5.06	5.05	1.46	44.83
		20	-	-	-	-	5.37	2.90	1.54	49.06	5.33	3.60	1.53	48.60	5.32	4.30	1.53	48.62	5.47	5.02	1.57	50.76
	4	15	1.90	1.90	0.41	4.10	2.65	2.65	0.57	8.91	3.40	3.40	0.73	13.61	4.12	4.12	0.89	19.11	4.82	4.82	1.04	25.03
		17	1.91	1.90	0.41	4.15	2.65	2.65	0.57	8.93	3.40	3.40	0.73	13.64	4.13	4.13	0.89	19.16	4.83	4.83	1.04	25.10
		19	-	-	-	-	3.29	2.55	0.71	12.89	3.70	3.35	0.80	15.87	4.19	4.12	0.90	19.65	4.84	4.84	1.04	25.16
		20	-	-	-	-	4.51	2.59	0.97	22.24	4.51	3.30	0.97	22.27	4.73	4.05	1.02	24.12	5.07	4.80	1.09	27.23
	5	15	1.63	1.63	0.28	1.71	2.36	2.36	0.41	4.04	3.11	3.11	0.53	7.91	3.86	3.86	0.66	11.54	4.58	4.58	0.79	15.59
		17	1.63	1.62	0.28	1.71	2.36	2.36	0.41	4.05	3.11	3.11	0.53	7.93	3.86	3.86	0.66	11.57	4.59	4.59	0.79	15.64
		19	-	-	-	-	2.62	2.24	0.45	5.34	3.23	3.07	0.55	8.49	3.88	3.87	0.67	11.64	4.60	4.60	0.79	15.68
		20	-	-	-	-	3.37	2.19	0.58	9.16	3.74	2.99	0.64	10.91	4.19	3.79	0.72	13.27	4.71	4.57	0.81	16.30
6	15	1.29	1.29	0.18	1.09	2.11	2.11	0.30	1.93	2.83	2.83	0.40	4.06	3.56	3.56	0.51	7.22	4.32	4.32	0.62	10.30	
	17	1.29	1.29	0.18	1.10	2.11	2.11	0.30	1.94	2.83	2.83	0.41	4.08	3.57	3.57	0.51	7.25	4.33	4.33	0.62	10.32	
	19	-	-	-	-	2.23	2.02	0.32	2.16	2.86	2.81	0.41	4.21	3.57	3.57	0.51	7.26	4.33	4.33	0.62	10.35	
	20	-	-	-	-	2.56	1.88	0.37	3.13	3.11	2.70	0.44	5.24	3.72	3.52	0.53	7.87	4.37	4.32	0.63	10.49	
15	3	15	1.43	1.43	0.41	4.15	2.19	2.19	0.63	10.39	2.93	2.93	0.84	17.29	3.64	3.64	1.04	24.75	4.34	4.34	1.24	33.51
		17	1.43	1.43	0.41	4.17	2.19	2.19	0.63	10.42	2.94	2.94	0.84	17.34	3.65	3.65	1.04	24.82	4.35	4.35	1.24	33.61
		19	-	-	-	-	2.34	2.16	0.67	11.61	2.94	2.94	0.85	17.39	3.65	3.65	1.04	24.90	4.36	4.36	1.25	33.72
		20	-	-	-	-	3.16	2.12	0.91	19.61	3.36	2.87	0.96	21.57	3.76	3.64	1.07	26.15	4.35	4.34	1.24	33.68
	4	15	1.15	1.15	0.25	1.44	1.90	1.90	0.41	4.19	2.66	2.66	0.57	8.84	3.40	3.40	0.73	13.59	4.11	4.11	0.88	18.62
		17	1.15	1.15	0.25	1.44	1.90	1.90	0.41	4.21	2.66	2.66	0.57	8.87	3.41	3.41	0.74	13.63	4.12	4.12	0.88	18.67
		19	-	-	-	-	1.92	1.89	0.41	4.35	2.66	2.66	0.57	8.87	3.42	3.42	0.74	13.67	4.13	4.13	0.89	18.72
		20	-	-	-	-	2.25	1.78	0.48	6.46	2.85	2.62	0.61	10.02	3.44	3.41	0.74	13.86	4.13	4.13	0.89	18.75
	5	15	0.78	0.78	0.13	0.76	1.64	1.64	0.28	1.70	2.37	2.37	0.41	4.29	3.13	3.13	0.54	8.01	3.87	3.87	0.67	11.51
		17	0.78	0.78	0.13	0.76	1.65	1.65	0.28	1.71	2.37	2.37	0.41	4.30	3.13	3.13	0.54	8.03	3.87	3.87	0.67	11.54
		19	-	-	-	-	1.65	1.65	0.28	1.71	2.38	2.38	0.41	4.32	3.14	3.14	0.54	8.06	3.88	3.88	0.67	11.57
		20	-	-	-	-	1.78	1.55	0.31	2.00	2.42	2.35	0.42	4.53	3.14	3.13	0.54	8.06	3.88	3.88	0.67	11.59
6	15	-	-	-	-	1.31	1.31	0.19	1.06	2.12	2.12	0.30	1.98	2.84	2.84	0.41	4.29	3.58	3.58	0.51	7.29	
	17	-	-	-	-	1.31	1.31	0.19	1.06	2.12	2.12	0.30	1.98	2.84	2.84	0.41	4.30	3.58	3.58	0.51	7.31	
	19	-	-	-	-	1.31	1.31	0.19	1.06	2.13	2.13	0.31	1.99	2.84	2.84	0.41	4.32	3.59	3.59	0.51	7.33	
	20	-	-	-	-	1.34	1.27	0.19	1.08	2.13	2.12	0.31	2.01	2.85	2.84	0.41	4.33	3.59	3.59	0.51	7.34	

Abbreviations:

EWT: Enter Water Temp. (°C) Δt: Temperature Difference (°C) DB: Dry Bulb Temp. (°C) WF: Water Flow (m³/h)
 WB: Wet Bulb Temp. (°C) TC: Total Cooling Capacity (kW) SC: Sensible Cooling Capacity (kW) WPD: Water Pressure Drop (kPa)

MDV DC Fan Coil Unit



13.2 Heating capacity table

R3 series

MDKH1-V150-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	1.26	0.14	2.94	1.11	0.12	2.38	0.96	0.10	1.78	0.82	0.09	1.18
	10	1.13	0.10	1.53	0.99	0.09	1.07	0.86	0.07	0.72	0.72	0.06	0.50
	12	1.03	0.07	0.72	0.89	0.06	0.54	0.74	0.05	0.43	0.59	0.04	0.35
	14	0.91	0.06	0.47	0.76	0.05	0.39	0.60	0.04	0.31	0.44	0.03	0.23
	16	0.78	0.04	0.36	0.62	0.03	0.29	0.45	0.02	0.21	0.26	0.01	0.13
45	8	1.63	0.18	4.43	1.48	0.16	3.77	1.34	0.14	3.17	1.19	0.13	2.61
	10	1.52	0.13	2.71	1.37	0.12	2.27	1.22	0.11	1.85	1.07	0.09	1.39
	12	1.40	0.10	1.68	1.25	0.09	1.28	1.10	0.08	0.93	0.97	0.07	0.65
	14	1.28	0.08	0.89	1.14	0.07	0.66	1.00	0.06	0.49	0.85	0.05	0.40
	16	1.18	0.06	0.52	1.03	0.06	0.43	0.87	0.05	0.37	0.72	0.04	0.30
50	8	1.99	0.21	6.09	1.85	0.20	5.35	1.70	0.18	4.65	1.56	0.17	4.00
	10	1.90	0.16	3.85	1.75	0.15	3.35	1.60	0.14	2.89	1.45	0.13	2.45
	12	1.79	0.13	2.55	1.63	0.12	2.20	1.48	0.11	1.87	1.33	0.10	1.53
	14	1.66	0.10	1.74	1.51	0.09	1.43	1.36	0.08	1.11	1.21	0.07	0.83
	16	1.54	0.08	1.08	1.39	0.08	0.83	1.25	0.07	0.62	1.11	0.06	0.47
55	8	2.35	0.25	7.92	2.20	0.24	7.09	2.06	0.22	6.30	1.91	0.21	5.56
	10	2.26	0.20	5.08	2.11	0.18	4.53	1.97	0.17	4.00	1.82	0.16	3.51
	12	2.16	0.16	3.45	2.01	0.14	3.05	1.86	0.13	2.68	1.72	0.12	2.33
	14	2.05	0.13	2.45	1.90	0.12	2.15	1.75	0.11	1.87	1.60	0.10	1.60
	16	1.93	0.10	1.77	1.78	0.10	1.52	1.62	0.09	1.27	1.47	0.08	1.01
60	8	2.71	0.29	9.97	2.56	0.28	9.04	2.41	0.26	8.17	2.27	0.25	7.34
	10	2.62	0.23	6.40	2.47	0.21	5.79	2.33	0.20	5.21	2.18	0.19	4.66
	12	2.53	0.18	4.43	2.38	0.17	3.99	2.23	0.16	3.56	2.09	0.15	3.17
	14	2.43	0.15	3.18	2.28	0.14	2.85	2.13	0.13	2.54	1.98	0.12	2.25
	16	2.33	0.13	2.36	2.17	0.12	2.11	2.02	0.11	1.86	1.87	0.10	1.63

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V250-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	2.12	0.23	3.58	1.88	0.20	2.92	1.63	0.18	2.30	1.39	0.15	1.64
	10	1.93	0.17	2.06	1.69	0.15	1.50	1.46	0.13	1.01	1.23	0.11	0.66
	12	1.76	0.13	1.02	1.53	0.11	0.70	1.29	0.09	0.51	1.04	0.07	0.41
	14	1.59	0.10	0.56	1.33	0.08	0.46	1.07	0.07	0.37	0.80	0.05	0.28
	16	1.38	0.07	0.43	1.11	0.06	0.35	0.83	0.04	0.26	0.51	0.03	0.16
45	8	2.71	0.29	5.31	2.47	0.27	4.54	2.24	0.24	3.82	2.00	0.22	3.16
	10	2.55	0.22	3.29	2.31	0.20	2.78	2.07	0.18	2.30	1.82	0.16	1.84
	12	2.37	0.17	2.15	2.12	0.15	1.73	1.88	0.14	1.30	1.64	0.12	0.91
	14	2.18	0.13	1.26	1.94	0.12	0.93	1.71	0.11	0.66	1.48	0.09	0.48
	16	2.02	0.11	0.71	1.78	0.10	0.54	1.53	0.08	0.43	1.27	0.07	0.36
50	8	3.29	0.36	7.24	3.06	0.33	6.36	2.82	0.30	5.55	2.59	0.28	4.78
	10	3.15	0.27	4.62	2.91	0.25	4.03	2.68	0.23	3.49	2.44	0.21	2.97
	12	3.00	0.22	3.10	2.75	0.20	2.69	2.51	0.18	2.30	2.26	0.16	1.93
	14	2.82	0.17	2.17	2.57	0.16	1.84	2.31	0.14	1.51	2.07	0.13	1.16
	16	2.62	0.14	1.48	2.37	0.13	1.17	2.14	0.12	0.88	1.90	0.10	0.65
55	8	3.87	0.42	9.37	3.63	0.39	8.39	3.40	0.37	7.47	3.16	0.34	6.60
	10	3.74	0.32	6.05	3.50	0.30	5.40	3.26	0.28	4.79	3.03	0.26	4.21
	12	3.60	0.26	4.14	3.36	0.24	3.68	3.12	0.22	3.24	2.88	0.21	2.82
	14	3.44	0.21	2.98	3.20	0.20	2.63	2.95	0.18	2.29	2.71	0.17	1.98
	16	3.27	0.18	2.18	3.02	0.16	1.90	2.77	0.15	1.64	2.51	0.14	1.36
60	8	4.45	0.48	11.69	4.21	0.45	10.61	3.97	0.43	9.64	3.73	0.40	8.66
	10	4.32	0.37	7.58	4.08	0.35	6.86	3.84	0.33	6.19	3.61	0.31	5.54
	12	4.19	0.30	5.28	3.95	0.28	4.77	3.71	0.27	4.28	3.47	0.25	3.81
	14	4.05	0.25	3.82	3.80	0.23	3.44	3.56	0.22	3.07	3.32	0.20	2.73
	16	3.89	0.21	2.86	3.65	0.20	2.56	3.40	0.18	2.27	3.15	0.17	2.00

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V350-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	3.23	0.35	9.79	2.88	0.31	7.99	2.53	0.27	6.40	2.17	0.23	4.94
	10	3.00	0.26	5.89	2.64	0.23	4.73	2.27	0.20	3.67	1.89	0.16	2.60
	12	2.73	0.20	3.72	2.35	0.17	2.80	1.98	0.14	1.84	1.62	0.12	1.08
	14	2.43	0.15	2.07	2.07	0.13	1.35	1.71	0.11	0.85	1.30	0.08	0.60
	16	2.17	0.12	1.07	1.79	0.10	0.75	1.36	0.07	0.57	0.88	0.05	0.38
45	8	4.10	0.44	14.37	3.75	0.40	12.25	3.40	0.37	10.36	3.05	0.33	8.61
	10	3.89	0.34	8.95	3.54	0.31	7.60	3.18	0.27	6.35	2.83	0.24	5.18
	12	3.67	0.26	5.97	3.30	0.24	5.00	2.94	0.21	4.10	2.57	0.18	3.26
	14	3.41	0.21	4.07	3.03	0.19	3.33	2.64	0.16	2.60	2.26	0.14	1.83
	16	3.11	0.17	2.76	2.73	0.15	2.06	2.36	0.13	1.42	2.00	0.11	0.91
50	8	4.96	0.53	19.42	4.61	0.50	17.10	4.26	0.46	14.91	3.91	0.42	12.88
	10	4.77	0.41	12.44	4.42	0.38	10.89	4.06	0.35	9.44	3.71	0.32	8.09
	12	4.56	0.33	8.43	4.20	0.30	7.33	3.85	0.28	6.29	3.48	0.25	5.33
	14	4.34	0.27	5.97	3.97	0.24	5.14	3.61	0.22	4.36	3.24	0.20	3.63
	16	4.09	0.22	4.33	3.72	0.20	3.69	3.34	0.18	3.08	2.95	0.16	2.48
55	8	5.81	0.63	25.12	5.46	0.59	22.63	5.11	0.55	20.15	4.76	0.51	17.83
	10	5.63	0.49	16.19	5.28	0.46	14.46	4.93	0.43	12.88	4.58	0.40	11.34
	12	5.44	0.39	11.16	5.08	0.37	9.93	4.73	0.34	8.76	4.37	0.31	7.67
	14	5.24	0.32	8.07	4.88	0.30	7.14	4.52	0.28	6.27	4.16	0.26	5.44
	16	5.02	0.27	5.99	4.64	0.25	5.25	4.28	0.23	4.56	3.92	0.21	3.92
60	8	6.66	0.72	31.48	6.31	0.68	28.52	5.95	0.64	25.72	5.60	0.60	23.14
	10	6.50	0.56	20.42	6.14	0.53	18.50	5.78	0.50	16.68	5.42	0.47	14.96
	12	6.31	0.45	14.20	5.95	0.43	12.83	5.60	0.40	11.53	5.25	0.38	10.30
	14	6.12	0.38	10.31	5.76	0.35	9.28	5.40	0.33	8.31	5.05	0.31	7.39
	16	5.92	0.32	7.78	5.55	0.30	6.97	5.19	0.28	6.21	4.83	0.26	5.49

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V500-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	4.03	0.44	14.31	3.59	0.39	11.73	3.15	0.34	9.37	2.70	0.29	7.18
	10	3.73	0.32	8.55	3.28	0.28	6.86	2.82	0.24	5.31	2.35	0.20	3.90
	12	3.40	0.24	5.39	2.92	0.21	4.18	2.43	0.18	3.01	1.95	0.14	1.78
	14	3.00	0.18	3.34	2.51	0.15	2.23	2.05	0.13	1.30	1.58	0.10	0.75
	16	2.61	0.14	1.71	2.15	0.12	1.04	1.64	0.09	0.69	1.05	0.06	0.45
45	8	5.12	0.55	21.01	4.68	0.50	17.99	4.25	0.46	15.27	3.81	0.41	12.60
	10	4.84	0.42	13.08	4.41	0.38	11.08	3.96	0.34	9.24	3.52	0.30	7.53
	12	4.56	0.33	8.67	4.11	0.30	7.25	3.65	0.26	5.93	3.19	0.23	4.72
	14	4.23	0.26	5.88	3.76	0.23	4.82	3.29	0.20	3.84	2.80	0.17	2.90
	16	3.87	0.21	4.06	3.37	0.18	3.21	2.87	0.16	2.33	2.40	0.13	1.47
50	8	6.20	0.67	28.70	5.76	0.62	25.38	5.33	0.58	22.12	4.89	0.53	18.98
	10	5.95	0.51	18.27	5.51	0.48	15.98	5.07	0.44	13.83	4.63	0.40	11.83
	12	5.68	0.41	12.31	5.23	0.38	10.69	4.79	0.34	9.17	4.34	0.31	7.75
	14	5.39	0.33	8.67	4.94	0.30	7.46	4.48	0.28	6.32	4.02	0.25	5.26
	16	5.08	0.27	6.26	4.61	0.25	5.32	4.14	0.22	4.43	3.67	0.20	3.62
55	8	7.28	0.79	37.36	6.84	0.74	33.48	6.40	0.69	29.73	5.96	0.64	26.27
	10	7.04	0.61	23.89	6.60	0.57	21.32	6.15	0.53	18.90	5.72	0.49	16.62
	12	6.79	0.49	16.45	6.34	0.46	14.62	5.89	0.42	12.84	5.45	0.39	11.22
	14	6.52	0.40	11.79	6.07	0.37	10.42	5.62	0.35	9.13	5.17	0.32	7.91
	16	6.23	0.34	8.71	5.78	0.31	7.64	5.32	0.29	6.64	4.87	0.26	5.70
60	8	8.36	0.90	46.89	7.91	0.85	42.37	7.47	0.81	38.39	7.03	0.76	34.51
	10	8.13	0.70	30.13	7.68	0.66	27.41	7.24	0.63	24.70	6.80	0.59	22.13
	12	7.88	0.57	20.86	7.44	0.53	18.84	6.99	0.50	16.98	6.55	0.47	15.15
	14	7.63	0.47	15.12	7.18	0.44	13.61	6.73	0.41	12.17	6.29	0.39	10.81
	16	7.36	0.40	11.36	6.91	0.37	10.18	6.46	0.35	9.06	6.01	0.32	8.00

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V700-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	4.43	0.48	8.73	3.92	0.42	7.04	3.40	0.37	5.53	2.88	0.31	4.17
	10	4.00	0.35	5.02	3.47	0.30	3.94	2.93	0.25	2.95	2.38	0.21	1.94
	12	3.51	0.25	2.97	2.96	0.21	2.09	2.46	0.18	1.29	1.98	0.14	0.74
	14	3.02	0.19	1.46	2.55	0.16	0.92	2.04	0.13	0.61	1.48	0.09	0.44
	16	2.62	0.14	0.74	2.09	0.11	0.55	1.51	0.08	0.40	0.88	0.05	0.24
45	8	5.72	0.62	13.14	5.21	0.56	11.19	4.70	0.51	9.38	4.19	0.45	7.71
	10	5.33	0.46	7.97	4.82	0.42	6.70	4.30	0.37	5.52	3.78	0.33	4.43
	12	4.92	0.35	5.13	4.39	0.32	4.23	3.86	0.28	3.39	3.31	0.24	2.62
	14	4.44	0.27	3.34	3.89	0.24	2.66	3.33	0.21	1.96	2.81	0.17	1.29
	16	3.92	0.21	2.08	3.39	0.18	1.47	2.91	0.16	0.97	2.41	0.13	0.62
50	8	6.99	0.75	18.22	6.48	0.70	15.97	5.97	0.64	13.87	5.47	0.59	11.90
	10	6.64	0.57	11.39	6.12	0.53	9.91	5.61	0.48	8.53	5.10	0.44	7.24
	12	6.25	0.45	7.51	5.73	0.41	6.47	5.21	0.37	5.50	4.69	0.34	4.60
	14	5.84	0.36	5.16	5.31	0.33	4.39	4.78	0.29	3.67	4.24	0.26	3.00
	16	5.39	0.29	3.62	4.85	0.26	3.03	4.29	0.23	2.46	3.73	0.20	1.90
55	8	8.26	0.89	23.89	7.75	0.84	21.47	7.24	0.78	19.07	6.74	0.73	16.81
	10	7.92	0.68	15.09	7.40	0.64	13.43	6.89	0.60	11.91	6.38	0.55	10.43
	12	7.55	0.54	10.19	7.04	0.51	9.01	6.53	0.47	7.91	6.01	0.43	6.87
	14	7.17	0.44	7.20	6.65	0.41	6.33	6.14	0.38	5.50	5.61	0.35	4.73
	16	6.77	0.36	5.19	6.24	0.34	4.52	5.71	0.31	3.89	5.18	0.28	3.29
60	8	9.53	1.03	30.19	9.01	0.97	27.32	8.50	0.92	24.66	7.99	0.86	22.13
	10	9.19	0.79	19.29	8.68	0.75	17.44	8.17	0.71	15.69	7.66	0.66	14.02
	12	8.85	0.64	13.18	8.33	0.60	11.87	7.82	0.56	10.63	7.30	0.53	9.45
	14	8.49	0.52	9.39	7.96	0.49	8.42	7.43	0.46	7.50	6.93	0.43	6.63
	16	8.11	0.44	6.94	7.59	0.41	6.19	7.07	0.38	5.48	6.54	0.35	4.80

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V800-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	6.87	0.74	9.23	6.13	0.66	7.56	5.40	0.58	6.08	4.66	0.50	4.72
	10	6.42	0.55	5.61	5.66	0.49	4.53	4.89	0.42	3.54	4.10	0.35	2.61
	12	5.89	0.42	3.60	5.09	0.37	2.79	4.29	0.31	1.93	3.52	0.25	1.14
	14	5.27	0.32	2.15	4.49	0.28	1.42	3.73	0.23	0.87	2.88	0.18	0.57
	16	4.71	0.25	1.12	3.92	0.21	0.73	3.03	0.16	0.54	1.99	0.11	0.36
45	8	8.67	0.93	13.37	7.94	0.86	11.49	7.21	0.78	9.73	6.49	0.70	8.11
	10	8.28	0.71	8.44	7.54	0.65	7.19	6.79	0.59	6.02	6.05	0.52	4.94
	12	7.84	0.56	5.68	7.08	0.51	4.77	6.32	0.45	3.93	5.54	0.40	3.15
	14	7.33	0.45	3.91	6.54	0.40	3.23	5.74	0.35	2.58	4.92	0.30	1.90
	16	6.75	0.36	2.73	5.93	0.32	2.12	5.12	0.28	1.50	4.34	0.23	0.96
50	8	10.45	1.13	18.09	9.72	1.05	15.94	8.99	0.97	13.93	8.27	0.89	12.05
	10	10.10	0.87	11.66	9.36	0.81	10.22	8.62	0.75	8.88	7.89	0.68	7.62
	12	9.70	0.70	7.95	8.95	0.64	6.92	8.20	0.59	5.96	7.46	0.54	5.07
	14	9.26	0.57	5.67	8.50	0.52	4.90	7.74	0.48	4.17	6.97	0.43	3.49
	16	8.78	0.47	4.15	8.00	0.43	3.55	7.21	0.39	2.98	6.40	0.35	2.43
55	8	12.23	1.32	23.33	11.49	1.24	21.02	10.76	1.16	18.74	10.04	1.08	16.59
	10	11.89	1.03	15.11	11.15	0.96	13.51	10.42	0.90	12.05	9.68	0.84	10.62
	12	11.52	0.83	10.47	10.78	0.77	9.33	10.04	0.72	8.25	9.30	0.67	7.23
	14	11.13	0.69	7.61	10.38	0.64	6.75	9.63	0.59	5.93	8.88	0.55	5.16
	16	10.70	0.58	5.68	9.93	0.54	4.99	9.17	0.49	4.35	8.40	0.45	3.75
60	8	14.00	1.51	29.09	13.26	1.43	26.37	12.52	1.35	23.85	11.79	1.27	21.47
	10	13.68	1.18	18.99	12.93	1.12	17.22	12.19	1.05	15.54	11.46	0.99	13.95
	12	13.34	0.96	13.26	12.59	0.91	11.99	11.84	0.85	10.79	11.11	0.80	9.65
	14	12.97	0.80	9.67	12.21	0.75	8.72	11.46	0.71	7.82	10.72	0.66	6.96
	16	12.57	0.68	7.33	11.82	0.64	6.59	11.06	0.60	5.88	10.31	0.56	5.21

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V150-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	1.33	0.14	3.20	1.17	0.13	2.59	1.01	0.11	2.00	0.86	0.09	1.35
	10	1.19	0.10	1.74	1.04	0.09	1.23	0.90	0.08	0.82	0.76	0.07	0.55
	12	1.08	0.08	0.82	0.94	0.07	0.59	0.78	0.06	0.46	0.62	0.04	0.37
	14	0.96	0.06	0.50	0.80	0.05	0.41	0.64	0.04	0.33	0.47	0.03	0.24
	16	0.82	0.04	0.38	0.66	0.04	0.31	0.48	0.03	0.23	0.28	0.02	0.14
45	8	1.71	0.18	4.81	1.56	0.17	4.10	1.41	0.15	3.44	1.25	0.14	2.84
	10	1.60	0.14	2.95	1.44	0.12	2.48	1.29	0.11	2.03	1.13	0.10	1.57
	12	1.47	0.11	1.87	1.31	0.09	1.46	1.16	0.08	1.06	1.01	0.07	0.74
	14	1.34	0.08	1.02	1.20	0.07	0.75	1.05	0.06	0.54	0.90	0.06	0.42
	16	1.24	0.07	0.58	1.08	0.06	0.46	0.92	0.05	0.39	0.76	0.04	0.32
50	8	2.09	0.23	6.60	1.94	0.21	5.80	1.78	0.19	5.04	1.63	0.18	4.34
	10	1.99	0.17	4.18	1.83	0.16	3.64	1.68	0.15	3.14	1.53	0.13	2.67
	12	1.88	0.13	2.78	1.72	0.12	2.40	1.56	0.11	2.04	1.40	0.10	1.69
	14	1.75	0.11	1.91	1.59	0.10	1.60	1.43	0.09	1.27	1.28	0.08	0.95
	16	1.62	0.09	1.23	1.46	0.08	0.95	1.32	0.07	0.71	1.17	0.06	0.52
55	8	2.46	0.27	8.58	2.31	0.25	7.68	2.16	0.23	6.83	2.01	0.22	6.03
	10	2.37	0.20	5.51	2.21	0.19	4.91	2.06	0.18	4.34	1.91	0.17	3.81
	12	2.27	0.16	3.74	2.11	0.15	3.32	1.96	0.14	2.91	1.80	0.13	2.53
	14	2.16	0.13	2.67	2.00	0.12	2.35	1.84	0.11	2.04	1.69	0.10	1.75
	16	2.04	0.11	1.93	1.87	0.10	1.68	1.71	0.09	1.42	1.55	0.08	1.15
60	8	2.83	0.31	10.74	2.68	0.29	9.79	2.53	0.27	8.84	2.38	0.26	7.95
	10	2.74	0.24	6.93	2.59	0.22	6.27	2.44	0.21	5.64	2.28	0.20	5.05
	12	2.65	0.19	4.80	2.50	0.18	4.33	2.34	0.17	3.87	2.19	0.16	3.44
	14	2.55	0.16	3.45	2.39	0.15	3.10	2.24	0.14	2.76	2.08	0.13	2.45
	16	2.44	0.13	2.57	2.28	0.12	2.29	2.13	0.11	2.03	1.97	0.11	1.78

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V250-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
$^{\circ}C$	$^{\circ}C$	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	2.24	0.24	3.93	1.99	0.21	3.21	1.73	0.19	2.54	1.47	0.16	1.87
	10	2.04	0.18	2.31	1.78	0.15	1.73	1.54	0.13	1.17	1.30	0.11	0.75
	12	1.85	0.13	1.17	1.61	0.12	0.81	1.36	0.10	0.56	1.10	0.08	0.43
	14	1.68	0.10	0.62	1.41	0.09	0.49	1.14	0.07	0.39	0.85	0.05	0.30
	16	1.46	0.08	0.45	1.18	0.06	0.37	0.88	0.05	0.28	0.54	0.03	0.18
45	8	2.86	0.31	5.82	2.61	0.28	4.98	2.36	0.25	4.20	2.12	0.23	3.47
	10	2.70	0.23	3.61	2.44	0.21	3.06	2.19	0.19	2.53	1.93	0.17	2.05
	12	2.51	0.18	2.37	2.25	0.16	1.95	1.99	0.14	1.49	1.74	0.12	1.06
	14	2.30	0.14	1.45	2.05	0.13	1.07	1.81	0.11	0.76	1.56	0.10	0.53
	16	2.13	0.11	0.81	1.88	0.10	0.60	1.62	0.09	0.46	1.35	0.07	0.38
50	8	3.47	0.37	7.93	3.22	0.35	6.97	2.98	0.32	6.08	2.73	0.29	5.24
	10	3.33	0.29	5.06	3.08	0.27	4.42	2.83	0.24	3.83	2.57	0.22	3.27
	12	3.16	0.23	3.41	2.91	0.21	2.95	2.65	0.19	2.52	2.39	0.17	2.12
	14	2.98	0.18	2.39	2.72	0.17	2.04	2.45	0.15	1.70	2.19	0.13	1.33
	16	2.78	0.15	1.67	2.51	0.14	1.34	2.25	0.12	1.02	2.01	0.11	0.75
55	8	4.08	0.44	10.26	3.83	0.41	9.19	3.58	0.39	8.18	3.33	0.36	7.23
	10	3.94	0.34	6.63	3.69	0.32	5.92	3.44	0.30	5.25	3.19	0.28	4.61
	12	3.80	0.27	4.54	3.54	0.25	4.03	3.29	0.24	3.55	3.04	0.22	3.10
	14	3.64	0.22	3.27	3.38	0.21	2.88	3.12	0.19	2.52	2.86	0.18	2.18
	16	3.46	0.19	2.40	3.19	0.17	2.10	2.93	0.16	1.81	2.66	0.14	1.53
60	8	4.68	0.50	12.80	4.43	0.48	11.62	4.18	0.45	10.50	3.94	0.43	9.49
	10	4.55	0.39	8.30	4.30	0.37	7.52	4.05	0.35	6.78	3.80	0.33	6.07
	12	4.42	0.32	5.79	4.17	0.30	5.23	3.91	0.28	4.69	3.66	0.26	4.19
	14	4.27	0.26	4.19	4.01	0.25	3.77	3.76	0.23	3.37	3.50	0.22	2.99
	16	4.11	0.22	3.14	3.85	0.21	2.81	3.59	0.19	2.50	3.34	0.18	2.20

Abbreviations:

ΔT : Temperature Difference ($^{\circ}C$) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V350-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	3.32	0.36	10.25	2.96	0.32	8.42	2.60	0.28	6.70	2.23	0.24	5.18
	10	3.08	0.27	6.17	2.71	0.23	4.96	2.33	0.20	3.85	1.94	0.17	2.77
	12	2.81	0.20	3.91	2.42	0.17	2.97	2.03	0.15	1.98	1.67	0.12	1.16
	14	2.50	0.15	2.22	2.13	0.13	1.45	1.76	0.11	0.89	1.34	0.08	0.62
	16	2.23	0.12	1.14	1.84	0.10	0.78	1.41	0.08	0.59	0.91	0.05	0.39
45	8	4.21	0.46	15.04	3.85	0.42	12.82	3.49	0.38	10.84	3.14	0.34	9.01
	10	4.00	0.35	9.37	3.64	0.31	7.96	3.27	0.28	6.65	2.91	0.25	5.43
	12	3.77	0.27	6.25	3.40	0.24	5.24	3.02	0.22	4.30	2.64	0.19	3.42
	14	3.50	0.22	4.27	3.12	0.19	3.50	2.72	0.17	2.75	2.33	0.14	1.96
	16	3.20	0.17	2.92	2.81	0.15	2.21	2.42	0.13	1.52	2.05	0.11	0.97
50	8	5.09	0.55	20.32	4.73	0.51	17.89	4.37	0.47	15.61	4.02	0.43	13.48
	10	4.90	0.42	13.02	4.53	0.39	11.40	4.17	0.36	9.88	3.81	0.33	8.47
	12	4.68	0.34	8.82	4.32	0.31	7.67	3.95	0.28	6.59	3.59	0.26	5.58
	14	4.46	0.27	6.25	4.08	0.25	5.38	3.71	0.23	4.57	3.33	0.21	3.81
	16	4.20	0.23	4.53	3.82	0.21	3.87	3.43	0.19	3.23	3.04	0.16	2.62
55	8	5.96	0.64	26.29	5.60	0.60	23.56	5.24	0.57	21.09	4.89	0.53	18.66
	10	5.78	0.50	16.94	5.42	0.47	15.13	5.06	0.44	13.43	4.70	0.41	11.87
	12	5.59	0.40	11.69	5.22	0.38	10.39	4.86	0.35	9.18	4.49	0.32	8.03
	14	5.38	0.33	8.45	5.01	0.31	7.48	4.64	0.29	6.56	4.27	0.26	5.70
	16	5.15	0.28	6.27	4.78	0.26	5.51	4.40	0.24	4.78	4.03	0.22	4.11
60	8	6.84	0.74	32.95	6.48	0.70	29.85	6.11	0.66	26.92	5.75	0.62	24.22
	10	6.67	0.58	21.37	6.30	0.54	19.37	5.94	0.51	17.46	5.58	0.48	15.66
	12	6.48	0.47	14.86	6.11	0.44	13.43	5.75	0.41	12.07	5.39	0.39	10.78
	14	6.28	0.39	10.79	5.91	0.36	9.72	5.55	0.34	8.70	5.18	0.32	7.74
	16	6.08	0.33	8.14	5.70	0.31	7.30	5.33	0.29	6.51	4.96	0.27	5.75

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V500-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
$^{\circ}C$	$^{\circ}C$	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	4.07	0.44	14.52	3.62	0.39	11.90	3.18	0.34	9.50	2.73	0.29	7.29
	10	3.76	0.32	8.67	3.31	0.29	6.96	2.84	0.25	5.39	2.37	0.20	3.96
	12	3.42	0.25	5.47	2.95	0.21	4.24	2.45	0.18	3.06	1.97	0.14	1.81
	14	3.02	0.19	3.39	2.53	0.16	2.27	2.07	0.13	1.33	1.59	0.10	0.75
	16	2.62	0.14	1.75	2.17	0.12	1.06	1.66	0.09	0.69	1.06	0.06	0.45
45	8	5.16	0.56	21.33	4.72	0.51	18.26	4.28	0.46	15.46	3.84	0.41	12.79
	10	4.89	0.42	13.27	4.44	0.38	11.25	4.00	0.34	9.37	3.55	0.31	7.64
	12	4.60	0.33	8.79	4.14	0.30	7.35	3.68	0.27	6.02	3.22	0.23	4.79
	14	4.27	0.26	5.97	3.80	0.23	4.89	3.31	0.20	3.89	2.82	0.17	2.94
	16	3.90	0.21	4.12	3.40	0.18	3.26	2.90	0.16	2.37	2.42	0.13	1.50
50	8	6.25	0.67	29.15	5.81	0.63	25.77	5.37	0.58	22.46	4.93	0.53	19.26
	10	6.00	0.52	18.55	5.56	0.48	16.22	5.11	0.44	14.04	4.67	0.40	12.01
	12	5.73	0.41	12.49	5.28	0.38	10.84	4.83	0.35	9.30	4.38	0.31	7.86
	14	5.44	0.33	8.80	5.00	0.31	7.56	4.52	0.28	6.41	4.06	0.25	5.34
	16	5.12	0.28	6.35	4.65	0.25	5.39	4.18	0.23	4.49	3.70	0.20	3.67
55	8	7.35	0.79	37.94	6.90	0.74	34.00	6.45	0.70	30.19	6.01	0.65	26.68
	10	7.10	0.61	24.25	6.65	0.57	21.65	6.21	0.54	19.19	5.76	0.50	16.87
	12	6.85	0.49	16.69	6.40	0.46	14.83	5.95	0.43	13.03	5.50	0.40	11.39
	14	6.58	0.41	11.96	6.12	0.38	10.57	5.67	0.35	9.26	5.22	0.32	8.03
	16	6.29	0.34	8.83	5.83	0.31	7.75	5.37	0.29	6.74	4.91	0.26	5.78
60	8	8.43	0.91	47.62	7.98	0.86	43.04	7.54	0.81	38.99	7.09	0.76	35.07
	10	8.20	0.71	30.60	7.75	0.67	27.83	7.30	0.63	25.08	6.86	0.59	22.47
	12	7.95	0.57	21.18	7.50	0.54	19.12	7.05	0.51	17.23	6.61	0.48	15.38
	14	7.69	0.47	15.35	7.24	0.45	13.81	6.79	0.42	12.35	6.34	0.39	10.97
	16	7.43	0.40	11.53	6.97	0.38	10.33	6.51	0.35	9.19	6.06	0.33	8.12

Abbreviations:

ΔT : Temperature Difference ($^{\circ}C$) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V700-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	5.08	0.55	11.04	4.50	0.49	8.97	3.92	0.42	7.04	3.33	0.36	5.33
	10	4.61	0.40	6.39	4.02	0.35	5.05	3.41	0.29	3.83	2.78	0.24	2.70
	12	4.09	0.29	3.87	3.46	0.25	2.90	2.83	0.20	1.88	2.27	0.16	1.04
	14	3.49	0.22	2.11	2.92	0.18	1.32	2.36	0.15	0.77	1.74	0.11	0.51
	16	3.02	0.16	1.01	2.44	0.13	0.66	1.79	0.10	0.48	1.06	0.06	0.29
45	8	6.53	0.70	16.55	5.96	0.64	14.19	5.38	0.58	11.84	4.81	0.52	9.75
	10	6.11	0.53	10.08	5.53	0.48	8.49	4.94	0.43	7.01	4.36	0.38	5.65
	12	5.66	0.41	6.52	5.06	0.36	5.40	4.46	0.32	4.35	3.85	0.28	3.39
	14	5.15	0.32	4.29	4.54	0.28	3.46	3.90	0.24	2.67	3.26	0.20	1.86
	16	4.59	0.25	2.83	3.94	0.21	2.10	3.34	0.18	1.40	2.78	0.15	0.86
50	8	7.97	0.86	23.03	7.39	0.80	20.09	6.82	0.74	17.45	6.25	0.67	14.99
	10	7.58	0.65	14.35	7.00	0.60	12.50	6.42	0.55	10.77	5.84	0.51	9.15
	12	7.15	0.51	9.49	6.57	0.47	8.19	5.98	0.43	6.98	5.40	0.39	5.85
	14	6.71	0.41	6.55	6.11	0.38	5.59	5.51	0.34	4.69	4.91	0.30	3.85
	16	6.22	0.34	4.62	5.62	0.30	3.89	5.00	0.27	3.19	4.36	0.24	2.54
55	8	9.41	1.01	30.01	8.83	0.95	26.85	8.25	0.89	23.85	7.68	0.83	21.14
	10	9.03	0.78	18.98	8.45	0.73	16.90	7.87	0.68	14.94	7.29	0.63	13.12
	12	8.63	0.62	12.84	8.04	0.58	11.37	7.46	0.54	9.98	6.88	0.49	8.68
	14	8.22	0.51	9.10	7.63	0.47	8.00	7.04	0.43	6.97	6.45	0.40	6.00
	16	7.78	0.42	6.61	7.18	0.39	5.76	6.58	0.35	4.95	5.98	0.32	4.20
60	8	10.85	1.17	37.92	10.26	1.11	34.40	9.68	1.04	31.05	9.10	0.98	27.81
	10	10.48	0.90	24.25	9.89	0.85	21.93	9.31	0.80	19.73	8.73	0.75	17.64
	12	10.10	0.73	16.58	9.51	0.68	14.94	8.93	0.64	13.38	8.35	0.60	11.91
	14	9.69	0.60	11.83	9.11	0.56	10.62	8.52	0.52	9.46	7.94	0.49	8.37
	16	9.28	0.50	8.77	8.69	0.47	7.83	8.10	0.44	6.93	7.51	0.41	6.09

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V800-R3													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
$^{\circ}C$	$^{\circ}C$	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	6.91	0.75	9.32	6.14	0.66	7.57	5.36	0.58	6.02	4.59	0.49	4.61
	10	6.35	0.55	5.51	5.55	0.48	4.39	4.75	0.41	3.37	3.91	0.34	2.38
	12	5.71	0.41	3.41	4.87	0.35	2.56	4.05	0.29	1.67	3.30	0.24	0.96
	14	4.98	0.31	1.87	4.22	0.26	1.20	3.45	0.21	0.73	2.59	0.16	0.51
	16	4.40	0.24	0.94	3.58	0.19	0.64	2.68	0.14	0.48	1.67	0.09	0.30
45	8	8.81	0.95	13.77	8.05	0.87	11.77	7.29	0.79	9.92	6.53	0.70	8.21
	10	8.31	0.72	8.52	7.54	0.65	7.21	6.77	0.58	5.99	6.02	0.52	4.86
	12	7.77	0.56	5.60	6.98	0.50	4.67	6.18	0.45	3.80	5.37	0.39	2.99
	14	7.15	0.44	3.76	6.33	0.39	3.05	5.48	0.34	2.37	4.65	0.29	1.66
	16	6.45	0.35	2.51	5.61	0.30	1.87	4.81	0.26	1.27	4.05	0.22	0.80
50	8	10.71	1.15	18.87	9.94	1.07	16.58	9.18	0.99	14.44	8.42	0.91	12.44
	10	10.24	0.89	11.97	9.47	0.82	10.45	8.70	0.75	9.04	7.94	0.69	7.71
	12	9.74	0.70	8.02	8.96	0.64	6.95	8.18	0.59	5.95	7.40	0.53	5.01
	14	9.20	0.57	5.61	8.41	0.52	4.81	7.61	0.47	4.06	6.81	0.42	3.36
	16	8.62	0.47	4.03	7.80	0.42	3.41	6.98	0.38	2.82	6.13	0.33	2.26
55	8	12.60	1.36	24.54	11.82	1.28	22.09	11.07	1.19	19.65	10.30	1.11	17.36
	10	12.14	1.05	15.69	11.37	0.98	13.99	10.61	0.92	12.45	9.84	0.85	10.93
	12	11.68	0.84	10.73	10.90	0.78	9.52	10.12	0.73	8.39	9.35	0.67	7.32
	14	11.18	0.69	7.69	10.40	0.64	6.78	9.62	0.59	5.93	8.84	0.55	5.13
	16	10.66	0.58	5.65	9.86	0.53	4.93	9.06	0.49	4.27	8.26	0.45	3.65
60	8	14.47	1.56	30.83	13.69	1.47	27.92	12.92	1.39	25.22	12.15	1.31	22.67
	10	14.04	1.21	19.90	13.27	1.15	18.02	12.49	1.08	16.23	11.73	1.01	14.53
	12	13.60	0.98	13.74	12.82	0.92	12.40	12.04	0.87	11.13	11.27	0.81	9.92
	14	13.13	0.81	9.90	12.34	0.76	8.90	11.56	0.71	7.95	10.78	0.66	7.05
	16	12.64	0.68	7.41	11.84	0.64	6.63	11.06	0.60	5.89	10.28	0.55	5.19

Abbreviations:

Δt : Temperature Difference ($^{\circ}C$) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

R4 series

MDKH1-V150-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	1.83	0.20	7.35	1.65	0.18	6.16	1.47	0.16	5.06	1.29	0.14	4.05
	10	1.77	0.15	4.76	1.58	0.14	3.94	1.39	0.12	3.17	1.20	0.10	2.34
	12	1.68	0.12	3.23	1.49	0.11	2.52	1.29	0.09	1.77	1.09	0.08	1.13
	14	1.58	0.10	1.97	1.38	0.09	1.37	1.18	0.07	0.91	0.95	0.06	0.66
	16	1.47	0.08	1.13	1.26	0.07	0.81	1.02	0.06	0.63	0.74	0.04	0.47
45	8	2.26	0.24	10.29	2.08	0.22	8.92	1.90	0.21	7.66	1.72	0.19	6.48
	10	2.21	0.19	6.77	2.02	0.17	5.85	1.84	0.16	4.98	1.66	0.14	4.18
	12	2.15	0.15	4.76	1.96	0.14	4.08	1.77	0.13	3.44	1.58	0.11	2.84
	14	2.07	0.13	3.45	1.87	0.12	2.91	1.68	0.10	2.35	1.48	0.09	1.75
	16	1.97	0.11	2.49	1.77	0.10	1.96	1.57	0.08	1.43	1.37	0.07	0.98
50	8	2.68	0.29	13.53	2.50	0.27	12.00	2.33	0.25	10.56	2.15	0.23	9.22
	10	2.64	0.23	9.02	2.46	0.21	7.98	2.28	0.20	7.00	2.10	0.18	6.08
	12	2.59	0.19	6.37	2.40	0.17	5.62	2.22	0.16	4.91	2.04	0.15	4.24
	14	2.53	0.16	4.72	2.34	0.14	4.14	2.15	0.13	3.59	1.96	0.12	3.08
	16	2.45	0.13	3.61	2.26	0.12	3.14	2.06	0.11	2.69	1.87	0.10	2.24
55	8	3.11	0.34	17.17	2.93	0.32	15.47	2.75	0.30	13.79	2.57	0.28	12.28
	10	3.07	0.27	11.43	2.89	0.25	10.28	2.70	0.23	9.20	2.52	0.22	8.17
	12	3.02	0.22	8.13	2.84	0.20	7.30	2.66	0.19	6.51	2.47	0.18	5.77
	14	2.97	0.18	6.10	2.78	0.17	5.46	2.60	0.16	4.85	2.41	0.15	4.28
	16	2.91	0.16	4.69	2.72	0.15	4.18	2.53	0.14	3.70	2.34	0.13	3.25
60	8	3.53	0.38	20.92	3.34	0.36	19.06	3.16	0.34	17.38	2.98	0.32	15.70
	10	3.49	0.30	14.03	3.31	0.29	12.72	3.13	0.27	11.54	2.95	0.25	10.41
	12	3.45	0.25	10.05	3.27	0.24	9.14	3.08	0.22	8.27	2.90	0.21	7.45
	14	3.41	0.21	7.53	3.22	0.20	6.83	3.03	0.19	6.17	2.85	0.18	5.55
	16	3.35	0.18	5.86	3.17	0.17	5.31	2.98	0.16	4.78	2.79	0.15	4.29

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V250-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
$^{\circ}C$	$^{\circ}C$	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	2.35	0.25	5.69	2.10	0.23	4.69	1.84	0.20	3.77	1.58	0.17	2.90
	10	2.19	0.19	3.48	1.93	0.17	2.74	1.67	0.14	1.95	1.42	0.12	1.25
	12	2.01	0.14	1.96	1.76	0.13	1.36	1.51	0.11	0.91	1.24	0.09	0.65
	14	1.85	0.11	1.02	1.58	0.10	0.75	1.30	0.08	0.60	1.00	0.06	0.47
	16	1.65	0.09	0.68	1.36	0.07	0.57	1.05	0.06	0.44	0.69	0.04	0.30
45	8	2.97	0.32	8.26	2.72	0.29	7.10	2.47	0.27	6.02	2.22	0.24	5.02
	10	2.83	0.24	5.24	2.58	0.22	4.46	2.32	0.20	3.73	2.06	0.18	3.06
	12	2.68	0.19	3.53	2.42	0.17	2.96	2.15	0.15	2.38	1.89	0.14	1.76
	14	2.50	0.15	2.33	2.23	0.14	1.79	1.97	0.12	1.29	1.72	0.11	0.89
	16	2.32	0.13	1.38	2.07	0.11	1.01	1.80	0.10	0.74	1.53	0.08	0.57
50	8	3.58	0.39	11.13	3.33	0.36	9.81	3.08	0.33	8.58	2.83	0.31	7.42
	10	3.46	0.30	7.21	3.21	0.28	6.32	2.95	0.26	5.49	2.70	0.23	4.72
	12	3.32	0.24	4.93	3.06	0.22	4.30	2.81	0.20	3.70	2.55	0.18	3.14
	14	3.17	0.20	3.52	2.91	0.18	3.04	2.64	0.16	2.58	2.37	0.15	2.12
	16	3.00	0.16	2.57	2.73	0.15	2.14	2.46	0.13	1.69	2.19	0.12	1.27
55	8	4.19	0.45	14.35	3.93	0.42	12.82	3.68	0.40	11.43	3.43	0.37	10.13
	10	4.07	0.35	9.34	3.82	0.33	8.35	3.57	0.31	7.42	3.31	0.29	6.55
	12	3.95	0.28	6.47	3.69	0.27	5.77	3.44	0.25	5.10	3.18	0.23	4.48
	14	3.82	0.24	4.72	3.56	0.22	4.19	3.30	0.20	3.68	3.04	0.19	3.20
	16	3.67	0.20	3.52	3.40	0.18	3.10	3.14	0.17	2.70	2.87	0.15	2.32
60	8	4.79	0.52	17.80	4.53	0.49	16.17	4.28	0.46	14.63	4.03	0.43	13.11
	10	4.68	0.40	11.60	4.42	0.38	10.52	4.17	0.36	9.50	3.92	0.34	8.53
	12	4.57	0.33	8.17	4.31	0.31	7.39	4.05	0.29	6.65	3.81	0.27	5.95
	14	4.45	0.27	5.98	4.19	0.26	5.40	3.93	0.24	4.84	3.67	0.23	4.31
	16	4.31	0.23	4.55	4.05	0.22	4.09	3.79	0.20	3.65	3.53	0.19	3.23

Abbreviations:

ΔT : Temperature Difference ($^{\circ}C$) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V350-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	3.40	0.37	6.50	3.03	0.33	5.34	2.66	0.29	4.27	2.26	0.25	3.30
	10	3.16	0.27	3.94	2.77	0.24	3.14	2.38	0.21	2.29	2.01	0.17	1.47
	12	2.87	0.21	2.30	2.50	0.18	1.60	2.13	0.15	1.04	1.75	0.13	0.70
	14	2.61	0.16	1.17	2.24	0.14	0.82	1.83	0.11	0.63	1.39	0.09	0.48
	16	2.33	0.13	0.73	1.91	0.10	0.59	1.46	0.08	0.46	0.95	0.05	0.30
45	8	4.32	0.47	9.51	3.95	0.43	8.16	3.58	0.39	6.90	3.21	0.35	5.74
	10	4.10	0.35	5.98	3.73	0.32	5.08	3.35	0.29	4.24	2.97	0.26	3.46
	12	3.86	0.28	3.99	3.48	0.25	3.34	3.09	0.22	2.72	2.69	0.19	2.06
	14	3.58	0.22	2.68	3.18	0.20	2.09	2.80	0.17	1.51	2.43	0.15	1.03
	16	3.30	0.18	1.62	2.92	0.16	1.17	2.55	0.14	0.82	2.15	0.12	0.61
50	8	5.21	0.56	12.87	4.85	0.52	11.34	4.48	0.48	9.90	4.11	0.44	8.55
	10	5.02	0.43	8.28	4.65	0.40	7.26	4.28	0.37	6.29	3.91	0.34	5.39
	12	4.81	0.35	5.63	4.43	0.32	4.90	4.05	0.29	4.21	3.68	0.26	3.56
	14	4.57	0.28	4.00	4.19	0.26	3.44	3.80	0.23	2.92	3.40	0.21	2.41
	16	4.31	0.23	2.90	3.91	0.21	2.44	3.51	0.19	1.97	3.12	0.17	1.48
55	8	6.11	0.66	16.67	5.74	0.62	14.95	5.37	0.58	13.26	5.00	0.54	11.73
	10	5.93	0.51	10.78	5.56	0.48	9.64	5.19	0.45	8.56	4.82	0.42	7.54
	12	5.73	0.41	7.44	5.36	0.39	6.62	4.98	0.36	5.84	4.61	0.33	5.12
	14	5.53	0.34	5.40	5.14	0.32	4.78	4.76	0.29	4.19	4.38	0.27	3.64
	16	5.29	0.29	4.00	4.90	0.26	3.52	4.51	0.24	3.06	4.12	0.22	2.62
60	8	7.00	0.75	20.64	6.62	0.71	18.75	6.25	0.68	17.04	5.89	0.64	15.33
	10	6.83	0.59	13.45	6.45	0.56	12.19	6.08	0.52	11.00	5.71	0.49	9.87
	12	6.65	0.48	9.43	6.27	0.45	8.52	5.90	0.42	7.66	5.52	0.40	6.85
	14	6.45	0.40	6.87	6.07	0.37	6.19	5.69	0.35	5.54	5.32	0.33	4.93
	16	6.24	0.34	5.20	5.86	0.32	4.66	5.48	0.30	4.16	5.10	0.28	3.68

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V500-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
$^{\circ}C$	$^{\circ}C$	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	4.48	0.48	10.45	4.00	0.43	8.60	3.51	0.38	6.85	3.02	0.33	5.31
	10	4.17	0.36	6.32	3.67	0.32	5.09	3.16	0.27	3.95	2.64	0.23	2.87
	12	3.81	0.27	4.02	3.28	0.24	3.08	2.76	0.20	2.07	2.26	0.16	1.22
	14	3.39	0.21	2.32	2.89	0.18	1.52	2.39	0.15	0.93	1.83	0.11	0.63
	16	3.03	0.16	1.19	2.50	0.14	0.81	1.92	0.10	0.60	1.25	0.07	0.40
45	8	5.67	0.61	15.30	5.19	0.56	13.06	4.71	0.51	11.05	4.23	0.46	9.19
	10	5.40	0.47	9.56	4.91	0.42	8.13	4.42	0.38	6.79	3.93	0.34	5.56
	12	5.09	0.37	6.40	4.59	0.33	5.37	4.09	0.29	4.41	3.58	0.26	3.52
	14	4.75	0.29	4.38	4.23	0.26	3.60	3.69	0.23	2.85	3.16	0.19	2.05
	16	4.35	0.23	3.02	3.81	0.21	2.30	3.29	0.18	1.60	2.79	0.15	1.02
50	8	6.85	0.74	20.75	6.36	0.69	18.18	5.89	0.63	15.87	5.41	0.58	13.71
	10	6.60	0.57	13.26	6.11	0.53	11.61	5.63	0.49	10.07	5.14	0.44	8.63
	12	6.32	0.45	9.00	5.83	0.42	7.83	5.34	0.38	6.74	4.85	0.35	5.71
	14	6.02	0.37	6.39	5.52	0.34	5.51	5.02	0.31	4.68	4.51	0.28	3.91
	16	5.69	0.31	4.65	5.18	0.28	3.97	4.66	0.25	3.32	4.12	0.22	2.70
55	8	8.02	0.86	26.67	7.53	0.81	23.91	7.05	0.76	21.41	6.57	0.71	18.95
	10	7.78	0.67	17.22	7.29	0.63	15.39	6.81	0.59	13.66	6.33	0.55	12.08
	12	7.53	0.54	11.90	7.04	0.51	10.59	6.55	0.47	9.35	6.06	0.44	8.19
	14	7.26	0.45	8.62	6.76	0.42	7.64	6.27	0.39	6.70	5.77	0.36	5.82
	16	6.96	0.38	6.41	6.46	0.35	5.64	5.95	0.32	4.90	5.45	0.29	4.21
60	8	9.19	0.99	33.41	8.70	0.94	30.26	8.21	0.88	27.30	7.73	0.83	24.56
	10	8.97	0.77	21.70	8.47	0.73	19.67	7.99	0.69	17.74	7.50	0.65	15.91
	12	8.73	0.63	15.11	8.23	0.59	13.66	7.74	0.56	12.28	7.26	0.52	10.98
	14	8.47	0.52	10.99	7.97	0.49	9.90	7.48	0.46	8.87	6.99	0.43	7.89
	16	8.20	0.44	8.31	7.70	0.42	7.45	7.20	0.39	6.65	6.70	0.36	5.88

Abbreviations:

ΔT : Temperature Difference ($^{\circ}C$) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V700-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	5.25	0.57	5.15	4.64	0.50	4.18	4.03	0.44	3.29	3.41	0.37	2.48
	10	4.75	0.41	2.99	4.11	0.36	2.33	3.49	0.30	1.63	2.91	0.25	1.01
	12	4.20	0.30	1.63	3.61	0.26	1.09	3.05	0.22	0.70	2.44	0.18	0.48
	14	3.75	0.23	0.79	3.15	0.19	0.56	2.51	0.15	0.44	1.83	0.11	0.32
	16	3.24	0.17	0.50	2.58	0.14	0.40	1.89	0.10	0.30	1.12	0.06	0.18
45	8	6.75	0.73	7.73	6.16	0.66	6.59	5.56	0.60	5.54	4.97	0.54	4.56
	10	6.32	0.55	4.74	5.71	0.49	3.99	5.10	0.44	3.29	4.49	0.39	2.64
	12	5.84	0.42	3.06	5.21	0.38	2.53	4.57	0.33	2.01	3.94	0.28	1.46
	14	5.28	0.33	1.96	4.65	0.29	1.48	4.05	0.25	1.03	3.49	0.21	0.69
	16	4.77	0.26	1.11	4.20	0.23	0.78	3.61	0.20	0.55	2.98	0.16	0.42
50	8	8.24	0.89	10.64	7.64	0.82	9.34	7.04	0.76	8.12	6.45	0.70	6.98
	10	7.85	0.68	6.71	7.24	0.63	5.85	6.64	0.57	5.04	6.04	0.52	4.29
	12	7.41	0.53	4.46	6.80	0.49	3.85	6.19	0.44	3.28	5.57	0.40	2.75
	14	6.94	0.43	3.09	6.31	0.39	2.63	5.68	0.35	2.20	5.03	0.31	1.78
	16	6.42	0.35	2.17	5.76	0.31	1.79	5.12	0.28	1.39	4.51	0.24	1.01
55	8	9.71	1.05	13.88	9.11	0.98	12.42	8.51	0.92	11.04	7.92	0.85	9.74
	10	9.34	0.81	8.88	8.74	0.76	7.91	8.14	0.70	6.99	7.54	0.65	6.13
	12	8.94	0.64	6.01	8.33	0.60	5.33	7.73	0.56	4.68	7.12	0.51	4.07
	14	8.52	0.53	4.28	7.91	0.49	3.77	7.29	0.45	3.28	6.67	0.41	2.82
	16	8.06	0.43	3.11	7.43	0.40	2.71	6.80	0.37	2.33	6.16	0.33	1.97
60	8	11.19	1.21	17.50	10.58	1.14	15.88	9.97	1.07	14.26	9.38	1.01	12.81
	10	10.82	0.93	11.19	10.22	0.88	10.13	9.62	0.83	9.11	9.01	0.78	8.15
	12	10.46	0.75	7.73	9.84	0.71	6.97	9.24	0.67	6.25	8.64	0.62	5.56
	14	10.06	0.62	5.55	9.44	0.58	4.98	8.83	0.54	4.44	8.22	0.51	3.93
	16	9.64	0.52	4.13	9.02	0.49	3.69	8.40	0.45	3.27	7.78	0.42	2.86

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH1-V800-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	6.79	0.73	12.06	6.07	0.66	9.93	5.34	0.58	7.94	4.60	0.50	6.18
	10	6.35	0.55	7.34	5.60	0.48	5.93	4.84	0.42	4.64	4.06	0.35	3.42
	12	5.84	0.42	4.72	5.05	0.36	3.66	4.26	0.31	2.53	3.51	0.25	1.50
	14	5.24	0.32	2.84	4.47	0.28	1.87	3.71	0.23	1.15	2.88	0.18	0.75
	16	4.69	0.25	1.47	3.91	0.21	0.97	3.03	0.16	0.71	2.01	0.11	0.48
45	8	8.57	0.92	17.46	7.85	0.85	15.08	7.13	0.77	12.71	6.41	0.69	10.59
	10	8.18	0.71	11.03	7.45	0.64	9.39	6.71	0.58	7.87	5.98	0.52	6.46
	12	7.75	0.56	7.42	7.00	0.50	6.24	6.25	0.45	5.15	5.48	0.40	4.13
	14	7.26	0.45	5.12	6.48	0.40	4.23	5.68	0.35	3.38	4.88	0.30	2.49
	16	6.69	0.36	3.58	5.88	0.32	2.78	5.09	0.27	1.96	4.32	0.23	1.27
50	8	10.33	1.12	23.73	9.60	1.04	20.91	8.88	0.96	18.18	8.17	0.88	15.72
	10	9.97	0.86	15.22	9.24	0.80	13.34	8.52	0.74	11.59	7.79	0.67	9.95
	12	9.58	0.69	10.38	8.84	0.64	9.05	8.11	0.58	7.79	7.37	0.53	6.62
	14	9.16	0.56	7.41	8.40	0.52	6.40	7.65	0.47	5.46	6.89	0.42	4.57
	16	8.68	0.47	5.42	7.91	0.43	4.63	7.14	0.39	3.90	6.34	0.34	3.19
55	8	12.08	1.30	30.44	11.35	1.22	27.29	10.63	1.15	24.33	9.91	1.07	21.65
	10	11.74	1.01	19.72	11.01	0.95	17.62	10.28	0.89	15.65	9.56	0.82	13.80
	12	11.38	0.82	13.67	10.65	0.77	12.17	9.91	0.71	10.76	9.18	0.66	9.44
	14	11.00	0.68	9.94	10.26	0.63	8.81	9.51	0.59	7.75	8.77	0.54	6.74
	16	10.58	0.57	7.43	9.82	0.53	6.54	9.07	0.49	5.71	8.31	0.45	4.91
60	8	13.83	1.49	37.95	13.09	1.41	34.48	12.36	1.33	31.18	11.64	1.25	27.99
	10	13.51	1.17	24.78	12.78	1.10	22.47	12.04	1.04	20.27	11.32	0.98	18.19
	12	13.17	0.95	17.31	12.43	0.89	15.65	11.70	0.84	14.08	10.97	0.79	12.60
	14	12.81	0.79	12.63	12.06	0.74	11.39	11.32	0.70	10.21	10.59	0.65	9.09
	16	12.43	0.67	9.58	11.67	0.63	8.60	10.93	0.59	7.68	10.18	0.55	6.80

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V150-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	1.90	0.20	7.81	1.71	0.18	6.55	1.52	0.16	5.38	1.33	0.14	4.30
	10	1.83	0.16	5.05	1.64	0.14	4.18	1.44	0.12	3.37	1.24	0.11	2.53
	12	1.74	0.13	3.44	1.54	0.11	2.72	1.33	0.10	1.93	1.13	0.08	1.22
	14	1.63	0.10	2.14	1.43	0.09	1.49	1.22	0.07	0.98	0.99	0.06	0.68
	16	1.52	0.08	1.22	1.30	0.07	0.86	1.06	0.06	0.66	0.77	0.04	0.49
45	8	2.34	0.25	10.94	2.16	0.23	9.49	1.97	0.21	8.14	1.79	0.19	6.88
	10	2.29	0.20	7.20	2.10	0.18	6.21	1.91	0.16	5.29	1.72	0.15	4.43
	12	2.22	0.16	5.06	2.03	0.15	4.33	1.83	0.13	3.65	1.64	0.12	3.02
	14	2.14	0.13	3.66	1.94	0.12	3.10	1.73	0.11	2.52	1.53	0.09	1.90
	16	2.04	0.11	2.67	1.83	0.10	2.12	1.62	0.09	1.56	1.41	0.08	1.06
50	8	2.78	0.30	14.41	2.60	0.28	12.78	2.41	0.26	11.24	2.23	0.24	9.81
	10	2.74	0.24	9.59	2.55	0.22	8.48	2.36	0.20	7.44	2.17	0.19	6.47
	12	2.68	0.19	6.77	2.49	0.18	5.97	2.30	0.17	5.21	2.11	0.15	4.50
	14	2.62	0.16	5.01	2.42	0.15	4.40	2.23	0.14	3.81	2.03	0.13	3.26
	16	2.54	0.14	3.83	2.34	0.13	3.33	2.14	0.12	2.86	1.93	0.10	2.39
55	8	3.22	0.35	18.30	3.04	0.33	16.48	2.85	0.31	14.76	2.66	0.29	13.08
	10	3.18	0.27	12.17	2.99	0.26	10.95	2.80	0.24	9.79	2.62	0.23	8.70
	12	3.13	0.23	8.65	2.94	0.21	7.76	2.75	0.20	6.92	2.56	0.18	6.13
	14	3.08	0.19	6.48	2.88	0.18	5.80	2.69	0.17	5.15	2.50	0.15	4.55
	16	3.01	0.16	4.98	2.82	0.15	4.44	2.62	0.14	3.93	2.42	0.13	3.44
60	8	3.66	0.39	22.30	3.47	0.37	20.31	3.28	0.35	18.43	3.09	0.33	16.73
	10	3.61	0.31	14.95	3.43	0.30	13.60	3.24	0.28	12.28	3.05	0.26	11.08
	12	3.58	0.26	10.70	3.39	0.24	9.72	3.20	0.23	8.80	3.01	0.22	7.93
	14	3.53	0.22	8.01	3.34	0.21	7.27	3.14	0.19	6.56	2.95	0.18	5.90
	16	3.47	0.19	6.23	3.28	0.18	5.64	3.09	0.17	5.08	2.89	0.16	4.55

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V250-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	2.59	0.28	6.74	2.31	0.25	5.55	2.04	0.22	4.46	1.75	0.19	3.46
	10	2.42	0.21	4.12	2.13	0.18	3.31	1.83	0.16	2.46	1.55	0.13	1.60
	12	2.21	0.16	2.48	1.93	0.14	1.74	1.65	0.12	1.14	1.36	0.10	0.74
	14	2.02	0.12	1.27	1.73	0.11	0.88	1.43	0.09	0.66	1.10	0.07	0.51
	16	1.81	0.10	0.77	1.49	0.08	0.62	1.15	0.06	0.48	0.76	0.04	0.32
45	8	3.28	0.35	9.79	3.00	0.32	8.41	2.72	0.29	7.13	2.45	0.26	5.95
	10	3.13	0.27	6.20	2.85	0.25	5.27	2.56	0.22	4.42	2.28	0.20	3.62
	12	2.96	0.21	4.17	2.67	0.19	3.50	2.37	0.17	2.87	2.08	0.15	2.21
	14	2.76	0.17	2.84	2.46	0.15	2.25	2.16	0.13	1.65	1.88	0.12	1.13
	16	2.55	0.14	1.76	2.26	0.12	1.28	1.97	0.11	0.90	1.67	0.09	0.65
50	8	3.95	0.43	13.21	3.67	0.40	11.64	3.40	0.37	10.17	3.12	0.34	8.80
	10	3.82	0.33	8.54	3.54	0.31	7.49	3.26	0.28	6.50	2.98	0.26	5.59
	12	3.67	0.26	5.83	3.38	0.24	5.08	3.10	0.22	4.38	2.80	0.20	3.72
	14	3.50	0.22	4.17	3.21	0.20	3.60	2.92	0.18	3.06	2.62	0.16	2.55
	16	3.31	0.18	3.05	3.01	0.16	2.59	2.71	0.15	2.11	2.41	0.13	1.61
55	8	4.62	0.50	17.06	4.34	0.47	15.31	4.06	0.44	13.58	3.79	0.41	12.03
	10	4.50	0.39	11.08	4.22	0.36	9.91	3.94	0.34	8.80	3.66	0.32	7.76
	12	4.36	0.31	7.67	4.07	0.29	6.83	3.79	0.27	6.04	3.51	0.25	5.30
	14	4.21	0.26	5.59	3.92	0.24	4.95	3.64	0.22	4.35	3.35	0.21	3.79
	16	4.04	0.22	4.17	3.75	0.20	3.67	3.46	0.19	3.20	3.17	0.17	2.75
60	8	5.29	0.57	21.08	5.01	0.54	19.15	4.73	0.51	17.41	4.45	0.48	15.67
	10	5.17	0.45	13.84	4.89	0.42	12.50	4.61	0.40	11.28	4.33	0.37	10.13
	12	5.04	0.36	9.69	4.76	0.34	8.77	4.48	0.32	7.89	4.20	0.30	7.06
	14	4.91	0.30	7.09	4.62	0.28	6.39	4.33	0.27	5.73	4.05	0.25	5.10
	16	4.76	0.26	5.38	4.47	0.24	4.84	4.18	0.23	4.32	3.89	0.21	3.82

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V350-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	3.55	0.38	6.99	3.17	0.34	5.75	2.78	0.30	4.61	2.39	0.26	3.57
	10	3.30	0.29	4.25	2.90	0.25	3.42	2.50	0.22	2.56	2.11	0.18	1.67
	12	3.01	0.22	2.58	2.62	0.19	1.81	2.23	0.16	1.18	1.84	0.13	0.75
	14	2.74	0.17	1.32	2.35	0.14	0.90	1.93	0.12	0.67	1.48	0.09	0.51
	16	2.46	0.13	0.78	2.02	0.11	0.62	1.55	0.08	0.48	1.01	0.05	0.32
45	8	4.50	0.48	10.19	4.11	0.44	8.75	3.73	0.40	7.41	3.35	0.36	6.17
	10	4.28	0.37	6.43	3.89	0.34	5.47	3.50	0.30	4.57	3.11	0.27	3.74
	12	4.04	0.29	4.31	3.64	0.26	3.61	3.24	0.23	2.96	2.83	0.20	2.29
	14	3.76	0.23	2.93	3.34	0.21	2.33	2.94	0.18	1.71	2.55	0.16	1.17
	16	3.46	0.19	1.83	3.06	0.17	1.33	2.67	0.14	0.92	2.27	0.12	0.66
50	8	5.42	0.58	13.78	5.04	0.54	12.14	4.66	0.50	10.60	4.28	0.46	9.17
	10	5.23	0.45	8.88	4.85	0.42	7.79	4.46	0.39	6.76	4.08	0.35	5.80
	12	5.02	0.36	6.05	4.63	0.33	5.27	4.24	0.30	4.53	3.84	0.28	3.85
	14	4.78	0.29	4.31	4.38	0.27	3.72	3.98	0.25	3.16	3.57	0.22	2.63
	16	4.52	0.24	3.15	4.10	0.22	2.67	3.68	0.20	2.18	3.27	0.18	1.67
55	8	6.35	0.69	17.83	5.97	0.64	15.99	5.58	0.60	14.18	5.20	0.56	12.56
	10	6.17	0.53	11.55	5.78	0.50	10.33	5.40	0.47	9.17	5.02	0.43	8.08
	12	5.97	0.43	7.98	5.58	0.40	7.10	5.20	0.37	6.28	4.81	0.35	5.50
	14	5.76	0.36	5.80	5.37	0.33	5.14	4.98	0.31	4.51	4.58	0.28	3.92
	16	5.53	0.30	4.31	5.13	0.28	3.79	4.72	0.25	3.30	4.32	0.23	2.84
60	8	7.27	0.78	22.06	6.88	0.74	20.04	6.50	0.70	18.12	6.12	0.66	16.39
	10	7.10	0.61	14.45	6.71	0.58	13.05	6.32	0.55	11.77	5.94	0.51	10.57
	12	6.92	0.50	10.10	6.53	0.47	9.13	6.14	0.44	8.22	5.75	0.41	7.35
	14	6.72	0.41	7.37	6.33	0.39	6.64	5.94	0.37	5.95	5.55	0.34	5.30
	16	6.51	0.35	5.59	6.11	0.33	5.02	5.72	0.31	4.47	5.32	0.29	3.96

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V500-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
$^{\circ}C$	$^{\circ}C$	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa	kW	m ³ /h	kPa
40	8	4.60	0.50	10.93	4.10	0.44	8.99	3.60	0.39	7.17	3.10	0.33	5.56
	10	4.28	0.37	6.61	3.77	0.33	5.33	3.25	0.28	4.15	2.71	0.23	3.03
	12	3.92	0.28	4.21	3.38	0.24	3.25	2.83	0.20	2.22	2.32	0.17	1.30
	14	3.49	0.21	2.48	2.96	0.18	1.63	2.45	0.15	0.99	1.88	0.12	0.65
	16	3.11	0.17	1.27	2.57	0.14	0.84	1.98	0.11	0.62	1.29	0.07	0.41
45	8	5.82	0.63	15.91	5.32	0.57	13.65	4.83	0.52	11.55	4.34	0.47	9.61
	10	5.54	0.48	10.00	5.04	0.43	8.50	4.54	0.39	7.11	4.04	0.35	5.82
	12	5.23	0.38	6.69	4.72	0.34	5.62	4.20	0.30	4.61	3.68	0.27	3.68
	14	4.88	0.30	4.59	4.34	0.27	3.77	3.80	0.23	3.00	3.25	0.20	2.19
	16	4.47	0.24	3.18	3.92	0.21	2.45	3.38	0.18	1.71	2.86	0.15	1.09
50	8	7.03	0.76	21.69	6.53	0.70	19.01	6.04	0.65	16.59	5.55	0.60	14.33
	10	6.77	0.59	13.86	6.27	0.54	12.14	5.77	0.50	10.53	5.28	0.46	9.03
	12	6.49	0.47	9.41	5.98	0.43	8.19	5.48	0.39	7.05	4.96	0.36	5.98
	14	6.18	0.38	6.69	5.67	0.35	5.77	5.15	0.32	4.90	4.63	0.29	4.10
	16	5.84	0.32	4.87	5.32	0.29	4.15	4.79	0.26	3.48	4.24	0.23	2.84
55	8	8.23	0.89	27.88	7.73	0.83	25.00	7.24	0.78	22.38	6.74	0.73	19.81
	10	7.98	0.69	18.00	7.48	0.65	16.09	6.99	0.60	14.28	6.49	0.56	12.63
	12	7.72	0.56	12.44	7.22	0.52	11.07	6.72	0.48	9.78	6.22	0.45	8.56
	14	7.45	0.46	9.02	6.94	0.43	7.98	6.43	0.40	7.01	5.93	0.37	6.09
	16	7.15	0.39	6.71	6.63	0.36	5.90	6.11	0.33	5.12	5.60	0.30	4.41
60	8	9.43	1.02	34.83	8.92	0.96	31.72	8.42	0.91	28.60	7.93	0.85	25.67
	10	9.20	0.79	22.68	8.69	0.75	20.56	8.19	0.71	18.54	7.70	0.66	16.63
	12	8.95	0.64	15.80	8.45	0.61	14.28	7.94	0.57	12.84	7.45	0.54	11.47
	14	8.69	0.54	11.49	8.18	0.50	10.35	7.67	0.47	9.27	7.17	0.44	8.25
	16	8.41	0.45	8.69	7.90	0.43	7.80	7.39	0.40	6.95	6.88	0.37	6.15

Abbreviations:

ΔT : Temperature Difference ($^{\circ}C$) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V700-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	6.01	0.65	6.49	5.32	0.57	5.28	4.64	0.50	4.17	3.94	0.43	3.17
	10	5.47	0.47	3.81	4.76	0.41	3.01	4.03	0.35	2.25	3.33	0.29	1.44
	12	4.85	0.35	2.26	4.14	0.30	1.57	3.48	0.25	0.98	2.82	0.20	0.59
	14	4.27	0.26	1.11	3.62	0.22	0.72	2.91	0.18	0.51	2.14	0.13	0.37
	16	3.74	0.20	0.60	3.00	0.16	0.47	2.21	0.12	0.35	1.33	0.07	0.21
45	8	7.70	0.83	9.70	7.03	0.76	8.28	6.35	0.69	6.96	5.68	0.61	5.75
	10	7.23	0.62	5.96	6.55	0.56	5.03	5.86	0.51	4.16	5.17	0.45	3.36
	12	6.72	0.48	3.88	6.01	0.43	3.22	5.30	0.38	2.60	4.56	0.33	2.00
	14	6.12	0.38	2.56	5.38	0.33	2.03	4.65	0.29	1.48	3.97	0.24	0.98
	16	5.48	0.30	1.57	4.79	0.26	1.11	4.13	0.22	0.75	3.45	0.19	0.51
50	8	9.38	1.01	13.33	8.70	0.94	11.71	8.03	0.87	10.18	7.36	0.79	8.76
	10	8.95	0.77	8.42	8.27	0.71	7.35	7.59	0.66	6.34	6.91	0.60	5.40
	12	8.48	0.61	5.62	7.79	0.56	4.86	7.10	0.51	4.14	6.40	0.46	3.48
	14	7.97	0.49	3.90	7.26	0.45	3.33	6.55	0.40	2.80	5.83	0.36	2.30
	16	7.41	0.40	2.77	6.68	0.36	2.33	5.93	0.32	1.89	5.19	0.28	1.44
55	8	11.05	1.19	17.46	10.37	1.12	15.62	9.69	1.04	13.82	9.02	0.97	12.20
	10	10.64	0.92	11.12	9.96	0.86	9.91	9.28	0.80	8.77	8.60	0.74	7.70
	12	10.20	0.73	7.55	9.51	0.68	6.69	8.83	0.63	5.88	8.14	0.59	5.12
	14	9.74	0.60	5.39	9.05	0.56	4.74	8.35	0.52	4.14	7.66	0.47	3.57
	16	9.24	0.50	3.92	8.53	0.46	3.43	7.82	0.42	2.96	7.11	0.38	2.51
60	8	12.71	1.37	21.79	12.03	1.30	19.77	11.34	1.22	17.93	10.68	1.15	16.12
	10	12.32	1.06	14.08	11.63	1.00	12.68	10.95	0.94	11.41	10.27	0.89	10.21
	12	11.91	0.86	9.69	11.22	0.81	8.74	10.53	0.76	7.84	9.85	0.71	6.98
	14	11.47	0.71	6.96	10.78	0.66	6.25	10.09	0.62	5.58	9.40	0.58	4.94
	16	11.01	0.59	5.20	10.31	0.56	4.64	9.61	0.52	4.12	8.92	0.48	3.62

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)

MDKH2(3)-V800-R4													
EWT	ΔT	Indoor temperature (W.B.)											
		16			18			20			22		
		TH	WF	WPD	TH	WF	WPD	TH	WF	WPD	TH	WF	WPD
°C	°C	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa	kW	m³/h	kPa
40	8	7.67	0.83	14.87	6.86	0.74	12.26	6.04	0.65	9.87	5.22	0.56	7.64
	10	7.18	0.62	9.07	6.35	0.55	7.34	5.50	0.47	5.76	4.63	0.40	4.31
	12	6.63	0.48	5.86	5.75	0.41	4.61	4.84	0.35	3.38	3.95	0.28	2.08
	14	5.96	0.37	3.75	5.05	0.31	2.59	4.18	0.26	1.55	3.27	0.20	0.89
	16	5.28	0.29	2.02	4.41	0.24	1.25	3.44	0.19	0.82	2.30	0.12	0.55
45	8	9.67	1.04	21.52	8.85	0.95	18.49	8.05	0.87	15.67	7.24	0.78	13.07
	10	9.24	0.80	13.60	8.41	0.73	11.58	7.59	0.66	9.71	6.77	0.58	7.98
	12	8.76	0.63	9.16	7.93	0.57	7.72	7.08	0.51	6.37	6.23	0.45	5.12
	14	8.22	0.51	6.34	7.36	0.45	5.25	6.47	0.40	4.23	5.56	0.34	3.25
	16	7.62	0.41	4.48	6.70	0.36	3.59	5.77	0.31	2.66	4.87	0.26	1.74
50	8	11.64	1.25	29.11	10.84	1.17	25.78	10.02	1.08	22.53	9.22	0.99	19.38
	10	11.25	0.97	18.76	10.43	0.90	16.45	9.62	0.83	14.29	8.80	0.76	12.27
	12	10.82	0.78	12.80	9.99	0.72	11.16	9.16	0.66	9.62	8.33	0.60	8.18
	14	10.35	0.64	9.14	9.51	0.59	7.91	8.66	0.53	6.74	7.81	0.48	5.66
	16	9.83	0.53	6.70	8.97	0.48	5.73	8.09	0.44	4.82	7.21	0.39	3.98
55	8	13.62	1.47	37.63	12.80	1.38	33.74	11.98	1.29	30.01	11.18	1.20	26.57
	10	13.24	1.14	24.31	12.42	1.07	21.73	11.60	1.00	19.30	10.79	0.93	17.02
	12	12.85	0.92	16.91	12.02	0.87	15.06	11.19	0.80	13.27	10.37	0.75	11.64
	14	12.42	0.77	12.26	11.58	0.71	10.87	10.75	0.66	9.56	9.91	0.61	8.33
	16	11.95	0.65	9.16	11.11	0.60	8.08	10.26	0.55	7.05	9.41	0.51	6.08
60	8	15.59	1.68	46.93	14.76	1.59	42.43	13.94	1.50	38.48	13.13	1.42	34.63
	10	15.23	1.31	30.44	14.41	1.24	27.71	13.58	1.17	25.01	12.77	1.10	22.44
	12	14.86	1.07	21.27	14.02	1.01	19.24	13.20	0.95	17.36	12.38	0.89	15.54
	14	14.45	0.89	15.57	13.61	0.84	14.04	12.78	0.79	12.59	11.95	0.74	11.21
	16	14.03	0.76	11.81	13.18	0.71	10.61	12.34	0.67	9.47	11.50	0.62	8.39

Abbreviations:

Δt: Temperature Difference (°C) **TH:** Total Heating Capacity (kW) **WF:** Water Flow (m³/h) **WPD:** Water Pressure Drop (kPa)